

**Summaries of BFRL Fire Research In-house  
Projects and Grants, 1993**

---

**Nora H. Jason**

**Building and Fire Research Laboratory  
Gaithersburg, MD 20899**



**United States Department of Commerce  
Technology Administration  
National Institute of Standards and Technology**

# Summaries of BFRL Fire Research In-house Projects and Grants, 1993

---

Nora H. Jason

September 1993  
Building and Fire Research Laboratory  
National Institute of Standards and Technology  
Gaithersburg, MD 20899



U.S. Department of Commerce  
Ronald H. Brown, *Secretary*  
Technology Administration  
Mary L. Good, *Under Secretary for Technology*  
National Institute of Standards and Technology  
Arati Prabhakar, *Director*

## **PREFACE**

This report describes the fire research projects performed in the Building and Fire Research Laboratory (BFRL) and under its extramural grants program during Fiscal Year 1993. BFRL is one of the eight major technical units of the National Institute of Standards and Technology (NIST).

The BFRL Fire Research Program is nationally recognized as the focal point for fire research in the United States of America. BFRL has a multi-disciplinary technical staff that is supported by extensive laboratory and computing facilities and a definitive fire research library.

The BFRL pursues NIST's commitment to meeting the critical needs of the fire community as they relate to all three of the Institute's goals: assistance to industry, fundamental research, and public health and safety. The BFRL fire program combines careful attention to the fire safety community's needs for advances in fire safety technology with its mandated role as the focal point for fire research in the United States. BFRL staff then performs basic research to improve the understanding of the elemental phenomena of fire and applied research to develop and to adapt technological tools and procedures to address critical issues of fire safety.

In addition to its in-house programs, the BFRL maintains a fire research grants program that supplements its in-house programs and through which supports most of the academic fire research in the United States. This was initiated under the Federal Fire Prevention and Control Act of 1974, which authorized the Secretary of Commerce to conduct a fire research program directly or through contracts and grants.

Third, BFRL responds to the needs of other Federal agencies and private sector organizations. This publication summarizes work performed both with funds appropriated to the BFRL Fire Research Program and under contract to outside organizations.

The BFRL Fire Research Program has directed its efforts under three program thrusts. The in-house priority projects, grants, and externally-funded efforts thus form an integrated, focussed ensemble. This publication is organized along those lines:

### **FIRE RISK AND HAZARD PREDICTION**

- Carbon Monoxide Prediction
- Turbulent Combustion
- Soot
- Engineering Analysis
- Fire Hazard Assessment
- Large Fires

### **FIRE SAFETY OF PRODUCTS AND MATERIALS**

- Materials Combustion
- Furniture Flammability
- Wall and Ceiling Fires

### **ADVANCED TECHNOLOGIES FOR FIRE SENSING AND CONTROL**

- Fire Detection
- Fire Suppression

For the convenience of the reader, an alphabetical listing of all grants is contained in Part 2.0.

## CONTENTS

|   | Page |
|---|------|
| Preface   | iii  |
| Part 1.0      BFRL/NIST Fire Program projects (in-house projects, associated grants funded by NIST, and projects funded by other agencies and private sector organizations) | 1    |
| <b>A.      FIRE RISK AND HAZARD PREDICTION</b>  |      |
| A1. <u>Carbon Monoxide Prediction</u>   | 3    |
| Carbon Monoxide Production and Prediction (in-house) . . . . .  | 5    |
| Compartment Fire Combustion Dynamics (grant) . . . . .  | 9    |
| Fundamental Mechanisms for CO and Soot Formation in Diffusion Flames (grant) . . . . .  | 13   |
| A2. <u>Turbulent Combustion</u>   | 17   |
| Fire Propagation in Concurrent Flows (grant) . . . . .  | 19   |
| Simulation of Turbulent Combustion and Transport in Fires (in-house) . . . . .  | 23   |
| A3. <u>Soot</u>   | 27   |
| Experimental and Modeling Studies of Soot and Carbon Monoxide in an Ethylene/Air Diffusion Flame (grant) . . . . .  | 29   |
| Fundamental Mechanisms for CO and Soot Formation in Diffusion Flames (grant) . . . . .  | 13   |
| Ground-Based Smoke Sampling Techniques Training Course and Collaborative Local Smoke Sampling in Saudi Arabia (KSA) . . . . .   | 33   |
| Light Scattering Studies of Fractal Soot Aggregates (grant) . . . . .   | 35   |
| Soot, Carbon Monoxide and Radiant Emissions of Luminous Turbulent Flames (grant) . . . . .  | 39   |
| Soot Formation and Evolution (in-house) . . . . .   | 43   |
| A4. <u>Engineering Analysis</u>   | 47   |
| Comprehensive Fire Risk Assessment Method (in-house) . . . . .  | 49   |
| Experimental Study of Heat Transfer and the Environment in a Room Fire (grant) . . . . .  | 51   |
| Fire and Thermal Characteristics of Navy Fire Fighter Trainers (NTSC) . . . . .   | 55   |
| Large Scale Smoke Movement (in-house) . . . . .   | 56   |
| Movement of Smoke and Hot Gases in Open Shafts (grant) . . . . .  | 59   |
| Risk Analysis for the Fire Safety of Airline Passengers (FAA) . . . . .   | 63   |
| Study of Smoke Agglomerates (NASA) . . . . .  | 65   |
| Support of the Navy Fire Modeling Program (NRL) . . . . .   | 67   |

|          |  |     |
|----------|--|-----|
| B3.      | <u>Wall and Ceiling Fires (cont)</u>   |     |
|          | Study of Heat and Smoke Movement and Their Influence on Detector and Sprinkler Response in Enclosed Spaces with Complex Ceiling Geometries (NFPRF) . . . . . | 165 |
|          | Upward Flame Spread on a Vertical Wall Under External Radiation (grant) . . . . .  | 167 |
| C.       | <b>ADVANCED FIRE SENSING AND SUPPRESSION</b>   |     |
| C1.      | <u>Fire Detection</u>  | 171 |
|          | Advanced Fire Detection Systems (in-house) . . . . .   | 173 |
|          | Balanced Design (in-house) . . . . .   | 177 |
|          | Detection and Monitoring of Fires with Open-Path FTIR (Director's Reserve) . . . . .   | 179 |
|          | Development of an Economical Video Based Fire Detection and Location System (grant) . . . . .  | 183 |
|          | Smart Fire Detection Using Neural Networks (grant) . . . . .   | 187 |
| C2.      | <u>Fire Suppression</u>  | 191 |
|          | Agent Screening for Halon 1301 Aviation Replacement (USAF) . . . . .   | 193 |
|          | Agent/System Compatibility for Halon 1301 Aviation Replacement (USAF) . . . . .  | 195 |
|          | Basic Research on Fire Suppression (grant) . . . . .   | 197 |
|          | Dynamics of Fire Suppression (in-house) . . . . .  | 201 |
|          | Evaluation of Metal vs Plastic Piping for Use in Fire Sprinkler Systems (USFA) . . . . .   | 205 |
|          | Experimental Studies on the Extinction of Diffusion Flames Using Halon Substitutes (grant) . . . . .   | 207 |
|          | Need for a Sprinkler Standard for Board and Care Facilities (USFA) . . . . .   | 211 |
|          | Predicting the Response of Sprinklers and Detectors in Large (GSA, NASA) . . . . .   | 213 |
|          | Transient Cooling of a Hot Surface by Droplets Evaporation (grant) . . . . .   | 215 |
| Part 2.0 | <b>Alphabetical Listing of BFRL Fire Research Grantees and Their Grants</b>  | 219 |

**Part 1.0      BFRL/NIST Fire Program Projects (in-house projects, associated grants funded by NIST, and projects funded by other agencies and private sector organizations)**

## **A. Fire Risk and Hazard Prediction**

### **A1. Carbon Monoxide Prediction**

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
PRIORITY PROJECT - FY93

CARBON MONOXIDE PRODUCTION AND PREDICTION

Professional Personnel

William M. Pitts, Project Leader  
Nelson P. Bryner, Chemical Engineer  
William D. Davis, Physicist  
Erik L. Johnsson, Mechanical Engineer  
George W. Mulholland, Research Chemist

Project Objective

To develop for the fire safety engineering community a fundamental understanding of the mechanisms of carbon monoxide formation in fires sufficient to produce an estimation model by July, 1994 and a detailed predictive model by July, 1998.

Scope

This program is designed to assess the importance of CO in fire toxicology (i.e., the levels of CO generated) and to provide the scientific background required to allow the prediction of CO in real fires. Efforts range from purely empirical studies such as assessments of CO production in full-scale fire tests to fundamental studies designed to improve the understanding of the chemically reacting turbulent flows which ultimately produce CO. New information which is generated is incorporated into existing BFRL models of fire behavior.

Technical Accomplishments

During FY93 work has focused on five (discussed below) components of the overall priority project plan [see W. M. Pitts, "Long-Range Plan for a Research Project on Carbon Monoxide Production and Prediction," NISTIR 89-4185, October 1989]. All of these components are designed to allow an assessment of whether or not the global equivalence ratio (GER) concept offers a viable approach for the prediction of CO formation in real fire situations. The GER concept refers to the experimental observation that concentrations of major gas species, including CO, in the well defined layers of combustion gases above simple fires can be correlated in terms of the GER. The GER is defined as the ratio of fuel to air available normalized by the ratio of fuel and air required for complete combustion to water and carbon dioxide.

1. Investigation of CO Formation in a Reduced-Scale Enclosure (Johnsson, Bryner)

Despite the importance of the problem, very few detailed investigations of CO production during full-scale fire tests are available. The principal reason for this lack of data is the high cost associated with full-scale testing. An approach which is often used is to perform experiments on a reduced scale where costs are lower and the tests are more easily manageable. A major drawback to this approach is that all the important fire parameters cannot be scaled simultaneously. Despite this, reduced-scale testing has contributed immensely to the understanding of fire behavior for conditions where the



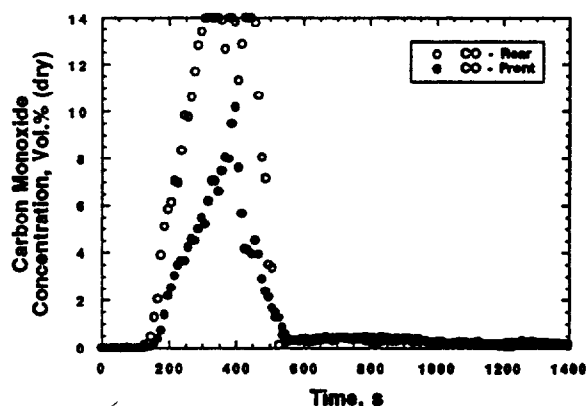


Figure 1. CO versus time for a 100 kW natural gas fire with the ceiling and upper walls lined with plywood.

combustion which generates only water and carbon dioxide as products) were the model outputs. The results provided plausible explanations for the observations of the RSE experiments.

The calculations showed that a large recirculation zone develops within the upper layer in the rear of the RSE which tends to recirculate combustion products generated by the fire plume. Direct entrainment of air into the upper layer provided an explanation for the higher upper-layer CO concentrations observed in the front of the RSE.

During the current fiscal year the calculations are being extended to incorporate flame radiation and a simple four-step chemistry model

which will allow prediction of CO concentrations. Comparisons of calculated and experimental behaviors are to be used to assess the validity of the model.

### 3. Chemical Stability of Upper Layers in Fires (Pitts)

Previous work had employed detailed chemical kinetic modeling to predict the reaction behavior of combustion gases observed in the hood experiments. These calculations showed that if air were entrained directly into a rich, high temperature upper layer, reaction would occur which would generate primarily CO in preference to  $\text{CO}_2$ . The results for the natural gas burns in the RSE have been explained in this way.

During the current year equilibrium calculations for the combustion gas mixtures observed in upper layers above fires burning in an open laboratory have been carried out. These indicate that very high levels of CO will be formed if the high temperature gases come into full chemical equilibrium. It has been found, however, that the gases do not start to approach equilibrium in reasonable times until temperatures exceed 1300 K. Since enclosure fires generally have upper-layer temperatures below 1300 K, the findings indicate that full equilibrium is unlikely in most enclosure fires. The combustion gases are therefore "frozen" in a nonequilibrium state determined by quenching of the fire plume and reactions within the upper layer. A manuscript describing these findings has been prepared for publication.

### 4. Development of an Instrument for Measuring the Global Equivalence Ratios in Fire Gases (Mulholland and Babrauskas)

This device uses complete oxidation and a single oxygen measurement to yield the local equivalence ratio for a sample of combustion gases. A manuscript has been prepared and submitted which describes the development and use of the  $\phi$ -meter.

**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT - FY93**

**Institution:** Virginia Polytechnic Institute & State University  
**Grant No.:** 60NANB1D1176  
**Grant Title:** Compartment Fire Combustion Dynamics  
**Principal Investigators:** Uri Vandsburger  
Department of Mechanical Engineering  
Virginia Polytechnic Institute & State University  
Blacksburg, Virginia 24061-0238

Richard J. Roby  
Hughes Associates  
Suite 125  
6770 Oak Hall Lane  
Columbia, Maryland 21045

**Other Professional Personnel:** David S. Ewens (M.S. Candidate)  
Wade Cole (Undergraduate Assistant)  
C. Harrison Smith (Undergraduate Assistant)

**NIST Scientific Officer:** Dr. William M. Pitts

**Technical Abstract:**

**Introduction and Facilities**

Compartment fires under fuel rich conditions (typical of compartment fires) have been shown to produce hazardous levels of carbon monoxide and smoke. Previous research has investigated the effect of external burning on exhaust gases as they spill into the open atmosphere and mix with ambient air [1]. That work has shown significant oxidation of carbon monoxide and smoke during sustained external burning of the exhausting gases [1]. However, the leading cause of deaths in compartment fires is carbon monoxide inhalation in neighboring rooms, remote from the fire. The present study focuses on the transport, and oxidation, of fuel rich exhaust gases in enclosed spaces located adjacent to and remotely from a compartment fire.

The goals for the current three year research effort are to (1) further quantify the efficiency of external flames in destroying toxic gases produced in the compartment, and (2) evaluate the robustness of existing CO yield correlation's for forced ventilation compartment fires designed to include poorly defined two-layer environments.

The main structure used consists of two levels, a 1.2 x 1.5 x 1.2 m fire compartment located above a 1.2 x 1.4 x 0.3 m high air distribution plenum. The inside of the fire compartment is covered with 2.54 cm thick Fire Master, UL rated, fire insulation board. A 1.8 m long, 30.5 cm diameter air inlet duct allows air to be drawn naturally into the air distribution plenum. The air plenum supplies air uniformly to the fire compartment through two thermally shielded vents, one on each side of the fire compartment floor. A window style exhaust vent, centered in the width direction, is located on the front of the fire compartment and opens into a 3.66 m long, 1.14 m wide, and 1.47 m tall hallway. The exhaust vent size is adjustable in order to vary the overall equivalence ratio. The hallway ceiling consists of the same fire board as in the compartment and the walls consist of dry wall covered with Fiberfax fireproof insulating sheets.

A 1.5 x 1.5 m hood collects all exhaust gases exiting the end of the hallway, and into a 45.7 cm diameter duct. A gas sampling probe and laser system in the exhaust duct allow for continuous

Figure 4 shows these equivalence ratios for the hallway experiments versus exhaust vent area for one fuel pan size (22.9 cm diameter). The data appears to suggest exponential behavior, as would be expected for vent areas approaching zero or infinity. The exhaust vent area (and fuel pan size) acts to limit the ignition source (i.e. flame jets from the compartment) from igniting the exhausting gases. Exponential curves fit to the data are shown in the figure with the regions of external burning indicated.

### Summary

The transport of compartment fire exhaust gases through an adjacent hallway has a dramatic effect on the evolution of combustion intermediates. Most notable the oxidation of CO is much reduced compared with external jet burning, resulting in a higher CO yield. Unburned hydrocarbons in contrast are oxidized efficiently. Soot is oxidized as efficient or more efficient than in the external jet experiments. The inefficient CO oxidation is attributed to a relatively low kinetic oxidation rate as a result of limitations on oxygen availability and temperature levels. Characteristic equivalence ratios display exponential behavior with respect to exhaust vent area, where this behavior was not as evident in the external jet experiments. Future work includes completing more detailed hallway experiments. Experiments on a forced ventilation compartment will also be completed in the future.

### References:

1. Gottuk, D. T., "The Generation of Carbon Monoxide in Compartment Fires," Ph.D. Dissertation, Virginia Polytechnic Institute & State University, Department of Mechanical Engineering, 1992.
2. Glassman, I., "Combustion", second edition, Academic Press, Inc., Orlando, Fla., 1987.
3. Pitts, W. M., "Reactivity of Product Gases Generated in Idealized Enclosure Fire Environments," Twenty-fourth Symposium (International) on Combustion, The Combustion Institute, 1992, p. 1737.
4. Dagaut, P., Boettner, J. C., and Cathonnet, M., International Journal of Chemical Kinetics, Vol. 22, 1990, p. 641.

### Acknowledgments:

We would like to thank Dan Gottuk for his thoughts and suggestions, enabling us a smoother start. The personnel of the mechanical engineering machine shop have also been very helpful in fabricating the new equipment.

### Reports and Papers:

- Peatross, M. J., "Experimental Study of Forced Ventilation Glove Box Fires," M.S. Thesis, Virginia Polytechnic Institute & State University, Department of Mechanical Engineering, August 1992.
- Gottuk, D. T., "The Generation of Carbon Monoxide in Compartment Fires," Ph.D. Dissertation, NIST-GCR-92-619, Virginia Polytechnic Institute & State University, Department of Mechanical Engineering, September 1992.
- Gottuk, D. T., Roby, R. J., and Beyler, C. L., "A Study of Carbon Monoxide and Smoke Yields from Compartment Fires with External Burning," presented at the Twenty-Fourth Symposium on Combustion, Combustion Institute, December 1992, pp. 17-29.
- Gottuk, D. T., Roby, R. J., Peatross, M. J., and Beyler, C. L., "Carbon Monoxide Production in Compartment Fires," Journal of Fire Protection Engineering, Vol. 4, No. 4, 1992, p. 133.
- Ewens, D. S., Vandsburger, U., and Roby, R. J., "Oxidation of Exhaust Gases in a Remote Location from a Burning Compartment," presented at the Eastern States Section Meeting of the Combustion Institute, Princeton, NJ, October 25-27, 1993.

**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT - FY93**

**Institution:** The Pennsylvania State University

**Grant No.:** 60NANB0D1035

**Grant Title:** Fundamental Mechanisms of CO and Soot Formation in Diffusion Flames

**Principal Investigator:** Professor Robert J. Santoro  
Department of Mechanical Engineering  
240 Research Building E  
University Park, PA 16802

**Other Professional Personnel:** R. Puri, Doctoral Student  
S. Léonard, Graduate Student

**NIST Scientific Officer:** Dr. Kermit C. Smyth

**Technical Abstract:**

**Introduction:** Since CO inhalation is one of the major causes of fire fatalities, significant effort has been directed towards obtaining an understanding of the increased CO production in fires. Numerous workers have observed a correlation between the amounts of CO and soot produced in diffusion flames [1] as well as compartment fires [2]. There have also been several studies of the species produced by underventilated turbulent flames [3,4]. In these studies, there is an abrupt increase in the CO concentration at a global equivalence ratio of 1.0. This large increase in CO is of concern in regards to safety implications for fires in structures and is a motivation for the present study of simpler underventilated laminar diffusion flames.

The focus of the present study is to provide a quantitative data base on the production of CO and smoke particulates from laminar underventilated diffusion flames à la Burke and Schumann [5]. Advantages of the underventilated laminar diffusion flame system include a wide range of  $\Phi$  up to at least 4, the ease in measuring  $\Phi$  and the yields of CO and smoke, and the potential for theoretical analysis of the generation rates of the combustion products. In the present study, emphasis is given to the general trends observed for both CO and soot production in terms of the global equivalence ratio. The trends in the CO and soot yields in these underventilated laminar flame studies differ distinctively from results observed in overventilated diffusion flames. Additionally, the very nature of the soot formed in these flames is different from that observed in the more widely studied overventilated conditions.

**Experimental Approach:** Underventilated diffusion flames refer to conditions where the amount of oxidizer flow is insufficient to result in the oxidation of all of the fuel to carbon dioxide and water. In the present study, the fuel-to-oxidizer ratio is characterized by the overall equivalence ratio,  $\Phi$ , based on the ratio of the inlet fuel and air flow rates, where  $\Phi$  greater than one correspond to fuel-rich conditions.

conditions. In particular, the proportionality between smoke yield and CO yield observed for the post-flame (overfire) region of overventilated flames for a wide range of fuels is not found to be valid for the underventilated case. In fact, the soot observed in the underventilated flames is observed to vary considerably in terms of the chemical structure from that typically observed in overventilated flames. The highly organic nature of the soot implies that the structure of the soot may be more similar to early agglutinated soot particles recently observed in diffusion flames than to the more aged aggregates typical of the post-flame region for overventilated flames. Based on additional results, comparisons in terms of the ratio of CO and CO<sub>2</sub> as a function of global equivalence ratio in the post-flame region of the underventilated flames show a similar behavior to that previously observed for in-flame measurements for both overventilated and underventilated diffusion flames which examined the dependence of this ratio on local equivalence ratio conditions. This suggests that for the in-flame fuel-rich region, the chemical environment excluding soot is correlated with equivalence ratio in a similar way for both an overventilated flame and an underventilated flame. The low production of CO in the post-flame region of overventilated flames is simply a result of the oxidation of CO to CO<sub>2</sub> in the upper region of these flames. Finally, the present studies illustrate the utility of the study of underventilated flame environments where product yields and trends can be quite different from overventilated conditions. These studies should have significance for combustion phenomena in which underventilated conditions are typical, such as in fires.

**Acknowledgement:** The work done at The Pennsylvania State University was supported under grant 60NANB0D1035 from the National Institute of Standards and Technology. Contributions to this work by Drs. Kermit C. Smyth and George W. Mulholland of the Building and Fire Research Laboratory are gratefully acknowledged.

#### References:

1. Köylü, Ü.Ö., Sivathanu, Y.R., and Faeth, G.M., Fire Safety Science - Proceedings of the Third International Symposium (G. Cox and B. Langford, Eds.), Elsevier, p. 625 (1991).
2. Fischer, S.J., and Grosshandler, W.L., Twenty-Second Symposium (International) on Combustion, p. 1241 (1988).
3. Zukoski, E.E., Morehart, J.H., Kubota, T. and Toner, S.J., Combustion and Flame, 83:325-332 (1991).
4. Beyler, C.L., Fire Safety Journal 10:47-56 (1986).
5. Burke, S.P. and Schumann, T.E.W., Industrial and Engineering Chemistry, 20:998-1004 (1928).
6. Mulholland, G., Yusa, S., Yanssens, M., Twilley, W., and Babrauskas, V., Fire Safety Science - Proceedings of the Third International Symposium (G. Cox and B. Langford, Eds.), Elsevier, pp. 585-594 (1991).

#### Reports and Papers:

1. Puri, R., Moser, M., Santoro, R.J. and Smyth, K.C., "Laser-Induced Fluorescence Measurements of OH Concentrations in the Oxidation Region of Laminar, Hydrocarbon Diffusion Flames," The Twenty-Fourth Symposium (International) on Combustion, The Combustion Institute, pp. 1015-1022 (1992).
2. Puri, R., Richardson, T.F., Santoro, R.J. and Dobbins, R.A., "Aerosol Dynamic Processes of Soot Aggregates in a Laminar Ethene Diffusion Flame," Combustion and Flame, 92:320-333 (1993).
3. Léonard, S., Mulholland, G.W., Puri, R. and Santoro, R.J., "Generation of CO and Smoke During Underventilated Combustion," submitted to Combustion and Flame.
4. Puri, R., Santoro, R.J. and Smyth, K.C., "The Oxidation of Soot and Carbon Monoxide in Hydrocarbon Diffusion Flames," submitted to Combustion and Flame.

## **A2. Turbulent Combustion**

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT-FY93

Institution: University of California, Berkeley

Grant No.: 60NANB1D1174

Grant Title: Fire Propagation in Concurrent Flows

Principal Investigator: Professor A. Carlos Fernandez-Pello  
Department of Mechanical Engineering  
University of California  
Berkeley, CA 94720  
Telephone: (510) 642-6554  
Fax: (510) 642-6163

Other Professional Personnel: Y.H. Chao, Doctoral Student

NIST Scientific Officer: Mr. Kenneth Steckler

Technical Abstract:

An experimental study is being conducted of the effect of gas flow velocity, turbulence intensity, and oxygen concentration on the concurrent spread of flames over the surface of a solid combustible. These experiments address both the transport and chemical kinetics mechanisms that control flame spread, and thus should provide information about what which ones are dominant, and under what conditions they are. This information could be used to provide simplified formulas of flame spread rate for use in fire models. The experiments include measurements of the flame spread rate, mass burning rate, flame length, surface heat flux, combustion products (CO, CO<sub>2</sub>, HC), and soot, as a function of the flow conditions. The tests are conducted in a combustion wind tunnel with the fuel mounted in the ceiling or the floor of the tunnel test section to observe, by comparison, the effect of buoyancy and geometry. All the tests are conducted with PMMA sheets 76 mm long, 37 mm wide and 12.7 mm thick. The tests are conducted with air flow velocities ranging from 0.25 to 4.5 m/s, grid induced turbulence intensities from 1% to 15%, and oxygen mass fractions from 0.19 to 0.4.

The measurements show that there is a complex interaction between the flow transport mechanisms, and the chemical kinetics mechanisms that control the flame spread process. This interaction determines the surface heat flux, the flame length, the rate of heat release, and through them the flame spread rate. Currently we are working on completing a test matrix that will allow us to map the different regimes of flame spread. The objective is to determine the regimes at which the flame spread process is controlled by transport mechanisms, or by chemical kinetics mechanisms. Such differentiation will help in the development of simplified formulas of flame spread to be used in models of fire development.

Turbulent, Concurrent, Ceiling Flame Spread

The flame spread rate measurements show that, in general, the flame spread rate increases as the flow velocity and oxygen concentration is increased although the rate of increase depends on the level

surface heat flux would, in turn, result in an enhanced solid heating, a larger pyrolysis rate and consequently a larger flame length. However, the enhanced mixing should also result in a shortening of the flame as the combustion efficiency is improved. The competition between these two effects, would determine the final flame length and its dependence on the turbulence intensity. The CO measurements also show that the worst conditions for incompleteness of combustion are low oxygen concentration, velocity and turbulence intensity. This observation is important since these are conditions that often prevail in fires.

#### Publications and Presentations

1. Zhou, L. and Fernandez-Pello A.C., "Turbulent, Concurrent, Ceiling Flame Spread: The Effect of Buoyancy," *Combustion and Flame*, 92, 45, 1993.
2. Zhou, L. and Fernandez-Pello A.C., "Solid Fuel Combustion in a Forced, Turbulent, Flat Plate Flow: The Effect of Buoyancy" *Twenty-Fourth International Symposium on Combustion*, The Combustion Institute, Pittsburgh, PA, 1721, 1992.
3. Zhou, L., "Solid Fuel Flame Spread and Mass Burning in Turbulent Flow" Ph.D. Thesis, University of California, Berkeley, CA, 1991.
4. Chao, Y.H. and Fernandez-Pello, A.C., "Flame Spread in a Vitiated Concurrent Flow," Heat Transfer in Fire and Combustion, 1992 ASME/AIChE National Heat Transfer Conference, San Diego, CA, August 1992.
5. Chao, Y.H. and Fernandez-Pello, A.C., "Turbulent Concurrent Flame Spread: Effect of Oxygen Concentration," 1993 Spring Meeting, Western States Section/The Combustion Institute, Salt Lake City, UT.

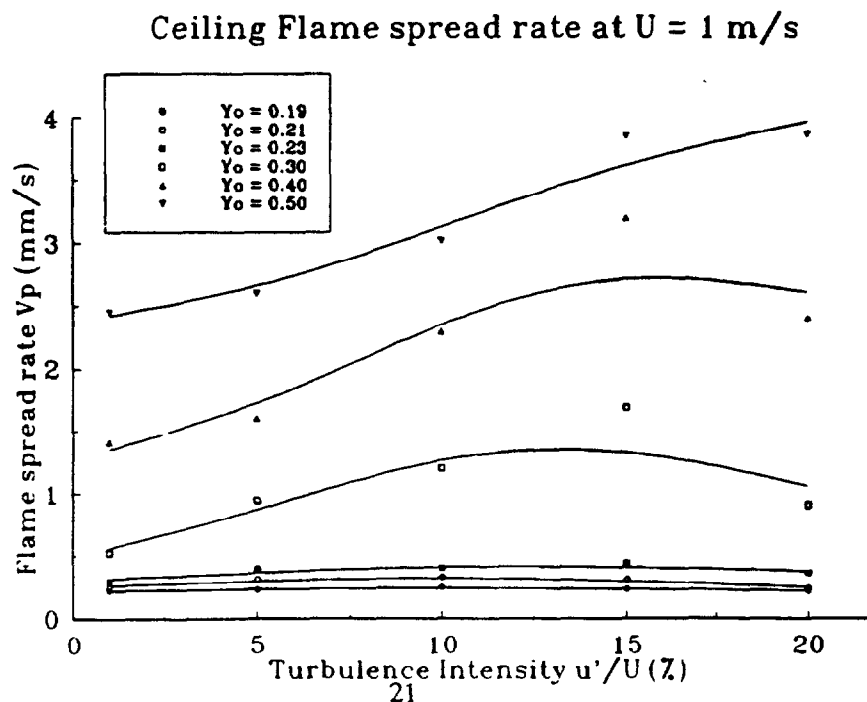


FIG. 1.



BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
PRIORITY PROJECT -FY93

SIMULATION OF TURBULENT COMBUSTION AND TRANSPORT IN FIRES

Professional Personnel

Howard R. Baum, Project Leader  
Ronald G. Rehm, CAML  
Kevin B. McGratten  
Ofodike A. Ezekoye (now at U. Texas Austin)

Project Objective

To develop a fundamental understanding of the mechanisms which control the gas phase combustion and transport processes in fires and develop a predictive capability which will allow the computer simulation of these processes to be based on the mathematical expression of underlying physical principles.

Scope

A theoretical and computational approach to the study of the transport, mixing, diffusion, reaction, and radiation processes occurring in both enclosure and exterior fires. Emphasis is placed on gaining an understanding both of the individual phenomena, which occur on widely differing length and time scales, and on the interaction between them. Analyses and computer simulations of separate phenomena are combined and applied to problems of general interest.

Technical Accomplishments

The enclosure fire model contains a employing calculation based on two-dimensional time dependent solutions of the Navier-Stokes equations in the Boussinesq limit. The calculations are performed using a conformal transformation of the spatial variables allowing the equations to be solved in an arbitrary polygonal domain. The conformal map transforms the physical geometry into a rectangular domain in which the transformed equations are solved using finite difference techniques. The flows are driven by a combustion model in which the heat is released on Lagrangian fuel elements which are convected by the large scale fluid motion. This is the high Reynolds number limit of diffusion controlled combustion on discrete fuel elements. The model permits computations of smoke and hot gas transport at Reynolds numbers of order  $10^5$  in enclosures of complex shape without employing empirical turbulence models.

motion. The model predicts the rise and stabilization of the thermal plume, the separation of the particulate plume, and its descent to ground level. When the particulate is within one computational cell of the ground, it is removed from the atmosphere and its position in the ground plane recorded. The totality of final ground level positions is the particulate deposition pattern.

The trajectory predicted by the model has been compared with field observation performed at the U.S. Coast Guard site in Mobile, AL, for the rising and stabilization portions of the plume. The results to date are quite encouraging. The observed large scale eddy structure in particular is captured quite well by the model.

### Publications

Baum, H.R., "Simulation of Convection and Combustion Processes in Fires", in *Computers and Computing in Heat Transfer Science and Engineering*, (Nakayama, W. and Yang, K.T., Eds), CRC Press, Boca Raton, p.207, (1992).

Rehm, R.G., Baum, H.R., Tang, H.C., and Lozier, D.C., "Finite-Rate Diffusion-Controlled Reaction in a Vortex", *Combust. Sci. and Tech.*, Vol. 91, p.143, (1993).

Ghoniem, A.F., Zhang, X., Knio, O., Baum, H.R., and Rehm, R.G., "Dispersion and deposition of smoke plumes generated in massive fires", *J. Hazardous Materials*, 33, p.275, (1993).

Baum, H.R., Ezekoye, O.A., McGrattan, K.B., and Rehm, R.G., , "Mathematical Modeling and Computer Simulation of Fire Phenomena", *Proceedings of the Ninth Symposium on Turbulent Shear Flows*, Kyoto, Japan, (1993).

Walton, W.D., Evans, D.E., McGrattan, K.B., Baum, H.R., Twilley, W.H., Madrzykowski, D., Putorti, A.D., and Rehm, R.G., "In Situ Burning of Oil Spills: Mesoscale Experiments", *Proceedings of the Sixteenth Arctic and Marine Oil Spill Program Technical Seminar*, Environment Canada, Ottawa, p.679, (1993).

### Related Grants

"Radiation from Turbulent Luminous Flames", Prof. G.M. Faeth, University of Michigan.

"Fire Modeling", Prof. P.J. Pagni, University of California, Berkeley.

"Numerical Modeling of Plume Dispersion and Smoke Deposition from Large Scale Fires", Prof. A.F. Ghoniem, Massachusetts Institute of Technology.

"Modeling of Combustion, Fluid Mechanics, and Radiation in Buoyant Turbulent Fires", Prof. O.A. Ezekoye, University of Texas at Austin

### **A3. Soot**

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT - FY93

**Institution:** The George Washington University

**Grant Number:** 60NANB1D1292

**Grant Title:** Experimental and Modeling Studies of Soot and Carbon Monoxide in an Ethylene/Air Diffusion Flame

**Principal Investigator:** Professor J. Houston Miller  
Department of Chemistry  
The George Washington University  
Washington, DC 20052  
(202) 994-7474

**Other Personnel:** Mr. R. Reed Skaggs, Graduate Student  
Mr. Michael Marro, Graduate Student  
Mr. Michael Tolocka, Graduate Student  
Ms. Khanh Le, Undergraduate Student

**NIST Scientific Officer:** Dr. Kermit C. Smyth

**Technical Abstract:**

During the past year our work focussed on three areas:

- the continuing development of a model for PAH growth in hydrocarbon diffusion flames with an emphasis on those burning ethylene,
- the application of tunable diode laser absorption spectroscopy to the study of ethylene/air diffusion flames near their smoke point, and
- the development of an efficient simulation program for infrared spectral signatures such as those which are observed at high resolution using narrow bandwidth lasers as well as those which would be available using more conventional Fourier Transform Infrared Spectrometry (FTIR).

Significant progress was made in all three of these areas as will be described below.

*PAH growth model in ethylene/air flames*

We have made some preliminary progress in modelling PAH and soot growth in ethylene/air flames. In last year's report, we described the development of this model for axially symmetric methane/air flames. Our model begins with a simple parabolic calculation of flame structure which solves conservation equations for mass, momentum, and mixture fraction. The energy equation is not solved; instead the experimentally determined dependence of temperature on mixture fraction is used.

were collected using a direct absorption technique. Because TDLAS is a line-of-sight technique, it is necessary to employ tomographic reconstruction to obtain radial data from the collected projection data, which is the convolution of the incremental absorptions from each spatial location in the flame traversing the length of the laser beam. We use a three point Abel inversion algorithm [3] for tomographic reconstruction of spectra for each radial location. The reconstructed spectra is then individually fit to the functional form of the second harmonic signal of a Lorentzian line shape [4]. This technique, as suggested by Varghese et al. [5], should lead to the most accurate measurements of temperature and concentration using TDLAS.

Soot particles have a graphitic morphology. Because aromatic oxidation produces copious yields of CO, we anticipate an increase in carbon monoxide concentrations at the flame tip as the quantity of soot is increased. Puri et al. have found that increased amounts of soot result in larger concentrations of CO in higher regions of flames as well as depleted hydroxyl radical species [2,7] in a series of methane flames which are either undiluted, diluted with butane, or butene. Our preliminary analysis of our data shows that centerline CO concentration levels are much higher at 55 mm HAB in the IS flame compared to those in the NS flame. The CO levels found in the sooting flame are slightly higher than those observed in the IS flame. We also observe a slight decrease in the centerline temperature for the series NS, IS, S.

#### *Spectral Simulation using the HITRAN data base*

Over the past few years we have demonstrated the application of tunable diode laser absorption spectroscopy (TDLAS) for the measurement of concentration and temperature in hydrocarbon diffusion flames. These studies have focussed on absorptions of carbon monoxide near 2150 cm<sup>-1</sup>. The great promise of the mid infrared region is that almost every molecule of interest absorbs light here.

The fractional absorption of infrared laser light is given by

$$\ln\left(\frac{I^0}{I}\right) = S(T) \cdot g(\nu - \nu^0) \cdot p_j \cdot l$$

where  $I^0$  is the incident beam intensity,  $I$  is the transmitted beam intensity,  $g$  is the line shape factor (in our work assumed to be Lorentzian),  $p_j$  is the partial pressure of the absorbing species, and  $l$  is the path length through the absorbing medium.

The line strength at flame temperatures is given by:

$$S(T) = S(296) \cdot \frac{Q_{296}}{Q_T} \cdot R \cdot \exp\left[\frac{hc}{k} \cdot E'' \cdot \frac{(T-296)}{(T \cdot 296)}\right]$$

with

$$R = \frac{1 - \exp\left[-\frac{hc}{k} \cdot \frac{(E' - E'')}{T}\right]}{1 - \exp\left[-\frac{hc}{k} \cdot \frac{(E' - E'')}{296}\right]}$$

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT - FY93

GROUND-BASED SMOKE SAMPLING TECHNIQUES TRAINING COURSE  
AND COLLABORATIVE LOCAL SMOKE SAMPLING IN SAUDI ARABIA

Funding Agency: Ministry of Defence and Aviation, Kingdom of Saudi Arabia

Professional Staff: Nelson Bryner, Project Leader  
Bruce A. Benner, Jr., Research Chemist (CSTL)  
Robert A. Fletcher, Research Chemist (CSTL)  
James E. Brown, Research Chemist  
George W. Mulholland, Research Chemist

Project Objective:

Train three Saudi operators in smoke sampling techniques, collect samples in Saudi Arabia, and jointly analyze smoke samples. Visit facilities in Riyadh, Saudi Arabia.

Technical Accomplishments:

Operator Training - NIST has trained three Saudis to operate portable gas and particulate sampling instrumentation. This training which occurred at NIST on August 17-28, 1992 involved lectures and demonstrations of gravimetric measurements, light scattering cells, portable size classifiers, battery-powered gas analyzers and filter sampling trains. NIST's organic analytical group demonstrated sample preparation and illustrated the use of gas and liquid chromatography instrumentation.

Local Sampling in Saudi Arabia - In order to demonstrate the operation of portable gas and particulate sampling instrumentation, a team of NIST researchers travelled to Riyadh in December 1992 to collect smoke and gas samples in Saudi Arabia for analysis. Analysis of smoke and gas samples will include determination of PAH, CO, CO<sub>2</sub> and total particulate concentrations. Split-sample analysis is being conducted with some samples being locally analyzed and other samples returned to NIST for more specialized analysis, such as laser microprobe analysis and scanning electron microscopy.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT-FY93

Institution: Kansas State University

Grant Number: NSF CTS 9024668

Grant Title: Light Scattering Studies of Fractal Soot Aggregates

Principal Investigator: Professor C.M. Sorensen  
Department of Physics  
Kansas State University  
Manhattan, KS 66506-2601  
(913) 532-6786

Other Professional Personnel: Mr. J. Cai, Graduate Student  
Mr. N. Lu, Graduate Student  
Mr. G. Roberts, Undergraduate Student

NIST Scientific Officer: Dr. R. Gann

Technical Abstract:

I. WORK COMPLETED DURING THE PAST YEAR

1. A Comparison of Cluster Size and Morphology Determined by Static Light Scattering and Electron Microscope Analysis

With the development of the fractal concept for describing clusters of particles and the realization that random aggregation processes lead to fractal clusters, our ability to describe and quantify the morphology of clusters so generated was significantly improved. This engendered the problem of how to experimentally determine cluster morphological parameters such as the radius of gyration,  $R_g$ , the fractal dimension,  $D_f$ , the number of monomers per aggregate,  $N$ , and the monomer radius (assumed spherical),  $a$ . This is a problem for both visual inspection via transmission electron microscopy and more so for light scattering measurements.

In previous work supported by this grant we demonstrated how the combined use of both optical structure factor measurements (scattered intensity as a function of scattering angle) and scattering/extinction measurements could yield in-situ determination of  $R_g$ ,  $D_f$ ,  $N$  and  $a$  for soot in a flame. It would be useful and important, however, to be able to make direct comparisons of these optical measurements with soot particles physically sampled from the flame. This would test the theory for the optics of fractal clusters, substantiate our ability to make in-situ optical measurements, and check the consistency of light scattering and mechanical sampling.

Our flame was supported on a cooled porous frit burner obtained from McKenna Products. The premixed gases,  $CH_4$  and  $O_2$ , passed through a 6 cm diameter porous frit. This frit was surrounded by an annular sheath region 0.5 cm wide through which nitrogen was passed. A 15 cm diameter steel stagnation plate was placed 30 mm above the burner surface to stabilize the flame. The cold gas velocity,

$R_m$  is proportional to  $R_g$  with ratio  $R_m/R_g \approx 0.6$ . Further work is in progress to carefully check this proportionality compared to a dependence on cluster projectional area which is plausible and would yield nearly the same result.

## 2. Depolarized Light Scattering from Aggregates

Static measurements of the depolarization ratio  $\rho = I_{VH}/I_{VV}$ , i.e., the ratio of scattered intensities horizontally and vertically polarized for incident vertical polarization, have been made from  $CH_4/O_2$ ,  $C_3H_8/O_2$  and  $C_2H_4/O_2$  flames. We find  $0.3 \leq \rho \leq 1.5\%$  and  $\rho$  decreases with height above the burner. Furthermore  $\rho \sim \lambda^{-4}$  and is not dependent on the scattering volume. These facts indicate  $I_{VH}$  is due to intracluster multiple scattering and not intercluster multiple scattering or cluster anisotropy. We hope this study will yield further understanding of cluster optics and methods of particle characterization for monomers per cluster and cluster index of refraction.

## 3. Cluster Morphology

An overlooked but important parameter is  $k_o$  in

$$N = k_o (R_g/a)^{D_f}$$

for fractal aggregates. We have recently measured  $k_o$  for soot aggregates collected from premixed  $CH_4/O_2$  flames to find  $k_o = 1.2 \pm 0.15$ . We are currently using computer simulations to create diffusion limited cluster aggregates and analysis shows these clusters to have  $k_o = 1.1 \pm 0.1$ . Work is underway to study other types of clusters and to obtain more real-world data.

## PAPERS

1. "Light Scattering Measurements of Monomer Size, Monomers per Aggregate and Fractal Dimension for Soot Aggregates in Flames," Appl. Optics **31**, 6547 (1992), C.M. Sorensen, J. Cai and N. Lu.
2. "Test of Static Structure Factors for Describing Light Scattering from Fractal Soot Aggregates," Langmuir **8**, 2064 (1992), C.M. Sorensen, J. Cai and N. Lu.
3. "Comment on 'Structure of Silica Gels'," accepted in Phys. Rev. Lett., C.M. Sorensen, J. Cai and N. Lu.
4. "Comparison of Size and Morphology of Soot Aggregates as Determined by Light Scattering and Electron Microscopic Analysis," accepted in Langmuir, J. Cai, N. Lu and C.M. Sorensen.



BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT —FY93

Institution: The University of Michigan

Grant No.: NANB1D1175

Grant Title: Soot, Carbon Monoxide and Radiant Emissions of Luminous Turbulent Flames

Principal Investigator: Professor G. M. Faeth  
Department of Aerospace Engineering  
The University of Michigan  
Ann Arbor, MI 48109-2140

Other Personnel: Z. Dai, Doctoral Candidate  
Ü. Ö. Köylü, Postdoctoral Fellow  
L.-K. Tseng, Postdoctoral Fellow

NIST Scientific Officer: Dr. Howard R. Baum

Technical Abstract:

Introduction. This investigation is examining two aspects of unwanted fires: (1) the structure of buoyant turbulent plumes and (2) the physical and optical properties of soot in diffusion flame environments. The findings of the research have applications to modeling fires in structures, developing materials test codes, and developing fire detectors.

Structure of Turbulent Plumes. Recent work has shown that turbulence/radiation interactions cause mean radiation levels to be biased upward (by factors of 2-4) in fire environments, in comparison to estimates based on mean scalar properties (Kounalakis et al., *J. Heat Trans.* 113, 437, 1991). Unfortunately, treating this effect requires information about mixture fraction fluctuations, that is not known very well for buoyant turbulent flows. Thus, the objective of this phase of the investigation was to complete measurements of the structure of round turbulent plumes — a classical buoyant turbulent flow relevant to fire environments. The study emphasizes the self-preserving region of the flow, where appropriately scaled properties become independent of the source.

The test plumes consisted of dense gas sources (carbon dioxide and sulfur hexafluoride) to provide negatively-buoyant plumes in still and unstratified air. Mixture fraction measurements were made using laser-induced iodine fluorescence (LIF); velocity measurements were made using laser velocimetry. Measurements emphasized large distances from the virtual origin of the flows in order to assure self-preserving conditions, i.e., up to 151 source diameters and 43 Morton length scales.

An important finding of present measurements was that earlier studies did not consider sufficient distances from the source to reach self-preserving conditions. Figure 1 is an illustration of the development of mean mixture fraction distributions with distance

transmission electron microscopy (TEM). Soot scattering and extinction were measured using an argon-ion laser operating at 514.5 nm, in conjunction with a variable angle detection system. The measurements involved round laminar jet diffusion flames of ethylene and acetylene burning in coflowing air. The structure measurements yielded fractal dimensions in the range 1.73-1.77, which is very similar to other recent measurements for a variety of flame conditions, see Köylü and Faeth, (*J. Heat Trans.*, 115, 409, 1993). Ranges of other soot structure properties for these test conditions were as follows: primary particle diameters of 21-54 nm, mean number of primary particles per aggregate of 31-83 and volume mean aggregate diameter of 87-189 nm. The scattering measurements indicated that properties of the Guinier regime, and the transition regime between Guinier and power-law scattering, were dominant; therefore, experimental objectives were satisfied. The comparison between RDG-PFA predictions, based on measured soot structure, and measured scattering properties was very good, well within discrepancies anticipated due to the experimental uncertainties of the soot structure and scattering measurements. Typical measured and predicted angular scattering patterns are illustrated in Fig. 2; the agreement between predictions and measurements is seen to be excellent. Complete results for this phase of the study are reported in Köylü and Faeth (*J. Heat Trans.*, submitted).

The second phase of the study involved comparing RDG-PFA predictions with results computed using the ICP approach (Iskander et al., *Appl. Optics* 28, 3083, 1989) which is a more exact treatment of scattering from aggregates of primary particles. In this case, aggregates were constructed using a numerical simulation, analogous to the approach of Mountain and Mulholland (*Langmuir* 4, 1321, 1988) to yield populations of aggregates of various sizes (up to 512 primary particles per aggregate). The findings indicate good performance of RDG-PFA theory, well within uncertainties of the ICP computations. Complete results of this phase of the study are reported in Farias et al. (6th AIAA/ASME Thermophysics and Heat Transfer Conference, submitted).

At the present time, the greatest impediment to the use of RDG-PFA scattering theory for nonintrusive measurements of soot properties, and estimates of the radiative properties of soot, involves long-standing uncertainties about soot refractive indices (Köylü and Faeth, *J. Heat Trans.*, 115, 409, 1993). Thus, current work is concentrating on measuring soot refractive indices for a variety of fire environments. Subsequent work will focus on the radiative properties of soot aggregates.

### Reports and Papers

1. Z. Dai, L.-K. Tseng and G.M. Faeth, "Structure of Round, Fully-Developed, Buoyant Turbulent Plumes," *J. Heat Trans.*, in press; also 29th National Heat Transfer Conference, Atlanta, 1993.
2. Z. Dai, L.-K. Tseng and G.M. Faeth, "Buoyant Turbulent Plumes Revisited." Proceedings of ISHMT/ASME Heat and Mass Transfer Conference, Bombay, in press.
3. Ü.Ö. Köylü and G.M. Faeth, "Radiative Properties of Flame-Generated Soot," *J. Heat Trans.*, Vol. 115, No. 2, pp. 409-417, 1993.
4. Ü.Ö. Köylü and G.M. Faeth, "Optical Properties of Overfire Soot in Buoyant Turbulent Diffusion Flames at Long Residence Times," *J. Heat Trans.*, in press.
5. Ü.Ö. Köylü and G.M. Faeth, "Optical Properties of Soot in Buoyant Turbulent Diffusion Flames," *J. Heat Trans.*, submitted; also, 29th National Heat Transfer Conference, Atlanta, 1993.
6. G.M. Faeth, and Ü.Ö. Köylü, "Soot Morphology and Optical Properties in Nonpremixed Flames," Proceedings of Second International Conference on

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
PRIORITY PROJECT - FY93

SOOT FORMATION AND EVOLUTION

Professional Personnel

Kermit C. Smyth, Project Leader  
George W. Mulholland, Project Leader  
Joel E. Harrington, NRC-NIST Postdoctoral Research Associate  
Christopher R. Shaddix, NRC-NIST Postdoctoral Research Associate  
Nelson P. Bryner, Chemical Engineer

Project Objectives

Develop scientifically sound principles, metrology, and data which contribute to a predictive model for the formation and evolution of smoke components in flames based upon the best available information for use in understanding fire phenomena. This work embraces broad areas underpinning the BFRL Fire Research Programs, with focussed study of hot gas chemistry and physics. The most successful descriptions of the key steps of soot formation and evolution will be identified for a comprehensive model by September, 1993. This will be used by the modelers of combustion product yields from fires.

Technical Accomplishments

During hydrocarbon combustion the exothermic chemical reactions which lead to the formation of water and carbon dioxide consume most of the fuel. However, in many cases a significant fraction of the fuel is converted into species which participate in chemical growth reactions. These processes lead to dramatic consequences in numerous combustion environments. For example, the formation of intermediate hydrocarbons, such as polycyclic aromatic hydrocarbons (PAH), occurs under fuel-rich conditions and poses a potential long term health hazard since many PAH are carcinogenic. In addition, such compounds are also involved in further growth reactions to form soot particles. Radiation from soot dominates energy transfer from large fires, and thus soot formation plays a key role for flame spread. In turn, particle formation and radiative energy transfer control the amount of smoke produced, which is important in fire detection and pollutant emission. In contrast to the oxidation of simple hydrocarbons, which is reasonably well understood, the detailed mechanisms for producing large hydrocarbons during combustion have not been established. The elucidation of chemical growth mechanisms continues to be one of the most challenging research problems in combustion science today.

While the chemical growth reactions play a key role in regard to the total amount of smoke produced, the actual structure of the smoke leaving the flame region is determined by a physical agglomeration process of particles sticking and forming a cluster. The agglomerate structure consists of a number of

carried out in the steady-state and time-varying flames as a function of height above the burner. Quantitative measurements of the increase in soot volume fraction in the time-varying flames have been made using extinction and tomographic reconstruction methods. These are the first spatially resolved measurements of the soot volume fraction in a time-varying flame.

Time-varying flames exhibit a larger range of combustion conditions than observed in corresponding steady-state flames, including different residence times, temperature histories, local stoichiometries, and strain and scalar dissipation rates. Thus, their investigation promises to yield new insights into a wide variety of chemistry-flowfield interactions which are prominent in turbulent combustion.

## 2. Smoke Agglomerates

This portion of the project focusses on the properties of the smoke agglomerates above the flame zone. During the past year, we have compared the fractal smoke optics model with light extinction measurements. We are also in the process of comparing soot volume fraction measurements made by an optical technique with results obtained gravimetrically.

The mass specific extinction was measured at wavelengths of 450, 630, and 1000 nm in a smoke filled chamber with an optical pathlength of 1.0 m. The facility was equipped to continuously monitor particle mass concentration with a tapered element microbalance and number concentration with a condensation nucleus counter over a 90-120 min interval. The smoke was generated by the burning of crude oil in a pool fire. The mass specific extinction at all three wavelengths was found to be constant even though the agglomerate number concentration decreased by about a factor of 25 owing to cluster-cluster agglomeration. During this time period the average number of primary spheres per agglomerate increased from about 200 to a final value of about 4500. The constancy of the specific extinction was observed for the chamber at ambient temperature and at 100°C. The measured mass extinction coefficients agree with fractal optics prediction if the real part of the refractive index is near 1.55 and the imaginary part varies systematically with the wavelength of light from the violet to IR spectral regions. However, the real and imaginary portions of the refractive index are uniquely defined only when both specific extinction and specific absorption are prescribed. A major conclusion of our study is that the treatment of the agglomerates as an effective sphere together with using Mie theory is inconsistent with our measurements.

Recent studies indicate a large uncertainty in the measurement of the soot volume fraction by optical techniques because of the uncertainty in the particle refractive index. To quantify the uncertainty in the optical measurements, we are performing simultaneous soot volume fraction measurements by two independent methods for soot generated by a premixed acetylene burner. One method is based on light extinction measurements and the second is a gravimetric technique which involves isokinetic sampling of the soot, measurement of the mass of soot collected, and the determination of the soot density by helium pycnometry. The soot is diluted with nitrogen above the flame so that the gas temperature is about 500 K where the sampling and optical measurements are performed. Preliminary results indicate that the optical measurements at a wavelength of 632.8 nm based on the Dalzell-Sarofim dispersion relation overestimate the soot volume fraction by 30 to 50% for the acetylene burner operating at equivalence ratios of 2.3 and 2.5.

In addition to the studies outlined above, Kermit Smyth and George Mulholland have completed an internal document which identifies the best available modeling capabilities for the key steps of soot formation, destruction, and evolution. Remaining issues are also specified.

## **A4. Engineering Analysis**

**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
PRIORITY PROJECT - FY93**

**COMPREHENSIVE FIRE RISK ASSESSMENT METHOD**

Professional Personnel

Richard W. Bukowski, Project Leader  
Scot Deal

Project Objective

To develop an internationally accepted fire risk calculation method that is suitable as the foundation for a performance fire code by 1996.

Scope

The first step is to establish an international, cooperative effort under one or more of the organizations mentioned above. We will volunteer to chair the activity, but acceptance of this is up to a vote of the group. A working group will be established where participants are funded by their own organizations. This group will need to review the existing body of work and identify the elements which should form the final methodology, including optional components. The three methods reviewed in a recent paper (Japan, Australia, and US) are ostensibly complete, although some portions of each contain only place holders due to limitations in the technology. These need to be identified and the research needed to fill these gaps needs to be done.

Technical Accomplishments

A working group has been established with participation from about 12 countries. The FORUM has endorsed the activity and committed to provide financing for staff to participate. A formal charter from CIB W14 is being sought in order to facilitate the financial arrangements from the individual participating countries. Papers related to the project have been solicited from all participants and have been collected and circulated.

Several initial project collaborations have been identified and the working relationships are being worked out. A joint effort on structural performance prediction has been established between US and Canada with interest expressed by Australia and Japan. A project on uncertainty assessment of models and data has been outlined. This would provide a mechanism for qualifying calculational techniques on the basis of computational uncertainty related to design safety factors. Interest in working this issue has been expressed by Sweden, Norway, UK, and Australia; and would be led by US. Other collaborations on verifying zone models and adding phenomena to CFAST have been discussed.

Some effort has been put into establishing a grants program in risk at FM. This will proceed, and will provide insight into Bayesian techniques which can be used to supplement sparse data on incidents.

**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT - FY93**

**Institution:** California Institute of Technology

**Grant No.** 60NANB9D0958

**Grant Title:** Experimental Study of Heat Transfer and the Environment in a Room Fire

**Principal Investigator:** E. E. Zukoski  
Jet Propulsion Center, 301-46  
California Institute of Technology  
Pasadena, CA 91125

**Other Professional Personnel:** T. Kubota, Professor Emeritus  
  
R. Chan, Doctoral Student  
S. Palm, Master's Student  
D. Revolinski, Doctoral Student

**NIST Scientific Officer:** Dr. Leonard Y. Cooper

**TECHNICAL ABSTRACT**

During the past year we have been investigating four problem areas. These are the influence of viscosity on the propagation of hot smoke layers in horizontal passages with a large length to width ratio, the evolution of chemical species in a transient ceiling layer formed in a large hood by a suddenly lighted fire with a constant heat release rate, the entrainment of ambient air by fire-plumes, and the flow of hot gas up a closed shaft with a large height to width ratio. Progress made in each of these areas is reported in the following paragraphs with emphasis on a proposed model for entrainment of ambient gas into a fire-plume. Reports concerning the first three areas are now available.

**Gravity Currents:** Experiments concerning the motion of shallow gravity currents in long halls have been completed and are described in Chan (1993). The influence of the viscosity of the current and the ambient fluid have been clarified in these experiments.

**Transient Development of a Ceiling Layer:** We have investigated the transient development of the ceiling layer in a hood that is 2.44m square by 1.22m deep and that is open on the bottom. A 67 kW natural gas fire stabilized on a 19 cm diameter burner is started at the beginning of the experiments and the burner surface is located about 10 cm below the lower edge of the hood. This arrangement gives a steady state equivalence ratio for the gas entering the hood in the fire plume of 2.17. The data obtained in this work include measurements of

**Model for Entrainment in Fire-Plumes:** Models for the entrainment into buoyant plumes have typically been based on the work of Morton, Taylor, and Turner (1950) and their predictions have been found to be satisfactory for buoyant plumes rising above a point source. The primary problem in applying these results to fire plumes is the requirement that the source of the equivalent point source plume must be located with respect to the level of the fire. Experimental mass flux data obtained by Cetegen *et al* (1984) in a hood apparatus and data based on temperature profiles along the centerline of the plume by Kung and Stavrianidis (1984) and Hasemi (1989) have been analyzed by Heskestad (1981), Cetegen *et al* (1984) and Hasemi (1989) with the result that several models are now available to predict the elevation of the source for the equivalent point source

plume relative to the elevation of the fire source. The resulting correlation for the mass flux,  $\dot{m}_f$ , in an adiabatic and far field plume at a point,  $Z + \Delta Z_f$ , above its source and for a fire with heat release  $\dot{Q}$  is discussed in Cetegen *et al*, (1984) and can be written as:

$$\dot{m}_f = \frac{\dot{m}_f}{\rho_\infty \sqrt{gD} D^2} = 0.21 (Q_D^*)^{1/3} \left( \frac{Z}{D} + \frac{\Delta Z_f}{D} \right)^{5/3} \quad (1)$$

Here,  $Q_D^* = \dot{Q} / \left( \rho_\infty C_{p\infty} T_\infty \sqrt{gD} (D)^2 \right)$ ,  $Z$  is the elevation above the surface of the burner, and  $\Delta Z_f$  is the distance that the origin of the plume lies *below* the surface of the burner.

Descriptions of the entrainment into the flaming region of the fire, called the fire plume, have not been as satisfactory. A recent review has been made of measurements made at Caltech, see Cetegen *et al* (1984) Lim (1988), Toner (1988) and Morehart (1990), of the mass flux rates of fire-plumes for natural gas and several other fuels in flames stabilized on 10, 19 and 50 cm diameter burners. These data, show that the entrainment rate for flames in the regime for which

$0.1 \leq Q_D^* \leq 17$  have at best a very weak dependence on heat addition rate and certainty does not scale linearly or with the square root of the heat release rate. Entrainment rates obtained by Thomas *et al* (1963) and Beyler (1982) also showed no dependence on the heat release rate.

The near field, also called the the fire-plume, data collected at Caltech can be most simply correlated by the expression,  $\dot{m}_n = C_{ef} Z D$  or  $C_{ef} = \dot{m}_n / Z D$ , for  $0.1 < Q_D^* < 17$ . The parameter  $C_{ef}$  depends on  $Q_D^*$  and the data indicate that,  $C_{ef}$  is about 0.62 when  $0.1 \leq Q_D^* \leq 4$  and increases strongly with  $Q_D^*$  when  $Q_D^* \geq 4.0$ . Unfortunately, this simple mass flux correlation is not dimensionally correct and some other correlation must be sought. When allowance is made for an offset, with the origin for the  $Z$  axis located at  $\Delta Z_n$  below the fire surface, a correlation similar to that suggested Thomas,

$$\dot{m}_n = \frac{\dot{m}_n}{\rho_\infty \sqrt{gD} D^2} = 0.18 \left( \frac{Z}{D} + \frac{\Delta Z_n}{D} \right)^{3/2} \quad (2)$$



**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT - FY93**

**FIRE AND THERMAL CHARACTERISTICS OF NAVY FIRE FIGHTER TRAINERS**

Funding Agency: Naval Training Systems Center, Orlando, Florida

Professional Staff: Robert S. Levine, Project Leader

Project Objective:

Support the development and implementation of prototype fire fighter trainers.

In fighting naval fires at sea, it is essential that each seaman be trained so that they do the right thing the first time. The ship is a complex of highly flammable equipment, fuels and munitions. There is no place to retreat to if the suppression is not successful. Fire fighting may have to proceed while the ship is in action against an enemy.

The Navy's program provides facilities to allow at least one hot fire fighting training experience to each person per year. To provide safety and also minimize environmental problems, the trainers use propane as fuel.

The fire is controlled by valves, and can be shut off if the trainees are in danger. This also makes it possible to provide a good learning experience - the trainees can make a mistake, not be harmed by the fire, and can do better next time.

This is the fifth year of NIST's participation in the Navy's program. Thermal and toxic products measurements have been made in each of the five types of trainers in this program, and support has been provided for solving a number of developmental problems.

Technical Accomplishments:

Most of the effort this FY has been directed at measurements of minor air pollutants in prototype trainers, especially the Submarine Fire Fighter Trainer at Norfolk Naval Base. Information was obtained to satisfy environmental authorities at other trainer locations, especially in Washington and California. Measurements have been made utilizing the technique and equipment of the "Indoor Air Pollution" project at NIST. Estimation of pollutant concentrations are made using the EPA "SCREEN" code.

We have also measured artificial smoke density in the trainers from improved smoke generators, and have analyzed for decomposition of the smoke agent.

Two of the Navy contractors are building trainers for civilian fire fighters. Separately funded, we have made related measurements for them.

Publications:

Results have been reported in memos to the sponsors. They have handled additional distribution.

in CFAST. The cell size for conduction is the same as that defined for the field model, but the cells for radiation are the ten walls and upper layer of the room. The average temperatures of the ten walls and the upper layer are calculated from the previous step calculations of the field model. The conduction routine uses input of the average radiation plus the convection based on the adjacent fluid cell to calculate wall temperatures. This approach is considerably more efficient and numerically stable than the corresponding routines in FLOW3D.

#### Reports and Publications:

"Smoke Movement in a Corridor: Hybrid Model, Simple Model and Comparison With Experiments," Matsushita, T., Klotz, J.H., National Institute of Standards and Technology, NISTIR 4982, 1992.

"Design of Smoke Management Systems," Klotz, J.H., Milke, J.A., American Society of Heating, Refrigerating and Air Conditioning Engineers, Atlanta, GA 1992.

"Workshop on Elevator Use During Fires," Klotz, J.H., Deal, S.P., Levin, B.M., Groner, N.E., Donoghue, E.A., National Institute of Standards and Technology, NISTIR 4993, 1993.

"Design of Smoke Control Systems for Areas of Refuge," Klotz, J.H., National Institute of Standards and Technology, NISTIR 5132, 1993.

#### Related Grants:

Flow Through Horizontal Vents as Related to Compartment Fire Environments, Rutgers - State University of New Jersey.

Experimental Study of Environmental and Heat Transfer in a Room Fire, CALTECH.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT - FY93

Institution: Rutgers, The State University of New Jersey  
New Brunswick, New Jersey

Grant No.: 60NANB1H1171

Grant Title: Movement of Smoke and Hot Gases in Open Shafts

Principal Investigator: Professor Yogesh Jaluria  
Department of Mechanical and Aerospace Engineering  
Rutgers, The State University of New Jersey  
New Brunswick, NJ 08903  
Telephone: (908)932-3652

Other Professional Personnel: S.H.-K. Lee (Ph.D. Student)  
G.P. Mercier (M.S. Student)  
W.K.-S. Chiu (Research Assistant)

NIST Scientific Officer: Dr. Leonard Y. Cooper

Technical Abstract:

Introduction. This work has been involved with two experimental studies related to the modeling of enclosure fires. Though most of the effort has been directed at the study initiated in October 1993 on the movement of smoke and hot gases in open vertical shafts, work has also been carried out to complete the earlier project on flow through horizontal vents. The experimental findings of the research have applications to the modeling of fires in enclosed spaces with vents, such as ships and multi-room compartments, and in multi-leveled buildings with vertical shafts.

Movement of Smoke and Hot Gases in Vertical Shafts. The experimental arrangement is shown in Fig. 1. Smoke or hot gases are injected into the shaft at the lower opening and the downstream flow is monitored by means of thermocouples, visualization and optical sensors. The inlet temperature of the hot gases can be varied up to around 80 °C. Both natural and forced ventilation can be investigated in the shaft. The opening height can be varied up to around 0.2 m. The shaft is about 2.0 m in height and has an aspect ratio of about 3.0. However, the aspect ratio can be varied to consider its effect on the transport processes. The conditions at the outlet are also monitored to determine the effects of entrainment and heat transfer to the walls. Wide ranges of all the physical variables in the problem are obtainable, allowing the simulation of typical flows in multi-leveled buildings with vertical open shafts.

A few characteristic results for flow without ventilation are shown in Figs. 2 and 3. The time taken for the hot gases injected at the lower opening to reach the top opening as a function of the inlet temperature difference, over the ambient temperature, and of the mass flow rate indicate expected trends. With increasing temperature at the inlet, the buoyancy effect is larger resulting in higher velocities and shorter time to reach the top. This time is an important quantity since it indicates the speed with which the smoke and other combustion products reach into the higher levels of the building. The effect of the mass flow rate is smaller, with a larger flow rate resulting in smaller time. The temperature at the outlet depends on heat transfer to the walls as well as on the flow velocity.

2. Y. Jaluria and K. Kapoor, "Wall and Corner Flows Driven by a Ceiling Jet in an Enclosure Fire," *Combust. Sci. Tech.*, 86, 311-326, 1992.
3. Q. Tan and Y. Jaluria, "Flow Through a Horizontal Vent in an Enclosure Fire," in *Heat Transfer in Fire and Combustion Systems*, ASME Heat Transfer Div., 199, 115-122, 1992.
4. Y. Jaluria, S.H.-K. Lee, G.P. Mercier and Q. Tan, "Visualization of Transport Across a Horizontal Vent due to Density and Pressure Differences," *Nat. Heat Transfer Conf.*, Atlanta, GA, 1993.
5. S.H.-K. Lee, W.K.-S. Chiu and Y. Jaluria, "Experimental Study of Enclosure Fires with Horizontal Vents," Fall Tech. Meet. Eastern Sect. Combust. Inst., Princeton, NJ, 1993.
6. Q. Tan and Y. Jaluria, "Flow Through Horizontal Vents as Related to Compartment Fire Environments," Tech. Rep. NIST-GCR-92-607, Nat. Inst. Sids. Tech., Gaithersburg, MD, 1992.

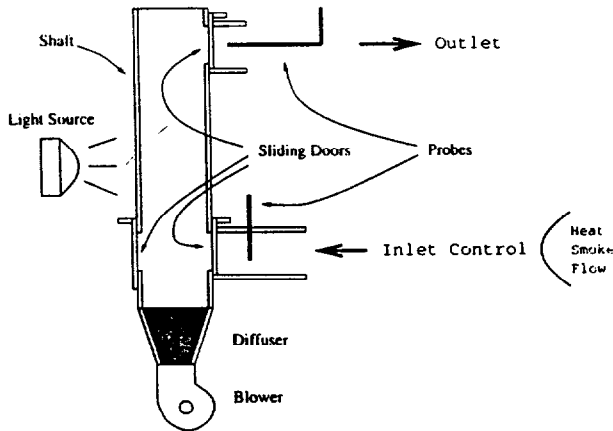


Fig. 1. Experimental arrangement for the vertical shaft study.

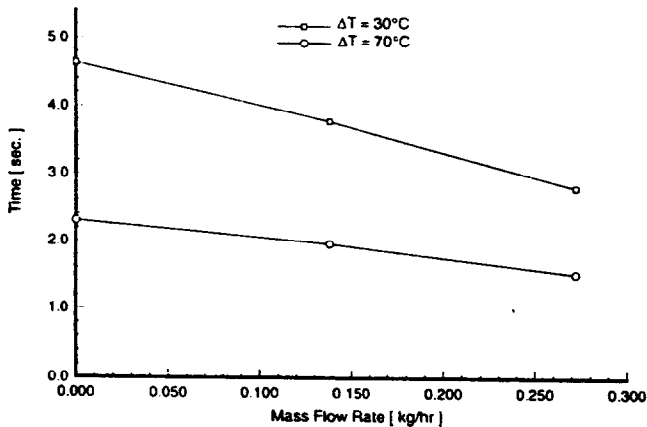


Fig. 3. Effect of injected mass flow rate on time taken by injected gases to reach the top opening.


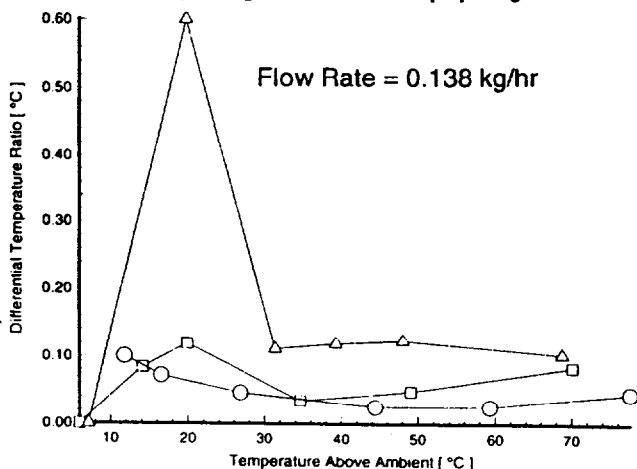


Fig. 4. Effect of inlet temperature difference, over the ambient temperature, on the ratio of the outlet temperature difference to the inlet temperature difference.

For Flow Rate = 0.138 kg/hr.

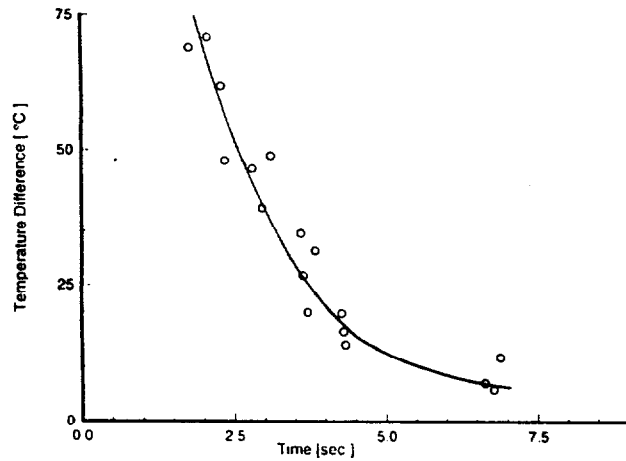

For Flow Rate = 0.272 kg/hr

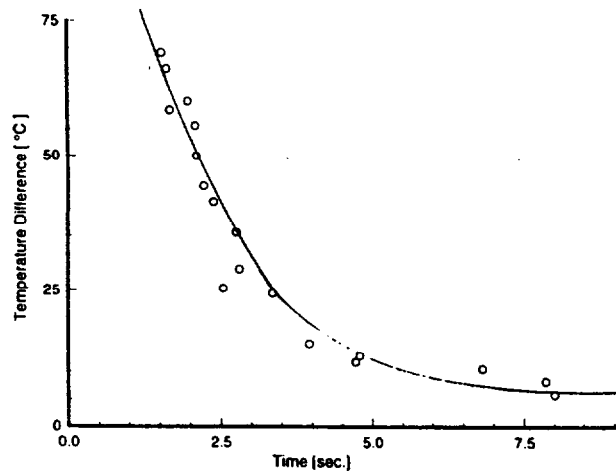


Fig. 2. Effect of inlet temperature difference, over the ambient temperature, on the time taken by hot gases injected at the lower opening to reach the top opening.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT -- FY93

RISK ANALYSIS FOR THE FIRE SAFETY OF AIRLINE PASSENGERS

Funding Agency: Federal Aviation Administration

Professional Staff: Dr. Richard L. Smith

Project Objective: The objective of this project is to develop the generic methodology and an intelligent computer program that will compute the fire risk for passengers of airlines. The program will determine the risk assuming the implementation of various fire safety regulations. The emphasis is on assisting the decision-maker gain greater understanding of the decision to be made rather than furnishing a "correct" conclusion.

Technical Accomplishments:

One approach to evaluating the merit of a fire safety system is to do a cost benefit analysis based on an analysis of past accidents using classical statistical techniques. We note that injuries or deaths due to airplane fires are rare events. Also, each crash is studied so that changes can be made in procedures or equipment to reduce the likelihood of a similar accident occurring. Therefore, the evidence available is inappropriate for the applications of classical statistical techniques in the fire risk analysis for the fire safety of airline passengers.

We will develop three progressively refined risk models: pilot, prototype, and production. For each of these we will first do the basic development which includes determining the alternatives, collecting the available information, and determining the decision maker's preferences. The second major step consists of developing the deterministic structures of the model. This is followed by the probabilistic evaluation which includes the use of probability distributions instead of unique values. Then the basic appraisal is done which includes sensitivity analysis, value of information analysis, value of control analysis, and a review of the decision maker's preferences. At this point the model is either complete or we start over and iterate the process until the decision maker is satisfied.

The selected approach utilizes influence diagrams rather than decision trees. Besides providing a clear and simpler representation of the problem, influence diagrams grow linearly with the size of the problem while decision trees grow exponentially. Some principal components of influence diagrams are: 1. Decision variables which are quantities over which the decision maker exercises direct control; 2. Value parameters which represent aspects of the preferences of the decision maker; and 3. Chance variables which are quantities which represent properties of states of the world.

For the development of the pilot version of the risk model we are using a beta version of a commercial software program. A pilot model is an extremely simplified representation of the problem. Its main use is for determining the most important relationships. For this version the only decision is whether or not to add a water mist system to the airplane and the only preference variable is the number of deaths. The model determines the expected number of deaths with and without the water mist system. The model uses a subset of FAA's incapacitation model which addresses the effects of temperature, carbon monoxide, carbon dioxide, oxygen depletion, and hydrogen cyanide.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT - FY93

STUDY OF SMOKE AGGLOMERATES

Funding Agency: National Aeronautics and Space Administration

Professional Staff: George Mulholland, Project Leader  
Raymond Mountain, NIST Fellow  
Nelson Bryner, Chemical Engineer  
William Pitts, Research Chemist  
Eric Steel, Supervisory Microscopist  
Dave Bright, Analytical Chemist

Project Objective:

To provide NASA with measures of the validity and utility of fractal concepts in describing the growth and properties of large smoke agglomerates and design guidelines for a Large Agglomerate Optics Facility by January, 1995.

Technical Accomplishments:

The Large Agglomerate Optics Facility (LOAF) has been fabricated. It will be used to measure the radius of gyration and fractal dimension of smoke as it agglomerates in a smoke aging cell over about a one hour period. The effect of aging on the extinction, total scattering, and differential scattering cross-section will be measured with the LOAF.

The key components of the facility are a constant output smoke agglomerate generator, a smoke aging cell, rotary table and associated source and detector for differential scattering measurements, and light source and detectors for performing both light extinction and total scattering measurements. The salient features of the facility include the following:

- Tapered inlet and outlet in smoke aging cell to insure uniform filling
- Will allow first accurate total scattering measurements for large agglomerates (up to  $3 \times 10^3$  primary spheres) by use of sensor with cosine response from 0 to  $89^\circ$ .
- Measurement of radius of gyration for agglomerates up to  $1 \mu\text{m}$  by small angle scattering down to  $3^\circ$  with  $\pm 0.4^\circ$  detector acceptance angle
- Computer controlled differential scattering measurement enabling measurement of scattering intensity at 12 angles in 60 seconds

Publications:

G.W. Mulholland, C.F. Bohren, and K.A. Fuller, submitted to *Langmuir*(1993), Light Scattering by Agglomerates: Coupled Electric and Magnetic Dipole Method.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT - 1993

SUPPORT OF THE NAVY FIRE MODELING PROGRAM

Funding Agency: Naval Research Laboratory

Professional Staff: Walter W. Jones, Project Leader  
Paul A. Reneke

Project Objective:

Develop specific algorithms to incorporate phenomena into the BFRL fire models which address problems unique to Navy ships.

Technical Accomplishments:

The zone model CFAST has been developed to predict fire growth and smoke spread in any compartmented structure. Several phenomena of particular interest to the US Navy have been incorporated. These include mechanical ventilation and vertical flow through hatches and other openings in decks.

An algorithm for flame spread has been incorporated this year and will be tested against experimental data during the next fiscal year. In addition, CFAST was restructured this year to increase its speed for real time applications of damage assessment, and to allow more easily other Navy Commands to incorporate their own changes and additions.

Reports and Publications:

"Improvement in Predicting Smoke Movement in Compartmented Structures," Jones, W. W., and Fomey, G. P., Fire Safety Journal, in press.

"Modeling Smoke Movement through Compartmented Structures," Jones, W. W., Fire Sciences 11, 172 (1993).

"Comparison of Full Scale Fire Tests and a Computer Fire Model of Several Smoke Ejection Experiments," with Emil Braun, Darren L. Lowe, Patricia Tatem, Richard Carey and Jean Bailey, NISTIR 4961 (1992).

## **A5. Fire Hazard Assessment**



BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT - FY93

Institution: Clemson University

Grant No: 60NANB2D1281

Grant Title: Computational Heat Transfer for Zone Fire Modeling

Principal Investigator: Professor William F. Moss  
Department of Mathematical Sciences  
Clemson University  
Clemson, SC 29631  
(803) 656-5225

Other Professional Personnel: Mr. Jian Wang, Research Assistant

NIST Scientific Officer: Dr. Glenn P. Fomey

Technical Abstract:

## 1 Introduction

Heat conduction through the ceilings, walls, and floors of the rooms in a zone fire model can be modeled by an initial-boundary value problem for the 1-D or 2-D heat equation. Using the method of lines (MOL), this problem can be reduced to a differential-algebraic equation (DAE) system. This DAE system, together with the ordinary differential equations for pressure, layer height, and upper and lower layer masses in a room, make up the full model which is a large DAE system. The bulk of the solution variables and the CPU time is attributable to the heat conduction submodel.

A domain decomposition method has been developed for splitting this large DAE system into a main system and a secondary one. The main system is solved for pressure, layer height, upper layer mass, lower layer mass, and the temperatures at ceiling, wall, and floor surfaces. The secondary system is used to model heat conduction. The main and secondary systems are coupled through heat flux boundary conditions at ceiling, wall, and floor surfaces (heat flux in equals heat flux out). Time discretization for the secondary system is done using the backward Euler method. The time stepsize used for the secondary system is the stepsize chosen by DASSL, the DAE solver used for the main DAE system. This method has proved to be both efficient and accurate.

This grant is the third in a series that have investigated various numerical aspects of NIST zone fire models. In the current grant the emphasis is on computational heat transfer. A number of experimental computer codes have been produced or are currently being produced for this grant. These codes are designated by names of the form CONRADx where x is a number. This summary is divided into sections by code name. The codes CONRAD1 and CONRAD2 were produced for the second grant. The codes beginning with CONRAD2.2 were produced for this grant. Our zone models incorporate heat transfer by radiation and

coefficient. The approach works well for 1, 2, and 4 room test cases. We obtain CONRAD2.2 accuracy but with reduced CPU times.

The CONRAD2.3 approach has the disadvantage that the Jacobian matrix of the secondary DAE system now depends on node exterior surface temperature, time stepsize, and material, while for CONRAD2.2 the Jacobian only depends on time stepsize and material. In CONRAD2.2, once the time stepsize has been chosen by DASSL, the Jacobians for each material are factored. Then temperature profiles are updated on a node by node basis using forward and backward solves. In a simulation with 3 materials and 4 rooms, CONRAD2.2 would do 3 factorizations per time step and 16 forward and backward solves. On the other hand, it would appear that CONRAD2.3 would be forced to do 16 factorizations because the Jacobian is node dependent. There is a way around this difficulty as long as we are doing 1-D heat conduction. We can do a nearly complete factorization on a material by material basis and then complete the factorization just before doing the forward and backward solves. The structural feature of the Jacobian on which this trick depends does not exist in the 2-D case so CONRAD2.3 does not generalize to the 2-D case.

We have found another way to handle the radiation law that does not have the above cited difficulty. In CONRAD2.35 we treat the radiation term as a nonhomogeneous term in the boundary condition equation and we evaluate this term using linear polynomial prediction; that is, to evaluate the radiation term at time  $t + k$ , we predict the node exterior surface temperature at time  $t + k$  using two previously obtained values. CONRAD2.35 and CONRAD2.3 have nearly identical performance for 1, 2, and 4 room test cases. Linear polynomial prediction has the disadvantage of requiring more storage but the advantage of producing Jacobians that are not node dependent. We feel that this characteristic will be important for 2-D codes.

## 4 CONRAD2.42

A theoretical discussion of the method of decomposing the DAE system of CONRAD1 into main and secondary systems is discussed in [2]. The goal of this decomposition is to reduce execution times. We have experimented with a more advanced approach for solving the secondary DAE system of CONRAD2.2, again for the purpose of reducing execution times.

In CONRAD2.2, solution of the discretized secondary DAE system involves solving a linear system in two stages. First, factorization is done for each node material used. Second, forward and backward solves are done for each node in each room. The system is linear because the heat equation and boundary conditions are linear. The nonlinear heat flux boundary conditions are part of the main DAE system, not the secondary one. We can view this solution as the first iterate of Newton's method, and the matrix that is factored is the Jacobian. There is a case in which more than one iterate might be necessary. It is not necessary to factor the Jacobian at each time step as long as the time stepsize does not change too much. If the factorization is not updated, iteration is required. This approach generally goes by the name of the frozen Jacobian strategy. The matrices in CONRAD2.2 are so small that the cost of factoring is not dominant. However, with 2-D heat conduction, the matrices that must be factored will be much larger, so it is anticipated that avoiding factoring in favor of more solves will pay off in this case. CONRAD2.42 is a variant of CONRAD2.2 which implements the frozen Jacobian strategy. We use the same techniques as in DASSL for deciding when to factor and when not to factor. We have set up a stopping criterion for the iteration based on our problem; that is we have not used the generic criterion in DASSL. Typically only one iteration is required, and we obtain solutions with the high accuracy of CONRAD2.2 but with a significant decrease in CPU times (see [3]).

## 5 CONRAD5

In CONRAD5 we implemented a crude moving mesh strategy for breakpoints to see if improvements in accuracy or speed could be obtained. Currently, the breakpoint distribution for the heat conduction nodes is

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
PRIORITY PROJECT - FY 93

DEVELOPMENT OF THE FDMS DATABASE SYSTEM FOR FIRE RELATED DATA

Professional Personnel

Rebecca W. Portier, Project Leader  
Dr. Vytenis Babrauskas, Fire Prevention Engineer

Objective

Develop a centralized database of test values generated from a variety of sources within the fire community accessible through communications networks. Provide a platform-independent user interface to the database to support importing new data, editing existing data, querying and selecting specific test values, and interfacing to existing fire models.

Scope

A unified method of accessing data is crucial to both experimental and modeling efforts in the development of the science of fire. FDMS, the Fire Data Management System, is a computer database for organizing and presenting fire data obtained from bench-scale and real-scale tests as well as fire simulation programs. By storing available fire test values in a common format, this data is readily available to computer models, plotting programs, and report generators.

Technical Accomplishments

A beta version of the FDMS software currently exists which supports Cone Calorimeter and Furniture Calorimeter test results. The beta version FDMS provides for the selection and display of specific test results using several custom report formats. One of these custom reports is a statistical verification report which produces tabular output as specified by the ISO 5725 standard. The ISO5725 report generator was expanded this year to provide for the calculation of the repeatability and reproducibility values. A detailed evaluation of the FDMS beta version file formats was conducted and documented in order to make the current product compatible with other programs under development. This evaluation was then extended to determine any additional data required by existing fire models which was not supported by the beta version FDMS software. The results of the evaluation were detailed in a technical report which provides complete details for implementation of the second generation FDMS database. A new database engine and user interface library were selected which provide the platform independence desired for the FDMS database. Import routines were written to verify that all data existing in the beta version FDMS database can be successfully transferred to the new FDMS database engine.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT – FY 93

EVALUATION OF FIRE SAFETY REQUIREMENTS FOR POTENTIAL APPLICATION  
TO U.S. PASSENGER GUIDED GROUND TRANSPORTATION SYSTEMS

Funding Agency

U. S. Department of Transportation, Volpe National Transportation Systems Center and Federal Railroad Administration

Professional Personnel

Richard D. Peacock, Project Leader  
Richard W. Bukowski, Group Leader, Fire Protection Applications  
Walter W. Jones, Group Leader, Fire Modeling  
Paul A. Reneke, Computer Scientist

Objective

To perform an independent review and detailed comparison to evaluate the compatibility of U.S. and European approaches to fire protection in guided transportation systems and provide the FRA with additional information to continue improvement of fire safety standards for guided transportation systems.

Technical Accomplishments

Recent advances in guided ground transportation, fire test methods, and hazard analysis necessitate re-examination of current requirements for fire safety. Several studies have suggested nearly random ability of current tests to predict actual fire behavior. A comparison of the approaches used in the United States, Germany, and France has been prepared. With the strengths and weaknesses of current methods for measuring the fire performance of materials used in rail transit systems reviewed, a direction is suggested in which most fire science-oriented organizations in the world are clearly headed – fire hazard and fire risk assessment methods supported by *measurement* methods based on heat release rate. This approach holds promise to simplify testing requirements for manufactures while providing better indicators of fire hazard of materials used in vehicle construction.

Reports and Publications

"Fire Performance of Passenger Guided Ground Transportation, A Review of the Existing Methods and of New Concepts." Peacock, R. D., Bukowski, R. W., Jones, W. W., Reneke, P. A., and Babrauskas, V., NIST Technical Note, to be published.

"New Concepts for Fire Protection of Passenger Rail Transportation Vehicles." Bukowski, R. W., Jones, W. W., Peacock, R. D., and Reneke, P. A., to be presented at Fire and Materials Conference.

"New Concepts for Fire Protection of Passenger Rail Transportation Vehicles." Peacock, R. D. to be published.

**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT - FY93**

**Institution:** National Fire Protection Association

**Grant No.:** 60NANB2D1286

**Grant Title:** EXIT89

**Principal Investigator:** Rita F. Fahy  
Fire Analysis and Research Division  
1 Batterymarch Park  
Quincy, Massachusetts 02269-9101

**NIST Scientific Officer:** Dr. Walter Jones

**Technical Abstract:**

EXIT89 is an evacuation model designed to simulate the evacuation of a large population of individuals from a high-rise building or other complex space. It has the ability to track the location of individuals as they move through the building so that the output from this model can be used as input to a toxicity model that will accumulate occupant exposures to combustion products. EXIT89 uses occupant densities in building spaces to compute each occupant's walking speed. In this way, queueing effects are modeled. Ongoing development work on the model has been funded by this NIST grant.

EXIT89 was developed to meet the need for an evacuation model that could track large populations of individuals in high-rise buildings. The need for a model that can handle behavioral aspects of the evacuation of a high-rise building became obvious during some other project work being done at NFPA using Hazard I, a general fire hazard analysis model whose evacuation module has only behavioral features. Hazard I calculates toxic doses and other fire exposure by occupant, so it needs to track individuals along their routes out of the building. EXIT89 was specifically designed to track individuals and address all key evacuation phenomena in high-rise buildings with large occupant populations.

**Overview of EXIT89**

EXIT89 requires as input a network description of the building, geometric data for each room and for openings between rooms, and smoke data if the effect of smoke blockages is to be considered. The user now has the option of having the model calculate shortest routes to a location of safety, or setting the path occupants will take from each location in the building. The model moves people along the calculated or specified routes until a location is blocked by smoke. Affected exit routes are recalculated and people movement continues until the next blockage occurs or until everyone who can escape has reached the outside. Evacuation can begin for all occupants at time 0 or can be delayed to reflect externally calculated delays in alerting or responding. Smoke data can be used to predict when the activation of a smoke detector would occur and evacuation will begin then or after some user-defined delay beyond that time.

The model calculates walking speeds based on occupant densities. When escape routes are blocked by smoke, only the routes on the affected floor need to be recalculated. When the smoke blockage occurs in a stairwell, only the floors immediately above and below the blockage will be recalculated.

The model uses Predtechenskii and Milinskii's work that involved the calculation of average body sizes for Russian subjects in different types of dress. Subsequent work by Ezel Kendik using Austrian subjects found significant differences in the results. The Austrian data and available American data have been added to the model.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
PRIORITY PROJECT – FY 93

HAZARD DEVELOPMENT

Professional Personnel

Richard D. Peacock, Project Leader  
Walter W. Jones, Group Leader, Fire Modeling  
Glenn P. Forney, Computer Scientist  
Rebecca W. Portier, Mathematician  
Paul A. Reneke, Computer Scientist

Objective

To produce a fundamental capability to analyze the hazards associated with a specified fire scenario.

Scope

Each year, billions of dollars are spent to protect occupants and equipment against fire and fire related damage and loss. Yet in spite of the increased spending many people continue to die annually and there is still a large dollar loss. To ease these problems, a systematic approach to understanding the effect of fires in buildings is necessary. The fundamental capability has been provided as a fully-supported software package for personal computers. While initially limited to residential-style occupancies, the software design is aimed at a broad range of applications from fire safety education to fire reconstruction.

Technical Accomplishments

BFRL developed the software HAZARD I, which predicts the hazard to a building and to occupants anywhere within the building. The fire hazard assessment methodology embodied in the HAZARD I software provides a vehicle which state-of-the-art fire science can be applied to improve fire safety. Continued enhancement of its capabilities and validity is a primary aspect to the mission of BFRL's fire program. Version 1.0 was released in summer of 1989. Version 1.1 was released in the fall of 1991. This latter version includes new phenomenon and features to continue providing a state-of-the-art tool for hazard analysis for use by fire protection professionals. We have also improved the documentation by providing a step-by-step learning guide and integrating the example cases in the technical reference.

The research this year includes a most important missing piece in most fire models: "prediction of the growth of the fire." Single-surface pyrolysis, and fire suppression algorithms are being incorporated in the fire model. We continued the unification of the user interface with a new-generation input editor and hazard shell. The internal structure of the core model of HAZARD, CFAST, has been addressed by redefining the internal data structures to be consistent with the streamlining of the solver routines completed last year. The benefits of this year's research are twofold: The pyrolysis and fire suppression algorithms will allow the user to study fire scenarios without costly full-scale testing to develop input data for the model. Improving the internal structure will allow easier inclusion of algorithms in the future and allow more researchers, both within NIST and elsewhere to contribute to the development of the model.

**Internal model improvements:** The zone fire modeling equations in CFAST are expressed as a simultaneous system of algebraic and differential equations of the form

$$F \left( t, y(t), \frac{dy}{dt} \right) = 0$$

where  $t$  represents time and  $y(t)$ ,  $dy(t)/dt$  are vector valued functions with vector lengths  $N$  where  $N$  is the number of zone modeling equations. The components of  $y$  for CFAST are compartment pressures  $P$ , mechanical ventilation pressures and temperatures  $P_{MV}$ ,  $T_{MV}$ , upper layer volumes  $V_U$ , upper/lower layer temperatures  $T_U$ ,  $T_L$  and wall temperatures  $T_w$ . The vector  $y$  then is given by  $y = (P, P_{MV}, T_{MV}, T_U, V_U, T_L, T_w)^N$ . The differential equation solver in CFAST (DASSL) solves equation (1) by first constructing backward difference formulas for  $dy/dt$  and solving the resulting nonlinear finite difference equation using a variant of Newton's method. Newton-like methods require a derivative or in the multidimensional case a Jacobian of  $F$ . If the matrix  $A$  denotes the Jacobian of  $F$ , then the construction of  $A$  and the solution of linear systems of the form  $Ax=b$  are the dominant costs for solving the zone fire modeling equations in CFAST. In the improved model, the sparsity of  $A$  is exploited to reduce the memory requirements. Semi-analytic formulas are derived for the columns of  $A$  that correspond to partial derivatives with respect to wall temperatures to reduce computational costs. This approach has several advantages:

**Numerical Speedup:** Part of the Jacobian related to wall temperatures is computed more efficiently with a resulting speedup for some cases of 50 per cent. Normally, the routine RESID is called once for each solution variable to compute a finite difference approximation to the Jacobian. The speedup is possible because of the observation that Jacobian columns corresponding to partials with respect to wall temperatures can be computed by calling only a small fraction of the routines within RESID.

**Memory Reduction:** Part of the Jacobian related to wall temperature equations are stored more compactly. If  $NR$  is the number of rooms, then DASSL can solve up to  $NEQ=11NR + 6$  equations (assuming  $4NR$  gas layer equations,  $3NR + 6$  HVAC equations and  $4NR$  wall temperature equations. The size of the Jacobian work array is then  $NEQ^2$ . The reduced Jacobian option decreases this number to  $(NEQ-4NR)^2$  since the Jacobian elements corresponding to the  $4NR$  wall temperature equations are stored compactly. The work array space requirements is then approximately  $(7/11)^2 \approx .4$  of the old.

### Reports and Publications

"Verification of a Model of Fire and Smoke Transport." Peacock, R. D., Jones, W. W., and Bukowski, R. W., Fire Safety Journal 21 89-129, 1993.

"Calculating Flame Spread on Horizontal and Vertical Surfaces." Ahmed, G. N., Dietenberger, M. A., and Jones, W. W., NIST Internal Report, to be published.

"CFAST, the Consolidated Model of Fire and Smoke Transport." Peacock, R. D., Jones, W. W., Forney, G. P., Reneke, P. A., and Portier, R. W., NIST Technical Note 1299, 1992.

"A User's Guide for CFAST Version 1.6." Portier, R. W., Reneke, P. A., Jones, W. W., and Peacock, R. D., NISTIR 4985, 1992.

**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT - FY92**

**Institution:** Clemson University

**Grant No.:** 60NANB0D1023

**Grant Title:** Mathematical Modeling of Human Egress from Fires in Residential Buildings

**Principal Investigator:** Michael M. Kostreva, Professor  
Department of Mathematical Sciences  
Clemson University  
Clemson, SC 29634-1907  
Telephone: (803) 656-2616

**Other Professional Personnel:** Teodros Getachew, Doctoral Student

**NIST Scientific Officer:** Richard Peacock

**Technical Abstract:** In its first three years, this research project has produced some significant findings and discovered that there are some areas of research left to investigate. Mathematical modeling of egress of individual occupants from residential buildings remains the focus. The basic mathematical framework for all the fire egress models is a network superimposed on a geometric model of a residential building. Nodes in the network represent locations within and around the building, while links comprise potential egress routes. Each link carries several cost functions, possibly dependent on time, to be minimized by occupants in egress. Assignments of nodes, links and costs are made to closely reflect an actual scenario. Each occupant in the building is initially located at a unique node of the network, an origin node. The problem is to find, for each occupant, all nondominated paths (those minimizing all costs) leading from his/her origin node to a single destination node, representing safety outside the building.

In our research, we have derived several approaches which can solve the path planning problem in networks with multiple time varying objective functions. Applying dynamic programming to fire egress modeling allows for generalization of the network assumptions made in the current version of HAZARD I and development of a unified framework for handling a new more complex model based on a multiple objective dynamic network in which links and nodes may be removed, and in which link weights are multi-



Reports and Papers:

Kostreva, M. M., and Wiecek, M. M., Time Dependency in Multiple Objective Dynamic Programming, Journal of Mathematical Analysis and Applications 173, 289-307, 1993.

Kostreva, M. M., and Wiecek, M. M., Multicriteria Decision Making in Fire Egress Analysis, Preprints of IFAC/IFORS Workshop on Support Systems for Decision and Negotiation Processes, Warsaw, Poland, June 1992, pp. 285-290. (a)

Kostreva, M. M., and Wiecek, M. M., Approximation in Time Dependent Multiple Objective Path Planning, Proceedings of IEEE International Conference on Systems, Man and Cybernetics, Chicago, 1992, pp. 861-866. (b)

Getachew, T., and Kostreva, M. M., Transient Behavior in Multiple Criteria Path Planning Problems, Proceedings of IEEE International Conference on Systems, Man and Cybernetics, Chicago, 1992, pp. 867-873 .

**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
STRS PROJECT - FY93**

**MERGER OF FPEtool AND HAZARD**

Professional Personnel

Richard W. Bukowski, Project Leader  
Scot Deal  
Charles Arnold

Project Objective

Utilize FPEtool as a front end to HAZARD I for making initial estimates with shared data inputs.

Scope

The target is hazard predictors (FPEs, product manufacturers, regulators, product specifiers). Users of both products have asked for it as a tool with much broader utility. And it will be more efficient for us to support and further develop a single product.

Technical Accomplishments

In this effort, a new version of FPEtool was produced which incorporates new capabilities, including corridor flows, flows into areas of refuge, and suppression. The documentation for the code was brought up to date, and the package was prepared for distribution through the HAZARD I distributors to relieve the need for staff to duplicate and distribute it.

As part of the preparation to release HAZARD I v1.2 next year, FPEtool is being incorporated into the user interface. Specifically, the FIREFORM routines are being integrated as a "pop-up" calculator in CEDIT to facilitate off line calculations needed to make decisions about inputs to CFAST. This should provide enhanced user capabilities while demonstrating the utility of both products.

## **A6. Large Fires**

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT - FY93

**Institution:** Massachusetts Institute of Technology

**Grant No:** 60NANBOD1036

**Grant Title:** Computer Simulation of the Environmental Impact of Large Fires: Plume Rise and Dispersion

**Principal Investigator:** Professor Ahmed F. Ghoniem  
Department of Mechanical Engineering  
Massachusetts Institute of Technology  
Cambridge, MA 02139

**Other Personnel:** Xiaoming Zhang, Graduate Research Assistant

**NIST Scientific Officer:** Dr. Howard Baum

**Technical Abstract:**

The rise, dispersion, physical and chemical transformations, and deposition of plumes generated from large fires are responsible for distributing hazardous material, including soot, unburnt hydrocarbon and nitric oxides, in the atmosphere and on the ground [1]. The objectives of this work is to develop an efficient and accurate computational tool for predicting plume trajectory, dispersion pattern, and ground deposition as a function of the fire conditions, wind, atmospheric conditions, and ground terrain, and to extend this tool so as to accommodate the complex physics controlling the fire dynamics. In the first phase of this work, we formulated a moving plane model to describe the dynamics of the plume in the cross sections normal to the wind direction. Using the assumption that the horizontal velocity component is that of the wind and that gravity is the dominant force in the cross wind direction, the formulation is reduced to that of an unsteady, two-dimensional, buoyancy driven flow. Numerical solutions are obtained using the Lagrangian transport element method, which is formulated as an extension of the vortex method to include the dynamic effects of density variation. Results, in terms of the plume trajectory and dispersion rates and patterns, are compared with experimental measurements.

During the past year, we focused on: (1) validating the model, especially the dispersion pattern, against laboratory and field observations; (2) investigating plume rise and dispersion in a linearly stratified atmosphere; (3) performing parametric studies on plume penetration through a low-level atmospheric inversion layer; (4) extending the computational capability to allow the model to incorporate complex phenomena, such as soot formation and dispersion, radiative heat transfer, and combustion, which occur closer to fuel burning zone. The latter was done in anticipation of having to extend the computation to the fire zone, i.e., couple the plume dynamics computation with a calculation of the fire evolutions. In the following, we present some results from the first three projects.

The evolution of the plume cross section, in terms of the density contours in the plume cross sections downwind the source, in a neutrally stratified atmosphere is compared with a water plume experiment in Fig. 1. The numerical [2] and laboratory results [3], almost identical, exhibit the generation and evolution of a kidney-shaped pattern which, as shown by our investigations, is associated with two buoyancy-generated large scale wind-wise vortices that govern the rise and dispersion of the plume and the entrainment into its cross section. Although in the experiment, the initial vertical momentum of the plume was finite, the eventual fate of the plume cross section, which is determined by the vorticity that has accumulated there due to the initial shear augmented by the buoyancy generated vorticity, is the same. Since the plume dynamics are fundamentally represented in the model,

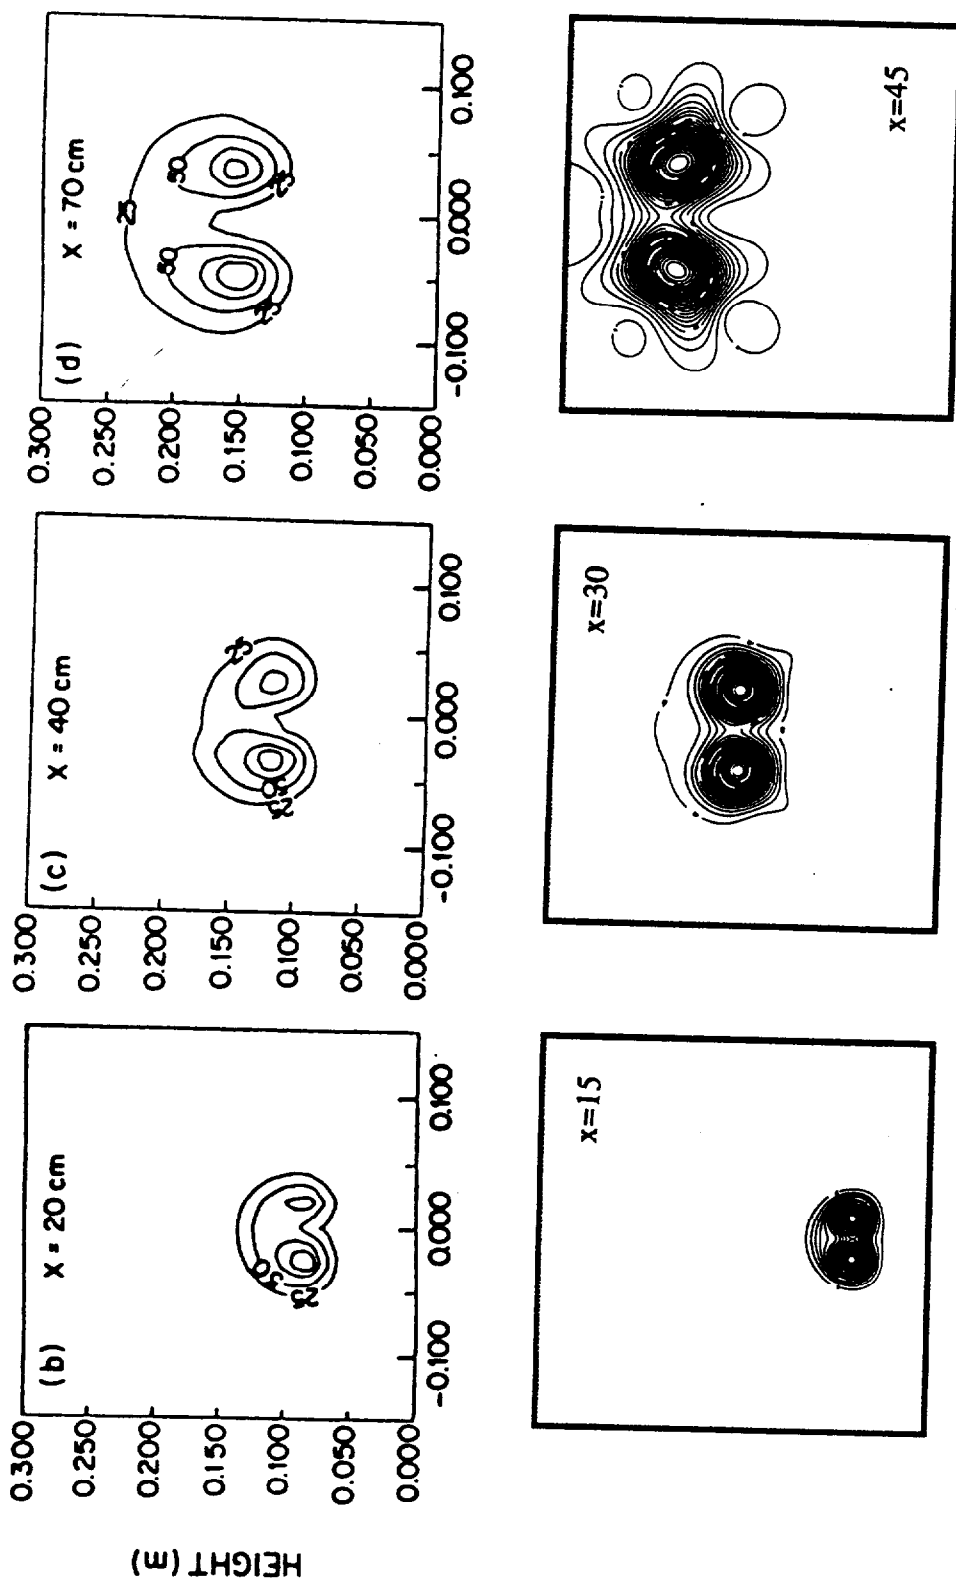


Figure 1. A comparison between laboratory measurements (top) of Alton et al., and our numerical simulation results (bottom) of the density contours in the plume cross sections.

**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT - FY93**

**IN-SITU BURNING OF OIL SPILLS**

Funding Agency: Minerals Management Service, DoI

Professional Staff: David D. Evans, Project Leader  
William D. Walton, Fire Protection Engineer  
Howard R. Baum, NIST Fellow  
Kevin McGrattan, Mathematician  
James R. Lawson, General Physical Scientist  
Daniel Madrzykowski, Mechanical Engineer  
Kurt Keydel, Mechanical Engineer

Project Objective:

To develop and implement the instrumentation and data use methodology for quantifying the combustion of crude oil on water during field experiments of current oil spill burning technology.

Technical Accomplishment:

Six mesoscale (231 m<sup>2</sup>) Louisiana crude oil pool fire experiments were conducted using the U.S. Coast Guard Fire and Safety Test Detachment facility in Mobile, Alabama. Results for burning rate and smoke yield were as expected from previous testing. The oil surface regression rate, a measure of burning rate, was found to be  $0.062 \pm 0.003$  mm/s. Smoke yield, the fraction of the fuel converted to particulate, was  $11 \pm 1$  percent. Laboratory experiments in which 1.2 m diameter pans of the Louisiana crude oil were burned at the Fire Research Institute in Japan showed that for this crude oil the smoke yield was the same as for the larger mesoscale fires, but the surface regression rate was reduced to a value of 0.046 mm/s. In cooperative research between NIST and the Massachusetts Institute of Technology (MIT), a method has been developed to simulate smoke dispersion and settling from crude oil pool fires burning in a uniform wind. Calculation of the smoke plume trajectory and smoke particulate deposition were performed using a Large Eddy Simulation (LES) model for the smoke plume trajectory and smoke particulate deposition. The speed and accuracy of the calculations have been improved so that calculations of smoke plume trajectory and airborne particulate concentrations over a 30 km distance from the source can be performed in a few hours using an IBM RISC 6000 computer.

Publications:

"In-Situ Burning of Oil Spills: Mesoscale Experiments and Analysis," W.D. Walton, D.D. Evans, K.B. McGrattan, H.R. Baum, W.H. Twilley, D. Madrzykowski, A.D. Putorti, R.G. Rehm, H. Koseki, E.J. Tennyson, Proceedings of the Sixteenth Arctic and Marine Oil Spill Program (AMOP) Technical Seminar, June 7-9, 1993, Calgary, Alberta, pp 679-734, (1993).

"Smoke Plumes from In Situ Burning of Oil Spills," D.D. Evans, W.D. Walton, H.R. Baum, R.G. Rehm, E.J. Tennyson, Proceedings of the Eighth Symposium on Coastal and Ocean Management, July 19-23, 1993, New Orleans, LA, pp 3409-3417, (1993).

Related Grants:

Numerical Modeling of Plume Dispersal and Smoke Deposition from Large Scale Fires, Ahmed F. Ghoniem, Massachusetts Institute of Technology.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT — FY93

Institution: The University of California at Berkeley

Grant No.: 60NANBID1168

Grant Title: Large Fire Analyses

Principal Investigator: Professor Patrick J. Pagni  
Mechanical Engineering Department  
5131 Etcheverry Hall  
University of California  
Berkeley, CA 94720

Other Professional Personnel: Dr. Charles M. Fleischmann  
Javier J. Trelles (Ph.D. Candidate)  
Alvin Lee

NIST Scientific Officer: Dr. Howard R. Baum

Technical Abstract:

Introduction. Two categories of large fires are being studied under this grant: the urban/wildland interface and backdrafts in large occupied structures. A devastating example of the former occurred near the U.C. Berkeley campus on 20 October 1991 and is the focus of our attention in this abstract. In addition we are numerically modeling transient fire plumes to provide a foundation for urban/wildland interface fire growth models. The second category, backdrafts, is primarily experimental. Unusually detailed data have been obtained from a fully-instrumented half-scale apparatus. This work is motivated by high loss of life hotel fires where backdrafts are thought to have played an important role.

Urban/Wildland Interface. During October 1991 two fires occurred in the same canyon in the hills southeast of the University of California at Berkeley campus. The 19 October fire burned  $2 \times 10^4 \text{ m}^2$  and was controlled with relative ease. The 20 October fire burned  $6 \times 10^6 \text{ m}^2$ , killed 25 people, and damaged 2334 structures. Why was the 20 October fire so terribly different from the 19 October fire? Post-fire investigations revealed that the 20 October fire propagated ~ 2 km downwind in 15 min., growing from  $5.5 \times 10^4 \text{ m}^2$  to  $1.5 \times 10^6 \text{ m}^2$  between 1115 and 1130 PDT as shown in Fig. 1. Once that accelerated fire growth occurred, the heroic performance of the local fire service was overwhelmed. The final fire outline, indicated by the 1800 contour, is also partially shown on Fig. 1. The purpose of our analysis was to explain the catastrophically swift fire spread between 1115 and 1130.

The direction of the hot, dry, fast ( $> 10 \text{ m/s}$ ) wind during this rapid spread, N  $35^\circ$  E, is right to left on the Fig. 1 diagonal arrow. The USGS survey topography along this line is shown to scale in Fig. 2. The horizontal location of the 19 October fire is the origin in Fig. 2. Atmospheric temperature profiles from the Oakland Airport suggest a strong inversion layer between 300 to 600 m at the time of rapid fire spread as shown in Fig. 2. The hot, flaming debris channeled downwind by the inversion layer found a rich fuel source in a 35 m high stand of *Eucalyptus globulus* at 600-700 m from the origin in Figs. 1 and 2. Local wind gusts and some NE fire-induced winds augmented the Fig. 2 velocities by as much as a factor of two. Further downwind spread of the 1115 to 1130 blow-out was impeded by some SW fire-induced winds which opposed the NE ambient winds. These detailed flow

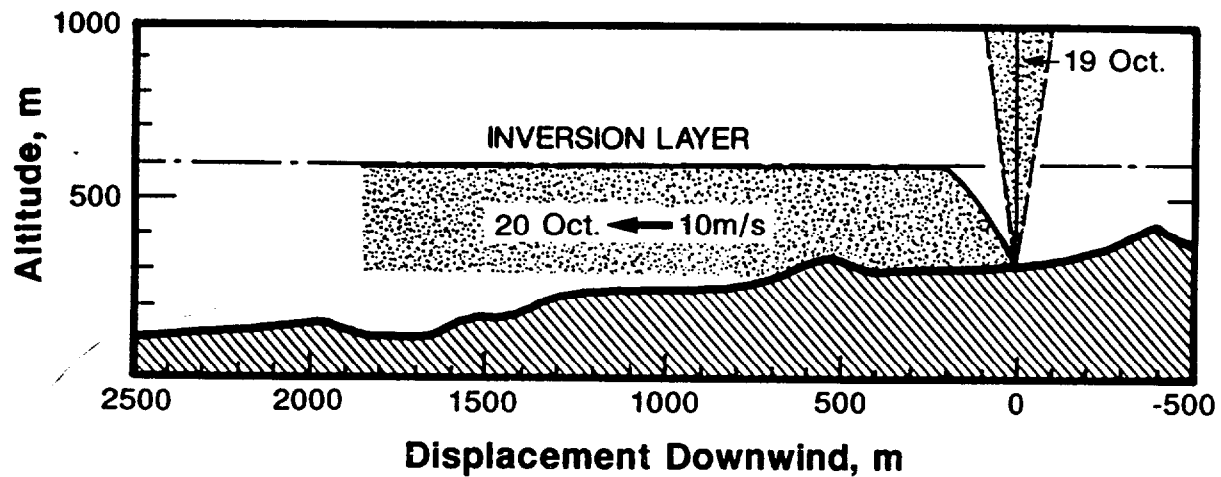


Fig. 2. This is an elevation looking NW perpendicular to the wind trajectory in Fig. 1a. The lower solid line is the hill topography. The upper dashed line is the top of the 20 October inversion layer. The speckled areas indicate the fire plumes on the 19th and 20th of October. Heavy vegetal and structural fuel load existed prior to the fire from 0 to 1200 m downwind of the fire origin.

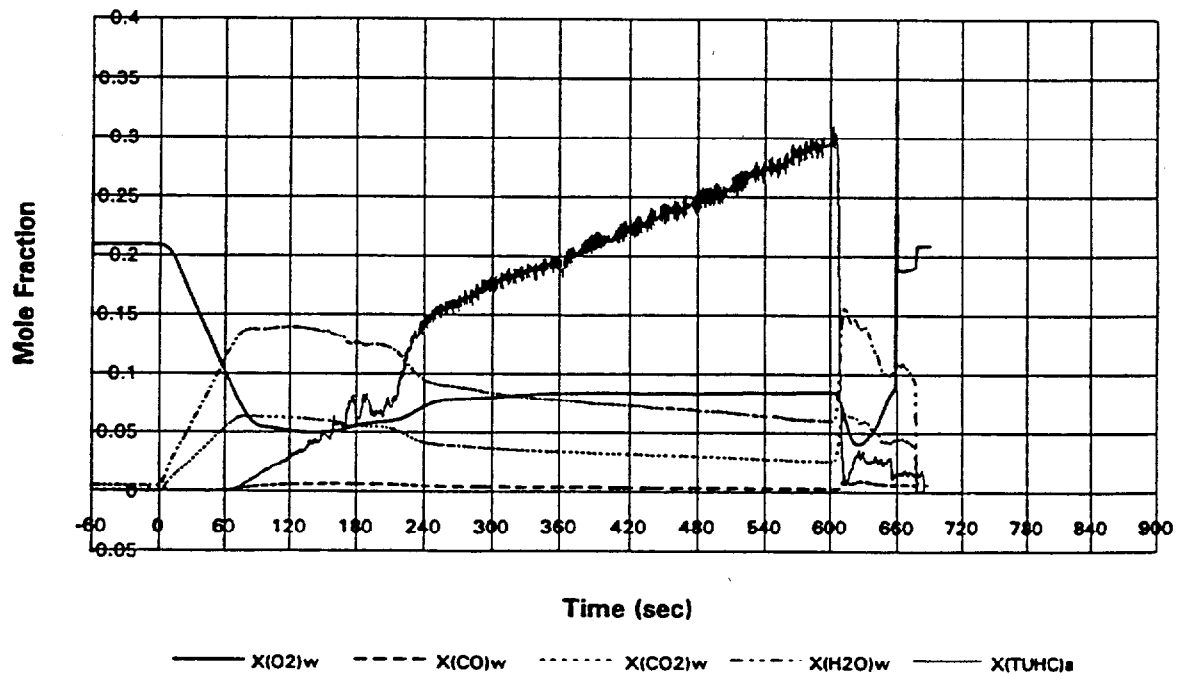


Figure 3. Typical measured upper layer gas species ( $O_2$ ,  $CO$ ,  $CO_2$ ,  $H_2O$ , and  $HC$ ) histories prior to the rich early ignition backdraft at 604 s.



BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
PRIORITY PROJECT - FY93

LARGE SCALE TEST FACILITY

Professional Personnel

Emil Braun, Physicist

Project Objective

To perform large scale fire tests and provide data to support other fire research projects. To apply, refine, and develop methods and equipment that contribute to the successful conduct of large scale fire tests. To develop plans for the expansion and modernization of the facility.

Scope

Improve the utilization of the current facility, upgrade existing hardware, develop calibration techniques for primary fire test equipment, and introduce new measurement techniques to measure critical fire parameters. Development of a laboratory for the calibration and repair of measurement tools such as heat flux meters, pressure transducers, gas analyzers, etc. Provide a testbed for the evaluation of new measurement equipment, such as the Open Path FTIR, and new developments in computer fire modeling, such as model verification tests for HAZARD, wind aided plume flow, etc. Investigate and measure new fire phenomena in a large scale environment.


Technical Accomplishments

Activities in FY 1993 consisted of:

- the redesign of the exhaust system of the furniture calorimeter and the initiation of an investigation into the alteration of the hood shape as it may affect the upper range of the calorimeter;
- the removal of the old floor/wall furnace to accommodate large scale plume experiments planned for FY 1994;
- the introduction of new data acquisition equipment;
- the development of a master plan for the expansion of the large scale fire test facility. The expanded facility, figures 1 and 2, will result in an expanded testing range for model verification and the investigation of large scale fire phenomena. The expanded facility is projected to consist of a high bay test facility approximately 22 m high and 60 m by 50 m construction area. The facility will include a new shops area as well as offices and small scale test laboratories. Currently planned for the new facility are a new fire wind tunnel and a multi-story corridor/stair tower facility.

Publications

Cooper, L.Y., Guidelines for the Design of a furniture calorimeter hood and exhaust, NISTIR, in review.

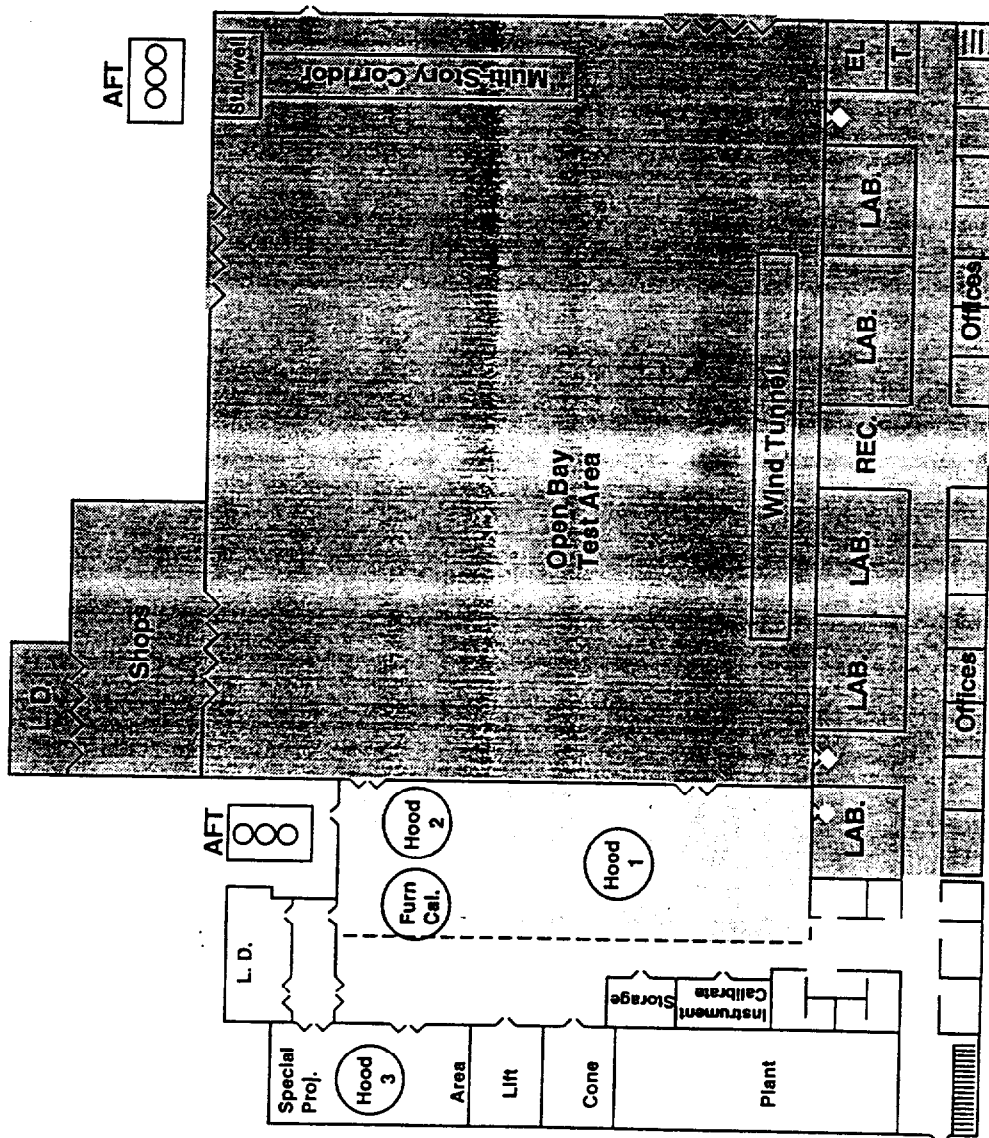

Floor Plan

**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT - FY93**

**OFFICE BUILDING FIRE RESEARCH PROGRAM**

Funding Agency: U.S. General Services Administration

Professional Staff: Daniel Madrzykowski, Project Leader  
Robert Vettori, Fire Protection Engineer

Project Objective:

Quantify the impact of large fires on buildings and their occupants, and investigate the use of current technology/resources for mitigating the hazards.

Technical Accomplishments:

Specific tasks currently being addressed by this program are 1) to analyze smoke flows down a corridor with and without sprinkler intervention and 2) to investigate the extent that materials or geometry effect the fire performance of systems furniture.

If the fire can not be suppressed in the room of origin, the impact of the smoke flow in the corridor (means of egress) with and without sprinkler intervention needs to be quantified. The pre-flashover condition series of fire tests in the U.S. Coast Guard's full scale corridor fire test facility have been completed. Smoke flows in the 37.5 m long corridor have been measured for fires with heat release rates ranging from 450 to 1200 kW. The post-flashover series of fire tests will be completed by 10/93. Results from these tests will be compared with predictions from the existing corridor model in FPETOOL and the Harwell FLOW 3D field model.

Due to the wide spread use of systems furniture in open office plan space, the potential fire hazard of these furnishings in "as used" situations needs to be quantified. A combination of laboratory scale and full scale tests will be used to quantify the fire development in open office plan scenarios and address means of mitigating the potential fire hazard. Results of the tests will be compared with predictive methods for determining peak heat release rates and flame spread rates. The testing will begin in FY 94.

Reports and Publications:

New Project

Related Grants:

None

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT – FY93

SMOKE PLUME TRAJECTORY FROM *IN SITU* BURNING OF CRUDE OIL IN ALASKA

Funding Agency: Alaska Department of Environmental Conservation (ADEC)

Professional Staff: Kevin McGrattan (project leader)

Anthony Putorti  
William Twilley  
Dave Evans  
Howard Baum  
Ronald Rehm (CAML)

Project Objective

Provide information about the expected trajectory of smoke plumes from the use of *in situ* burning as a response method for oil spills in Alaska.

Technical Accomplishments

Measurements of the burning rate, smoke yield and particulate size distribution from the burning of two varieties of Alaskan crude oil (Cook Inlet and North Slope) were made. The tests consisted of burning layers of oil in a 1.2 meter diameter pan in the large scale fire testing facility at NIST. The laboratory measurements were extrapolated to the expected size of fires at operational scale based on previous reported results from laboratory and mesoscale experiments. This information was then used as input for the Large Eddy Simulation model of smoke transport, which solves the conservation equations of mass, momentum and energy, predicting the downwind trajectory and concentration of particulate matter and other combustion products.

Publications

Walton, W.D., *et al.* "In Situ Burning of Oil Spills: Mesoscale Experiments and Analysis", Proceedings of the Sixteenth Arctic and Marine Oil Spill Program Technical Seminar, June 7–9, 1993, Calgary, Alberta, pp. 679–734.

NISTIR, to be completed.

**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
Grantee Project FY93**

Institution: Purdue University

Grant No: 60NANB2D1291

Grant Title: A Study of Entrainment and Flow Patterns in Pool Fires  
Using Particle Imaging Velocimetry

Principal Investigator: Professor J. P. Gore  
School of Mechanical Engineering  
Purdue University  
West Lafayette, IN 47907

Other Personnel: Mr. X. C. Zhou, Doctoral Student  
Dr. Y. Sivathanu, Research Associate

NIST Scientific Officer: Drs. Takashi Kashiwagi and Anthony Hamins

Technical Abstract:

Introduction: Entrainment of ambient air by a fire determines the flame size, shape and the composition of the fire products that are transported to the upper layer and to surrounding passages. The availability of air also determines the smoke and CO production, thermal radiation and fuel depletion. The existing experimental data involving entrainment have been obtained with three different techniques and are not in agreement with each other. The existing entrainment correlations are based on data obtained using gas fueled fires and have generally not been compared to data from liquid fueled fires. The present research is aimed at the application of laser Doppler Velocimetry (LDV) and Particle Imaging Velocimetry (PIV) to entrainment measurements. Measurements using a conventional technique (involving sampling of exhaust products captured in a hood) are also completed simultaneously to compare the results. The resulting data are expected to delineate the effects of fuel type, fire size, combustion efficiency and radiative heat loss fractions on the entrainment rates and lead to an improved understanding of the flow and flame structure.

Entrainment is defined as the mass flow rate of air that is set in motion including the portions that are engulfed by the flame and mixed, heated and possibly chemically reacted. The total entrainment as defined above is important in determining the properties of the upper layer or of the total flow leaving a fire. The portion that participates in combustion is important in determining the flame length and size as well as degree of ventilation. Defining, delineating and measuring these portions is important for practical applications. However, the concept has limitations in that a well-defined separation between the portions can be obtained only with the definition of the complete flow field.

Operating Conditions: A 7.1 cm toluene pool fire studied previously in this laboratory was used for the first set of entrainment measurements. The burner involved a constant 2 mm height of the liquid fuel below the rim maintained by supplying liquid fuel at a rate of 83 mg/s and adjusting the jacket cooling water flow to control the burning rate. Recognizing the sensitivity of the entrainment flows to ambient disturbances, floor size and height of liquid below the pool edge, these variables were controlled as much as possible. The

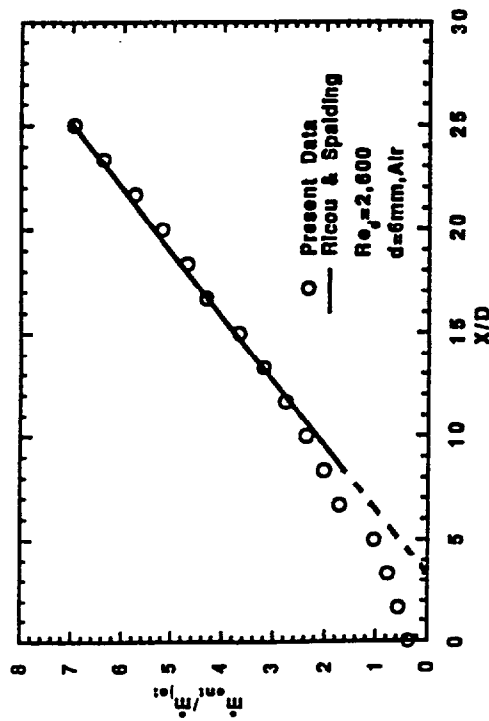


Figure 1: LDV Measurements of Entrainment into an Air Jet and Comparison with the Correlation of Ricou and Spalding.

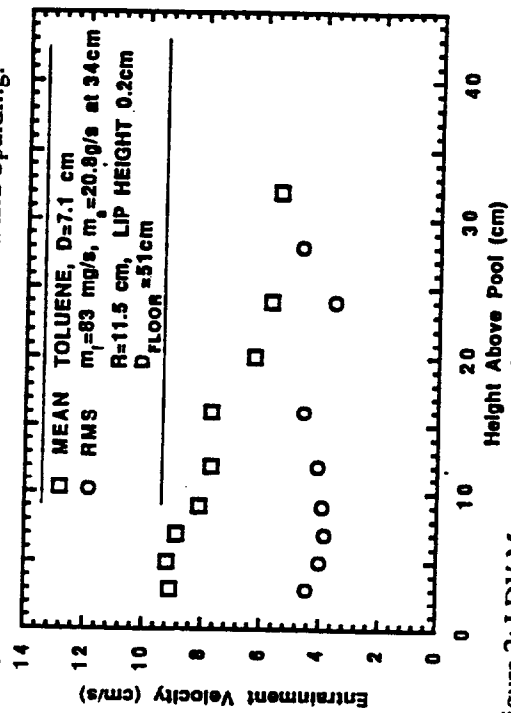


Figure 2: LDV Measurements of Mean and RMS Radial Entrainment Velocity for Toluene Pool Fires.

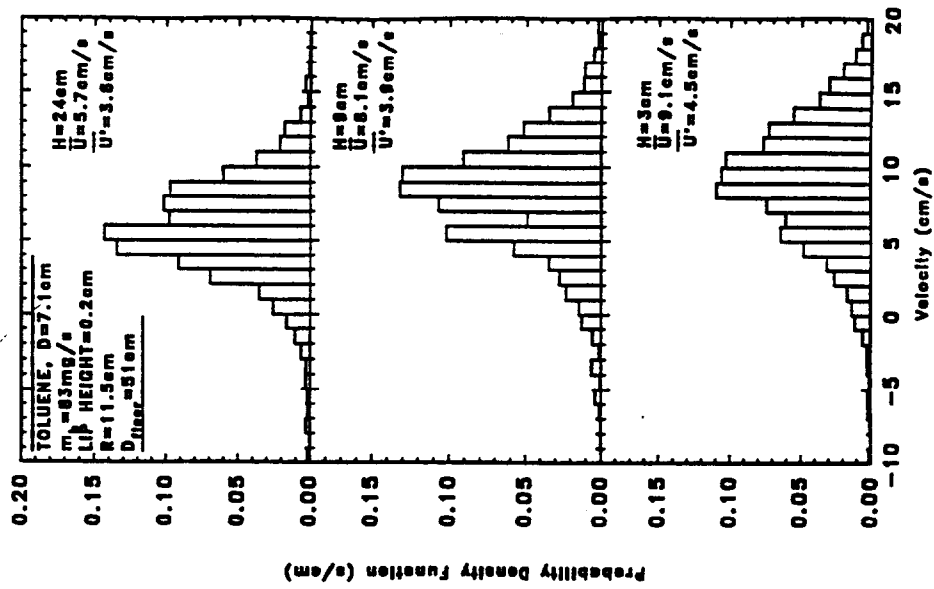


Figure 3: Probability Density Functions of Entrainment Velocity for Three Different Heights above the Pool Surface.

**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
Grantee Project FY93**

**Institution:** Purdue University

**Grant No:** 60NANB1D1172

**Grant Title:** A Study of Simulated Oil Well Blowout Fires and Flares

**Principal Investigator:** Professor J. P. Gore  
School of Mechanical Engineering  
Purdue University  
West Lafayette, IN 47907

**Other Personnel:** Mr. P. Dutta, Doctoral Student  
Dr. Y. Sivathanu, Research Associate

**NIST Scientific Officer:** Dr. David D. Evans

**Technical Abstract:**

**Introduction:** High liquid loading (85 to 95 % liquid by mass) spray fires may occur following accidental ruptures of flammable liquid storage tanks and pipe lines as well as oil well blowouts. The resulting industrial fires can be costly in terms of downtime, lost production, hazard to personnel, and litigation. The mechanisms of stabilization of such fires as well as their global properties remain poorly understood and correlated. One of the reasons for this difficulty was that controlled laboratory experiments with high liquid loading stable flames could not be established. An effervescent atomizer burner has been developed in this project to overcome this difficulty. The atomizer relies on the process of expansion of small dissolved gaseous bubbles upon depressurization of a two phase stream resulting in fine atomization. The resulting spray can be evaporated and burnt using a pilot flame in an axi-symmetric jet configuration at laboratory scales. In the present work, lengths, radiative heat flux, temperature and transmittance properties of the high liquid loading jet flames were studied. Comparison of the flame length data with existing correlations show important two phase flow effects that need further consideration.

(1) **Operating Conditions:** Table 1 shows the operating conditions for the flames studied during the present investigation. The mass flow rate of the atomizing methane was varied between 5 and 20% of the mass flow rate of the crude oil. The hydrogen flow used for flame stabilization did not affect the atomization quality significantly. The heat release rates for the flames varied between 9 and 21 kW based on nominal heating values for the three fuels. The Reynolds number characteristic of the jet can be based on the external orifice or the atomizing port. The two different selections lead to an order of magnitude difference in the exit Froude numbers. The appropriate Froude number in terms of buoyancy Vs momentum domination is currently unknown. The atomization quality produced by the present burner was measured in terms of Sauter Mean Diameters (SMD) using a Malvern instrument. Figure 1 shows the probability in terms of percent particles in a band as a function of diameter for three liquid loadings with a fixed methane to liquid ratio of 5%. The SMD appears to increase initially with liquid loading but is almost constant at 46 microns for the two larger flames.

measured temperatures together with high transmittance values indicate a high combustion efficiency in the present configuration.

**Acknowledgment:** The oil well blowout and diverter fires program at NIST has been supported by the Mineral Management Service of the U. S. Department of Interior with Mr. Ed Tennyson, Mr. Charles Smith and Mr. John Gregory serving as program monitors.

#### Reports and Papers:

- 1 P. Dutta, J. P. Gore, Y. R. Sivathanu and P. E. Sojka, 1993, Global Properties of High Liquid Loading Turbulent Crude Oil + Methane/Air Jet Diffusion Flames, Proceedings of the Symposium on Heat Transfer in Combustion and Fire, ASME/AIChE National Heat Transfer Conference, ASME, New York., in press; also Combustion and Flame, submitted.
- 2 Y. R. Sivathanu and J. P. Gore, 1993, Total Radiative Heat Loss in Jet Flames from Single Point Radiative Flux Measurements, Combustion and Flame, in press.

Table 1: Operating Conditions.

| Test Case | $\dot{m}_{OIL}$<br>(mg/s) | $\dot{m}_{CH_4}$<br>(mg/s) | $Re_d = 4.76 \text{ mm}$ | $Re_d = 0.38 \text{ mm}$ | $Q_t$<br>(kW) | $X_R$<br>(%) |
|-----------|---------------------------|----------------------------|--------------------------|--------------------------|---------------|--------------|
| 1.        | 135                       | 27.0                       | $3.8 \times 10^3$        | $1.8 \times 10^4$        | 9.2           | 11.4         |
| 2.        | 234                       | 32.8                       | $5.5 \times 10^3$        | $2.3 \times 10^4$        | 14.2          | 10.2         |
| 3.        | 238                       | 23.8                       | $4.9 \times 10^3$        | $1.8 \times 10^4$        | 13.5          | 15.5         |
| 4.        | 250                       | 25.0                       | $5.1 \times 10^3$        | $1.9 \times 10^4$        | 14.0          | 14.0         |
| 5.        | 260                       | 13.0                       | $4.8 \times 10^3$        | $1.1 \times 10^4$        | 13.9          | 21.4         |
| 6.        | 328                       | 16.4                       | $5.4 \times 10^3$        | $1.3 \times 10^4$        | 17.0          | 20.7         |
| 7.        | 360                       | 18.0                       | $5.7 \times 10^3$        | $1.5 \times 10^4$        | 18.5          | 20.6         |
| 8.*       | 400                       | 20.0                       | $6.9 \times 10^3$        | $1.6 \times 10^4$        | 21.0          | 19.5         |

\*HIGHER HYDROGEN FLOW RATE

$$Re_d = \frac{\rho_{TP} V_{TP} d}{\mu_{TP}}$$

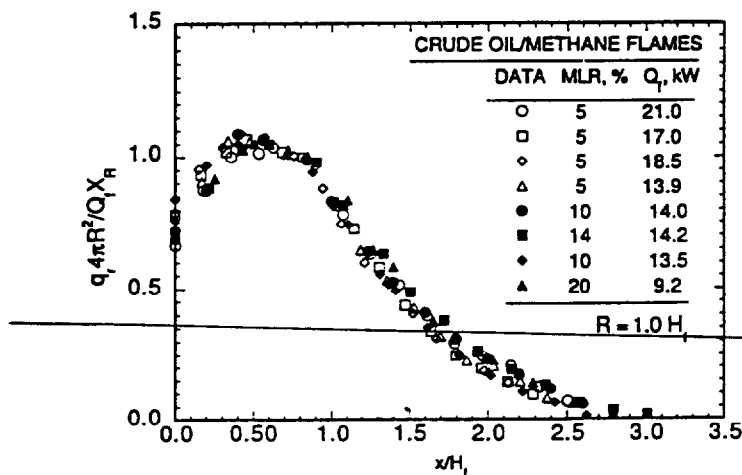


Figure 2. Normalized radiative heat flux parallel to the axis of crude oil/methane flames.

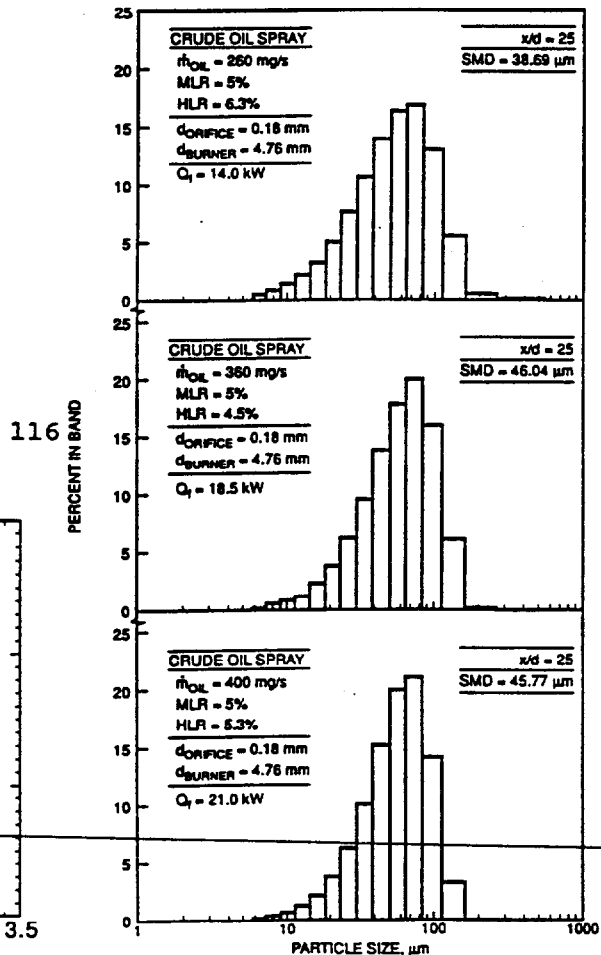


Figure 1. Malvern measurements of drop size distributions for crude oil sprays for three liquid flow rates with fixed liquid to gas loading ratio.



**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
PRIORITY PROJECT - FY93**

**WIND BLOWN LARGE FIRES**

**Professional Staff:**      David D. Evans, Project Leader  
                                 William Walton, Fire Protection Engineer  
                                 Howard Baum, NIST Fellow  
                                 Kevin McGrattan, Mathematician  
                                 Daniel Madrzykowski, Fire Protection Engineer

**Project Objective:**

Develop measurement and analytical methods needed to characterize large fires capable of threatening the environment or integrity of urban building complexes, industrial and commercial facilities, and transportation systems by 1997.

**Scope:**

This project is directed at measurement and prediction of large wind blown fires that occur as the result of industrial accidents and natural disasters. Research effort is directed at the development of non-intrusive means to assess major burning characteristics of large fires including geometry, motion, heat release rate, and emissions. The fate of wind blown combustion products in the near fire region that may extend downwind 100 km are included in this study of fire effects.

**Technical Accomplishment:**

A new area for research at BFRL dealing with open fires in the environment was proposed as a \$1.5 million NIST FY 1995 initiative. This initiative addressed the technical problems of assessing large fire situations from industrial accidents or natural fire disasters and predicting the major effects including the impact of the smoke plume downwind of the fire. The proposal focused on developing measurement methods capable of quantifying fire conditions and the actions of fire fighter over broad areas and the development of high resolution short range forecasting methods for the smoke plume trajectory. This program would enable the development of a high quality information system for response decisions that would provide for efficient use of limited resources during large fire emergencies. The initiative was withdrawn to promote a research program clearly focused on building fires.

The dynamics of wind blown smoke plumes was studied both experimentally and through computational fluid dynamic based modeling. Existing corridor fire tests facilities are being modified to construct a modest 12 m long wind tunnel to assess wind blown smoke plume trajectories in a series of tests to be conducted in September, 1993. A Fourier Transform Infrared Spectrometer (FTIR) will be used in conjunction with traditional point measurements of CO<sub>2</sub> using non-dispersive IR instruments to assess the concentrations of CO<sub>2</sub> in a wind blown smoke plume. In these experiments the use of FTIR in both the transmission and emission mode will be explored. The experiments have been planned in part using a CFD model of the wind blown smoke plume. Measurements from the experiments will in turn be used to verify parts of the model.

## **B. Fire Safety of Products and Materials**

### **B1. Materials Combustion**

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
PRIORITY PROJECT - FY93

BURNING RATE OF MATERIALS

Professional Personnel

Takashi Kashiwagi, Group Leader  
Anthony Hamins, Mechanical Engineer  
Kenneth Steckler, Physicist  
Mun Choi, Post-Doctoral Associate

Principal Objectives

To develop the capability to predict the burning rates of thermoplastic and char-forming polymers based on improved understanding of the physics and chemistry of gasification and the energy feedback from a pool flame to the fuel surface by September, 1995.

Scope

In order to accurately model the burning rates of polymers, both gasification rates and heat feedback rates from a flame to the fuel surface must be understood. Polymer gasification consists of three parts: thermal degradation chemistry, heat transfer and mass transfer processes in the polymer. Through a detailed study of each major component in the gasification process, a global model consisting of simplified sub-models will be developed. Flame heat transfer processes including heat feedback to the fuel surface are studied in a pool fire configuration. Pure liquid fuels are used to simulate the burning of polymer degradation products.

Technical Accomplishments

I. Polymer Gasification Rate Model

Condensed phase processes were modeled using one-dimensional transient numerical computations which assume that the solid is opaque, has finite thickness, temperature-dependent thermal properties, and that the heat of vaporization, and the vaporization temperature can be specified and are constant. The condensed-phase models -- one for the preheating period, the other for the gasification period -- are heat conduction equations without and with a moving boundary, respectively. The governing equations are the same as those used in previous work [1,2] except their range has been changed from semi-infinite to finite and the unexposed-surface boundary is now adiabatic.

These equations have been solved with the MOL1D (Method Of Lines, 1 Dimension) [3] software package. MOL1D is a PDE solver which provides minimal and cumbersome access to intermediate results. Recently, we began working with MATHEMATICA [4], a very extensive mathematics software package, which includes a simultaneous ODE solver. Working with H. Baum, we solved several PDE preheating and gasification problems by expressing the spatial derivatives at N grid nodes as finite differences and solved the resulting N simultaneous ODEs (in which time was the independent variable) using MATHEMATICA. Intermediate results are readily available with this latter approach.

the surface as the slab becomes thinner. This sharp increase is not mitigated in the calculation by the back-face heat losses to a calcium silicate board that occurred in the experiment. The calculation terminated at 790 seconds when surface regression reduced the total number of computational nodes below 5, the minimum required for solution by MOLID.

#### References

1. Hamins, A., Yang, J.C., and Kashiwagi, T., 1993, A Simple Global Model Predicting the Burning Rate of Liquid Pool Fires, submitted to Fire Safety Journal.
2. Steckler K.D. Kashiwagi, T., Baum, H.R., and Kanemaru, K., Analytical Model for Transient Gasification of Noncharring Thermoplastic Materials, Fire Safety Science - Proceedings of the Third International Symposium, 1991, pp.895-904.
3. Hyman, J.M., The NYU Report - The Method of Lines Solution of Partial Differential Equations, October, 1976. Los Alamos Scientific Laboratory, Los Alamos, NM. (computer code Revision No. 1, October 1978).
4. Wolfram, S., MATHEMATICA: A System for Doing Mathematics by Computer, Second Edition, Addison-Wesley, 1991.

#### Recent Publications

"An Experimental Investigation of the Pulsation Frequency of Flames," Hamins, A., Yang, J.C., and Kashiwagi, T., The Twenty-Fourth Symposium (International) on Combustion, 1992, pp.1695-1702.

"Radiative Heat Feedback in a Toluene Pool Fire," Klassen, M., Gore, J.P., Sivathanu, Y.R., Hamins, A., and Kashiwagi, T., The Twenty-Fourth Symposium (International) on Combustion, 1992, pp. 1713-1719.

"Heat Feedback to the Fuel Surface in Pool Fires", Hamins, A., Klassen, M., Gore, J.P., Fischer, S.J. and Kashiwagi, T., submitted to Combust. Science & Technology (1993).

"Simultaneous Optical Measurement of Soot Volume Fraction and Temperature", Choi, M.Y., Hamins, A., and Kashiwagi, T., submitted to Combust. and Flame (1993).

#### Related Grants

"The Behavior of Charring Materials in Simulated Fire Environments", Eric Suuberg, Brown University.

"A Study of Entrainment and Flow Patterns in Pool Fires using Particle Imaging Velocimetry", J.P. Gore, Purdue University.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NIST DIRECTOR'S FUND - FY93

CHAR STRUCTURE AND FLAMMABILITY

Professional Staff: Takashi. Kashiwagi, Group Leader  
Thomas J. Ohlemiller, General Engineer

Project Objective:

To determine the optimal way in which to suppress polymer flammability through the control of char structure. This requires a detailed examination of the links between original polymer structure, char characteristics and realistic flammability properties for a series of polymer systems by September, 1993.

Technical Approach and Accomplishments:

To provide partially charred samples for analyses, the polymer samples are exposed to well-defined temperatures or radiant fluxes comparable to those in fire environments. These samples are heated, degraded, and partially charred in a nitrogen atmosphere. Completely charred samples to slightly charred samples are formed by varying exposed temperature or external radiant flux, yielding a series of snapshots of the thermal behavior of the polymer in fire-like conditions. Measurements are being made on each char sample of C/H ratio by elemental analysis, aliphatic and aromatic carbon content by solid phase NMR and functional group content by FTIR. Measurement of the number of cross-linking sites is attempted by a solvent swelling technique. Heat transfer characteristics of the char residue and measurement of pore size distribution in the char sample are planned. Flammability properties of the char residue are measured by bench-scale techniques. They will provide critical information regarding at what stage of the char formation and char structure flammability of the polymers is significantly reduced.

The construction of a new large heated flow tube is nearly completed. About 10 g of powdered sample will be fed in to the tube and will be degraded to form char at various selected temperatures in a nitrogen atmosphere. Evolved gaseous products will be continuously fed into FTIR to measure change in products distribution.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT - FY93

CIGARETTE IGNITION METROLOGY

Funding Agency: U.S. Consumer Product Safety Commission

Professional Staff: Richard Gann (Project Leader), Emil Braun, Keith Eberhardt (882), Richard Harris, Randall Lawson, Henri Mitler, Thomas Ohlemiller, Kay Villa (ATMI), George Walton (863)

Project Objective: Fulfill NIST responsibilities under P.L. 101-352, the Fire-Safe Cigarette Act of 1990, by August 10, 1993: develop a standard test method to determine cigarette ignition propensity; compile performance data for current cigarettes using the method; and conduct laboratory studies on and computer modeling of ignition physics to develop a predictive capability.

Technical Accomplishments: The development of two test methods is complete, including successful interlaboratory evaluations of both. The Mock-Up Ignition Test Method uses substrates physically similar to upholstered furniture and mattresses: a layer of fabric over padding. The measure of cigarette performance is ignition or non-ignition of the substrate. The Cigarette Extinction Test Method replaces the fabric/padding assembly with multiple layers of common filter paper. The measure of performance is full-length burning or self-extinguishment of the cigarette. Routine measurement of the relative ignition propensity of cigarettes is feasible using either of the two methods. Improved cigarette performance under both methods has been linked with reduced real-world ignition behavior; and it is reasonable to assume that this, in turn, implies a significant real-world benefit. Both methods have been subjected to interlaboratory study. The resulting reproducibilities were comparable to each other and comparable to those in other fire test methods currently being used to regulate materials which may be involved in unwanted fires. Using the two methods, some current commercial cigarettes are shown to have reduced ignition propensities relative to the current best-selling cigarettes. A final report is in press. Complementary models of a furniture-like substrate reacting to a burning cigarette and a cigarette burning on such a substrate, along with a protocol for their use, have been completed. A final report is in review.

Publications: Ohlemiller, Thomas J., Villa, Kay M., Braun, Emil, Eberhardt, Keith R., Harris, Jr., Richard H., Lawson, J. Randall, and Gann, Richard G., "Test Methods for Quantifying the Propensity of Cigarettes to Ignite Soft Furnishings," NIST Special Publication 851, National Institute of Standards and Technology, in press, 1993.

Mitler, Henri E. and Walton, George N., "Modeling the Ignition of Soft Furnishings by a Cigarette," NIST Special Publication 852, National Institute of Standards and Technology, Gaithersburg, MD, in press, 1993.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT - FY93

Grant Title: Fire Growth Models for Materials

Grant Number: 60NANB2D1266

Institution: Department of Fire Protection Engineering, University of Maryland, College Park, MD

Principal Investigator: J. G. Quintiere, Prof. Other Personnel: B. Rhodes, Graduate student

NIST Scientific Officer: T. Ohlemiller

Technical Abstract:

The principal objective of this project is to develop engineering models to predict the fire growth of materials. Specifically we are currently investigating the dynamics of burning rate under the heat transfer conditions of the Cone Calorimeter. Data from the Cone Calorimeter are used in several models to predict the fire growth on wall and ceiling materials in a room corner test scenario. We have developed one such model (Quintiere, 1993) that attempts to generalize energy release rate data from the Cone Calorimeter in terms of the heat flux imposed on the material. This includes the external and the flame heat transfer. In that model, the burning rate is considered to be quasi-steady. It depends on the transient external heat flux and on a specified flame heat flux. Specifications of flame heat flux in the room-corner test scenario can be developed from the summary presented by Quintiere and Cleary (1992). However, in general, more data are needed on flame heat flux in order to generalize this approach. The present study is designed to provide more insight into the dynamics of transient burning and the role of flame heat flux in the Cone Calorimeter. The premise is that if these aspects can be better quantitatively understood, then the data from the Cone Calorimeter and other such devices could be more effectively used in predictive models for fire growth.

Before explaining our approach to studying the dynamics of burning under the Cone Calorimeter heat transfer conditions, we will give some background related to this work. The framework for the burning rate model we are considering has been outlined by Quintiere (1992). It considers an integral approach to the burning rate of a finite solid. Flame radiative heat flux is specified, but can be a function of the mass loss rate. The gas phase aspects are considered steady, whereas the solid phase is one-dimensional and unsteady. This model has been addressed for semi-infinite thermoplastic materials by Iqbal (1993). The model includes preheating to ignition before pyrolysis based on the use of ignition temperature. Also, only surface vaporization is considered at a constant vaporization temperature. An integral solution yields a solution for the preheating period in terms of a single nonlinear algebraic equation for the net surface heat flux. An extension of the integral solution to the vaporization period yields the following equations for solution.

$$\frac{d\delta}{dt} = \frac{6\alpha}{\delta} - \frac{3\dot{m}''}{\rho}$$

$$\dot{m}'' = \frac{\frac{h_c}{c_g} \left( \frac{\xi}{e\xi - 1} \right) \left[ Y_{O_2, \infty} (1 - \chi_r) \frac{\Delta H}{T} - c_g(T_v - T_o) \right] - \frac{2k}{\delta}(T_v - T_o) + (1 - \tau_s) \dot{q}_{f,r}'' - \epsilon \sigma T_v^4}{\Delta H_v}$$

where

$\dot{m}''$  is the mass loss rate per unit area,  
 $\delta$  is thermal penetration depth,  
 $t$  is time,  
 $\alpha$  is the thermal diffusivity of the solid,

It is surprising that so little is known about the flame heat fluxes under realistic fire conditions. The effects of scale, orientation, and enclosure have not been studied in a systematic way. Lacking fundamental approaches that can be practically implemented, it is suggested that experimental correlations might have greater immediate practicality. However, data are lacking to even explore such an approach. This brings us to the current experimental study under heat transfer conditions in the Cone Calorimeter. Since this device is in such wide spread use, it was decided to explore the flame heat flux under its range of external radiative conditions. Our strategy is to attempt to make direct measurements and to use the inferred technique described above. The experimental results have recently commenced, and we shall describe the experimental approach.

The experimental apparatus consists of a Cone heating element and load cell identical to the standard Cone Calorimeter. The heating element is manually maintained at a constant temperature by a variable transformer during a test. PMMA is burned on an insulated platform as in the standard Cone test. No edge frame is employed, however, thin cardboard is bonded to the sides of the PMMA to prevent edge effects during burning. This tends to provide a fixed face area as the sample regresses. A 3.2 mm (1/8 inch) water cooled heat flux meter is inserted in a slightly over-sized hole at the center of the PMMA sample to measure the surface heat flux. As the sample regresses the heat flux meter remains fixed, so that the surface heat flux is not measured any longer as significant regression occurs. The heat flux sensor is a thermopile type with a high emissivity surface. It is designed to measure the incident total heat flux. Water at approximately 50 C maintains the sensor at a fixed temperature, and prevents condensibles from contaminating it during a test. The sensor is continually calibrated before and after a test, and up to now no significant degradation effects have occurred. The following measurements are being taken, but not necessarily all simultaneously in the same test run:

1. mass loss,
2. surface heat flux,
3. surface temperature, and
4. back surface temperature.

Data for black PMMA are currently being taken over a range of external radiative heat fluxes of up to 70 kW/m<sup>2</sup>. Also a simulated burning sample is employed consisting of a glass head burner supplying methane. The burner has a metal sleeve to accommodate the heat flux sensor in order to measure the flame heat flux under simulated steady burning conditions in the Cone assembly. Experiments are expected to be concluded and the data analyzed over the next few months. The model described above will be further tested and utilized to compute the flame heat flux from the measured burning rate. Thus the two methods for determining the flame heat flux can be compared.

#### Acknowledgements:

We wish to thank Drs. T. Kashiwagi and T. Ohlemiller for their assistance in providing logistic and technical support for the laboratory experiments. Also we are grateful for the valuable assistance of Mr. E. Braun for providing the guidance in establishing the data acquisition system, and to Mr. R. Shields for assisting in the experimental assembly.

#### References:

- Cleary, T. and Quintiere, J. G., 1992, ASME Winter Annual Meeting, Anaheim, CA.
- Iqbaal, N., 1993, "Burning Rate Model for Thermoplastic Materials", Master of Science Thesis, Department of Fire Protection Engineering, Univ. of Maryland, College Park, MD.
- Modak, A. and Croce, P., 1977, Plastic Pool Fires", Combustion and Flame, Vol. 30, pp. 251-265.
- Quintiere, J. G., 1992, "A Semi-Quantitative Model for the Burning Rate of Solid Materials", NISTIR 4840, National Inst. of Standards and Technology, Gaithersburg, MD.
- Quintiere, J. G., 1993, "A Simulation Model for Fire Growth on Materials Subject to a Room-Corner Test", Fire Safety Journal, Vol. 18.



BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT-FY93

FIRE RESISTANT AIRCRAFT MATERIALS

Funding Agency

Federal Aviation Administration

Professional Staff

Marc R. Nyden, Research Chemist  
James E. Brown, Research Chemist  
Barry Bauer, Research Chemist (MSEL)  
Charles Dick, Research Physicist (Physics)

Project Objective

To develop a technical basis (by September 1994) for increasing the fire resistance of existing aircraft materials and for the design of a new generation of ultra-fire resistant polymer grafts and composites for use in the interiors of commercial aircraft.

Technical Accomplishments

Synthetic polymers comprise a significant fraction of the fire load borne by commercial aircraft. The flammability and combustion toxicity of these materials impact the passenger survivability of in-flight and post-crash fires. In recent years the FAA has issued improved fire test standards for aircraft seat cushions, panels, cargo liners and evacuation slides. Flammability measurements on the honeycomb composite panels used in the sidewalls, ceilings and stowage bins of commercial aircraft indicates that this material burns in two distinct stages. Only the initial stage is associated with a significant release of heat. A dramatic reduction in the peak rate-of-heat-release (~100%) was observed when the honeycomb panels were heated overnight in an oven at 250 °C. Analyses of the FTIR spectra of the evolved gases indicates that this reduction in flammability is probably due to decreased levels of CH<sub>4</sub> produced in the thermal decomposition of the heat treated resin. Thermal gravimetric analyses of the resin indicates that gases are not produced at temperatures below 450 °C, which when taken in conjunction with the FTIR-EGA results, suggests that the heat treatments actually induce a chemical change in the resin.

Publications

"Computer Aided Molecular Design of Fire Resistant Aircraft Materials," International Conference for the Promotion of Advanced Fire Resistant Aircraft Interior Materials, Federal Aviation Administration, Atlantic City, NJ, 1993.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT - FY93

FLAME RETARDANT STUDY

Funding Agency: General Electric Co.

Professional Staff: Takashi Kashiwagi, Project Leader  
Thomas G. Cleary

Project Objective:

To understand the effects of polymer structure and certain flame retardant treatments on flammability properties of engineering thermoplastics and advanced structural composites.

Technical Accomplishment:

Various flammability properties, ignition, flame spread rate, heat release rate, CO and soot yields, and smoke extinction, are measured for various GE's polycarbonates, polyimides and polyphenyleneoxides with and without flame retardant treatments. The effects of external radiant flux on the flammability properties of these sample were determined using Cone Calorimeter and LIFT devices. Since all of these samples intumesce during burning, two sample mounting configurations are used. One of them is with a metal frame and a coarse grid to retain the sample surface at the original location. The other is without any frame or a grid and the sample intumesces without any restriction. The former tends to generate lower heat release rate and the latter higher heat release rate. Since the sample size used in the Cone Calorimeter is relatively small ( about 10 cm x 10 cm), the amount of intumescent might be affected by the size. In order to study this effect samples with the size of 61 cm x 61 cm was tested to measure the amount of intumescent and also heat release rate. It was observed that heat release rate of the polycarbonate-siloxane copolymer samples was much lower (about one third) than that for the pure polycarbonate sample; also extinction area calculated from the measured He-Ne laser beam transmission through the exhaust duct for the polycarbonate-siloxane copolymer sample was significantly lower (about one order) than that for the latter sample. These trends are consistent with those measured in the Cone Calorimeter. Therefore, the size of the sample does not significantly affect the flame retardant performance of the polycarbonate-siloxane copolymer sample. The significant differences between the small sample and the large sample are in the total mass loss as a fraction of original weight from the sample and also in the total heat release per unit surface area. The large sample lost more weight and produced more total heat than the small sample.

Gasification rate, temperature distribution in the sample, and evolved gaseous products of selected combinations of polymer samples will be measured using the new radiative gasification device. The gasification experiment will be conducted in nitrogen atmosphere to make certain that there are no gas phase reactions. The sample will be exposed to external flux up to 75 KW/m<sup>2</sup>. Samples with and without the treatments will be studied to determine the effects of the treatments on the gasification process and hopefully to understand the mechanism of the flame retardant treatment.

Reports and Publication:

"Effects of Sample Mounting on Flammability Properties of Intumescent Polymers", Kashiwagi, T. and Cleary, T.G., Fire Safety J., 20, 203-225 (1993).

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT - FY93

MATERIAL FLAMMABILITY PREDICTIVE TECHNIQUES/METHODS

Funding Agency: U.S. Navy, David Taylor Research Center

Professional Staff: James E. Brown, Research Chemist  
Thomas J. Ohlemiller, Research Engineer  
Thomas G. Cleary, Chemical Engineer

Project Objective:

To develop for the U. S. Navy by September, 1993 an assessment of the correct external heat flux levels to be used in bench-scale flammability data intended to predict the full-scale behavior of composite materials.

Technical Accomplishments:

Medium-Scale Upward Flame Spread on Composite Materials

Most materials of interest to the Navy are sufficiently fire resistant as to require some external heat flux before they will yield upward flame spread in a flat wall configuration. For this reason, and to meet other program goals, we have built an medium-scale radiant panel facility which can be used under the hood of our furniture calorimeter. This facility allows uniform irradiation on samples 38 cm wide by 122 cm tall. The spread of flames and the resulting heat release process can be measured simultaneously. This facility has been applied to a pair of resin/woven glass composites. Flame spread behavior was measured as a function of external flux and of igniter size. The heat flux into the surface is being measured at several points during the flame spread process. The flux will also be measured on these same materials in Cone Calorimeter scale experiments. One goal is to determine the appropriate external flux conditions for small-scale measurements intended to be input into flame spread models. A second goal is to test the ability of existing spread models to predict the observed full-scale behavior.

Publication:

Ohlemiller, T., Cleary, T., Brown, J. and Shields, J., "Assessing the Flammability of Composite Materials", J. Fire Sciences, 4, July/August, 1993, p. 308

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT - FY93

RADIATIVE IGNITION AND SUBSEQUENT FLAME SPREADING  
IN MICROGRAVITY ENVIRONMENT

Funding Agency: NASA Microgravity Science Program

Professional Staff: Takashi Kashiwagi, Co-Project Leader  
Howard R. Baum, Co-Project Leader  
Kevin B. MacGrattan

Project Objective:

Develop a theoretical model to be able to predict ignition and subsequent flame spreading over a thin cellulosic material in a microgravity environment using the material characteristics determined in normal gravity by September, 1994.

Technical Accomplishment:

Two-dimensional, two-dimensional axisymmetric, and three-dimensional time-dependent ignition and subsequent flame spread with slow forced flows from 0 to 10 cm/s in microgravity has been developed. Its gas phase model is based on irrotational flow mainly controlled by the slow forced flow, gas expansion and mass addition from a degrading condensed fuel with one-step oxidative reaction with energy and chemical species equations. Its condensed phase model is based on the thermally thin cellulosic sheet with three global degradation reactions, pyrolysis reaction and oxidative degradation of the sheet to generate char and gaseous products, and oxidative char degradation. Preliminary results show that ignition parameters, the size of irradiated area, its duration and flux, have significant effects on transition to flame spread. The effects of flow velocity, oxygen concentration, the size and its duration of external radiant flux, with and without a pilot, and many other parameters (gas phase reaction kinetics,...) on transition from ignition and flame spread will be studied. It appears that transition from spontaneous ignition to flame spread tends to be difficult without the slow flows. Determination of kinetic constants of the three degradation reactions was completed using TGA analysis with multiple heating rates and oxygen concentrations and by continuous evolved gas analysis of CO, CO<sub>2</sub>, H<sub>2</sub>O and O<sub>2</sub>. A series of experiments corresponding to the above calculation will be planned in the glovebox of the USML-2 shuttle mission which is scheduled to fly in September 1995. The effects of external wind velocity and the size of irradiated area on ignition, the transition to flame spread and flame spread process will be determined for comparison with the predicted results.

Reports and Publication:

"Heat and Mass Transport From Thermally Degrading Thin Cellulosic Materials in a Microgravity Environment", Kushida, G., Baum, H.R., Kashiwagi, T. and Di Blasi, C., J. Heat Transfer, 114, 494-502 (1992).

"Global Kinetic Constants for Thermal Oxidative Degradation of a Cellulosic Paper", Kashiwagi, T. and Nambu, H., Combustion and Flame, 88,345-368 (1992).

"Heat Transfer from Radiatively Heated Thick Material in a Low Reynolds Number Microgravity Environment", Yamashita, H., Baum, H.R., Kushida, G., Nakabe, K. and Kashiwagi, T., J. Heat Transfer, 115, 418-425 (1993).

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
PRIORITY PROJECT-FY93

POLYMER FLAMMABILITY MODELING

Professional Personnel

Marc R. Nyden, Research Chemist  
James E. Brown, Research Chemist

Project Objective

To develop a technical basis for the design of a new generation of fire retardants and fire resistant materials.

Scope

The demand for better, cheaper and safer products has lead to a rapid proliferation of high performance and specialty polymers. This development has created a pressing need for new and more versatile approaches to increasing fire resistance. There is a strong correlation between char yield and fire resistance. This follows because char is always formed at the expense of combustible gases and because it protects the underlying polymer from the heat generated in combustion reactions. The presence of a surface char layer also acts as a physical barrier which obstructs the flow of gases produced in the degradation of the interior and thereby depresses the concentration of fuel in the gas phase.

In principle, the tendency of a polymer to char can be increased by chemical additives and/or by altering its molecular structure. We have demonstrated that factors which promote char formation are revealed in molecular dynamic simulations of degrading polymers. In particular, we observed that cross-linked model polymers charred more readily than their linear counterparts. This prediction has been confirmed by Cone Calorimeter measurements made on  $\gamma$  and electron beam - irradiated polyethylene (PE), as well as, on chemically cross-linked poly(methyl methacrylate). We are now investigating the efficacy of chemical additives which, though inert at ambient temperatures, will promote cross-linking at the onset of the thermal degradation of the bulk polymer.


Technical Accomplishments

We have demonstrated that molecular dynamics modeling is useful in providing concepts for the development and design of fire resistant materials. In particular, we have established that the flammability of certain polymers can be reduced by the addition of cross-linking agents and/or by exposing them to ionizing radiation.

Publications

"An Investigation of the Thermal Stability and Char Forming Tendency of Cross-linked Poly(methyl methacrylate)," S.M. Lomakin, James E. Brown, Robin S. Breese and Marc R. Nyden, *Polymer Degradation and Stability*, *in press*.

"A New Generation of Fire Resistant Polymers: Part I Computer-Aided Molecular Design," Marc R. Nyden and James E. Brown, *Proceedings of the 12<sup>th</sup> Joint Panel Meeting, UJNR Panel on Fire Research and Safety*, Tskuba, Japan, 1992.

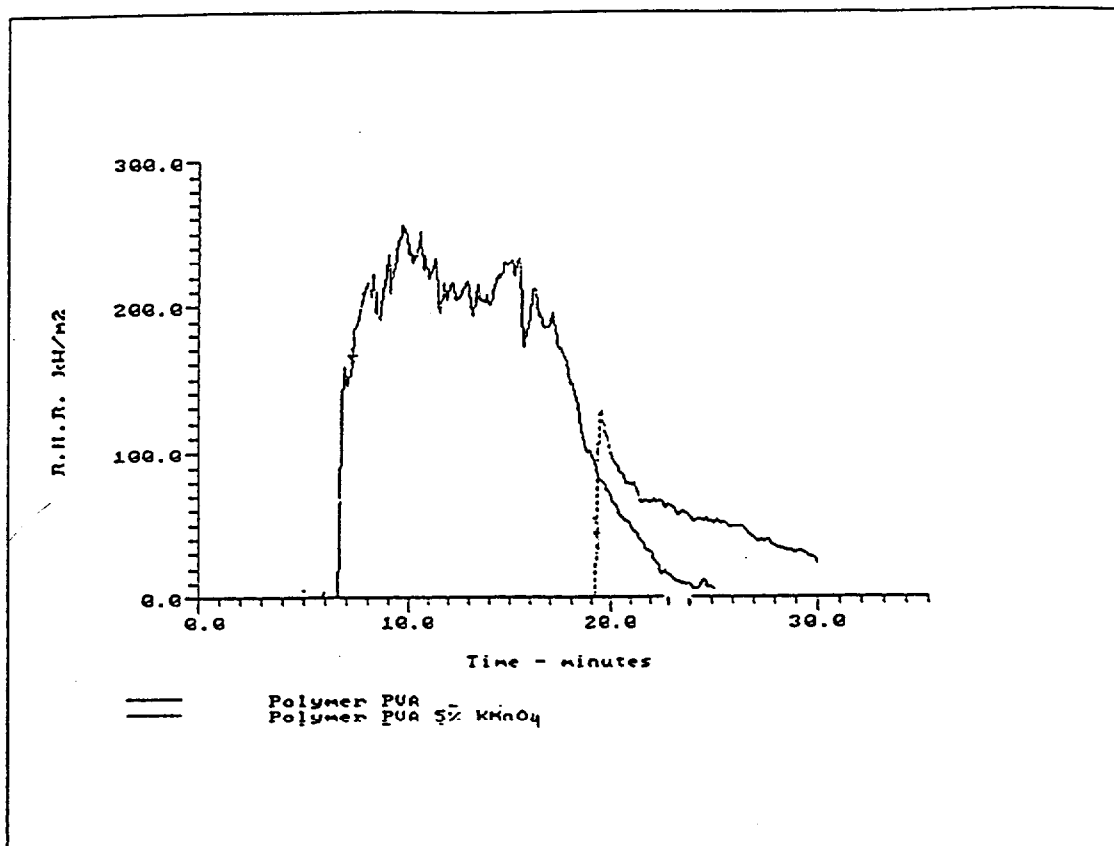

**Figure 3.** The presence of only 5% KMnO<sub>4</sub> in poly(vinyl alcohol) increases the time to ignition by more than a factor of two and reduces the peak rate of heat release by almost 50 %.

## **B2. Furniture Flammability**

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
PRIORITY PROJECT - FY 93

FURNITURE FLAMMABILITY

Professional Personnel

Andrew Fowell, Division Chief  
Thomas Ohlemiller, Research Engineer  
John Shields, Physical Scientist

Project Objective

Develop by 1996 a method by which manufacturers can predict the peak rate of heat release of residential furniture.

Technical Approach

The overall approach focuses on enabling the broader use of fire barrier technology in lessening furniture flammability. Fire barriers are non-combustible layers placed between fabric and polyurethane foam to minimize the contribution of the latter to any fire. They are a key element in furniture which passes the requirements of California Bulletin 133 (no more than 80 kW peak heat release rate in response to a 18 kW ignition source). There are two possible failure domains for a furniture item subjected to this test, during burner application or subsequent to it. In the former domain the barrier is intact, typically, but the fabric itself, coupled with the area of involvement, yields an excessive heat release rate. In the latter domain, which typically occurs long after burner termination, the barrier may fail in areas where flaming persists for an extended time. The work in the current year seeks to assess whether the former failure mode is predictable by (or at least correlatable with) the behavior of the material combinations as tested in the Cone Calorimeter and LIFT tests. As a part of this we are performing heat flux measurements on burning chairs to assist in determining the most meaningful external flux domain in which to make small scale measurements. We also seek to determine, at least qualitatively, the mechanism behind the later domain failures of barrier materials; visible and infrared images of the test items are used for this purpose.

Technical Accomplishments

A test series is underway using a variety of cushion materials in what is essentially the CB 133 mock-up frame for upholstered furniture testing. Six fabrics, three commercial barrier materials and two types of polyurethane foam are being examined using the CB 133 test protocol. Typically a set of four cushions (seat, seat back and two arms) is subjected to the CB 133 gas burner; the resulting heat release is measured in the NIST Furniture Calorimeter. A pair of silicone oil "cooled" heat flux gages is placed on the fabric surface near one corner juncture of three cushion surfaces. The gages are run at two different temperatures; a thermocouple sewn into the fabric near the gages measures the local fuel surface temperature. Test specimen behavior is recorded with visible and infrared video cameras, as well as still photo cameras. The test series is incomplete at this point but one new observation has emerged from the results thus far. A late peak in heat release (which may or may not exceed the 80 kW limit) can occur even if the barrier remains intact. Fires can become established on the lower surfaces of the cushions and sustain themselves by a continuing downward flow of polyurethane melt produced by heat transferred



### **B3. Wall and Ceiling Fires**

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
PRIORITY PROJECT - FY93

CEILING FIRES

Professional Personnel

H.E. Mitler, Project Leader  
K.D. Steckler, Physicist  
P. Reneke, Programmer

Project Objective

To develop an understanding of the effects of the presence of a ceiling on the evolution of a wall, corner, or other room fire, followed by the spread of the fire across the ceiling. This should be at a level sufficient to produce a preliminary (engineering-level) algorithm by September 1993, a much superior one by September 1994, and which can be incorporated into HAZARD.N by September 1995.

Scope

This project addresses the problem of fire growth on walls and ceilings in enclosures, and particularly on their mutual interactions. The effects of the ceiling on room fires is one of the most notable lacunae in our ability to predict the development of room fires. The wall-fire project (as well as other studies) have yielded reasonably successful models which predict wall fires. Most of these studies, however, neglect the effect of the ceiling; this is the case, in particular, for SPREAD, the BFRL model which is being prepared for insertion into HAZARD. That is, most extant models assume (in effect) that the wall is infinitely high. In fact, the presence of a ceiling has several important effects. Studying and modeling these phenomena is a natural -- indeed, a necessary -- sequel to the Wall Fire project. There are a number of other areas where having such a model will be important.

Technical Approach

The work is being done in three phases. In the first year, a literature survey of fires impinging on ceilings, including axisymmetric fires, wall fires, and corner fires, will be carried out. Flame extensions, fluxes and their position dependence, entrainment rates, effect on combustion rates, and ignition of flammable ceilings will all be looked at. As a result of the survey, determine what areas need to be studied further. Establish how much time, other resources, are needed. Suggest work for grantees to carry out, see what experimental work we can carry out at BFRL. Develop more detailed work plan, especially for years two and three. Finally, tie together theoretical understanding of flows and combustion under ceilings with empirical observations and put together a preliminary algorithm. In the second year, a preliminary plan for writing a stand-alone ceiling fire computer program will be formulated; this will include the interaction with the wall-fire computer program SPREAD and plans for its insertion into CFAST. Numerical investigation of the fluid flows, using FLOW3D, might supplement experiments to yield a quantitative understanding of this behavior, the obvious first condition for constructing a predictive algorithm. Scaling laws can be examined and/or established, and parameters varied in ways that might be prohibitively time-consuming and expensive -- or, indeed, impossible -- by experiment. Plan and carry out new experiments. Based on the new data, devise a much better algorithm, and write an NISTIR on the work. In the third year, calculate effects of ceiling ignition when ceiling is

**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT – FY93**

|                          |   |
|--------------------------|---|
| Institution:             | University of Kentucky  |
| Grant Number:            | 60NANB2D1295  |
| Grant Title:             | Fire Spread along the Vertical Corner Wall, Part I  |
| Principal Investigator:  | Kozo Saito, Professor of Mechanical Engineering   |
| Other Personnel:         | Cheng Qian, Doctoral Student<br>Hiroki Ishida, Visiting Scholar<br>Ted Oizumi, Visiting Scholar |
| NIST Scientific Officer: | Dr. Henry Mitler  |

#### **ABSTRACT**

Based on the previous experimental results on non-spreading corner fire studies at the Combustion and Fire Research Laboratory of the University of Kentucky, flame spread behavior and spread rate of pyrolysis front along the vertical corner walls were investigated in detail using an automated infrared imaging system (AIIS). A unique feature of AIIS is: for flames whose emissivity is less than 0.1, the flame interference effects (soot, CO<sub>2</sub> and H<sub>2</sub>O) can be eliminated using a 10.6  $\mu$ m band-pass filter, so that a time series of temperature map on a relatively large material surface area can be obtained from a remote location. Our experiments also showed that emissivity of pyrolysis front for most of building materials is nearly one [1]; therefore, it is possible to accurately measure the spread rate of pyrolysis front in any direction from the obtained time series of infrared images [1]. To demonstrate this, the infrared images were obtained at six different time periods after ignition of bottom of the corner wall, the location of the 329 °C isotherm at corresponding times are shown in Fig. 1, and the maximum spread rate in upward direction, deduced from the figure 1 results, is shown in Fig. 2. If an attempt was made to duplicate the similar result by multi-point thermocouple measurement, the work will be extremely elaborate. In addition, the thermocouple temperature measurement technique may be unreliable due to the uncertainty of pyrolysis temperature of the wall surface. It is obvious that visual observation techniques which were employed previously by several researchers can produce ambiguous results in the determination of the two-dimensional transient pyrolysis front location [1].

#### **RECENT RESULTS**

Our upward flame spread study in the grant 60NANB2D1295 period includes: (1) the effect of ceiling on the spread rate, and that on temperature and heat flux distributions over the corner walls; (2) mechanism of M-shape pyrolysis front formation along the vertical corner wall which was observed during the flame spread with ceiling and without ceiling; and (3) applicability of a simple one-dimensional thermal prediction model to the

prediction of the maximum upward spread rate along the vertical corner wall. The study (1) will aid us to quantitatively understand how the ceiling affects heat transfer rate to the vertical corner wall. The study (2) will help us developing a model to predict upward spread rate along the vertical corner wall, since the maximum spread rate is achieved at the peak of the M-shape pyrolysis front. The study (3) will provide the data for assessing the need for developing complex two-dimensional prediction model. In this abstract, we only present outlines of the results from studies (1) and (2), although the other part of study (1) and study (3) include some new findings.

### **Ceiling Effects on Temperature and Heat Flux Distributions on the Vertical Corner Wall**

Our one-half scale room corner model (1.6 m high x 1 m wide x 1 m long) was used for this measurement. Two vertical corner walls, ceiling and floor were made of Marinite board of 1.5 cm thickness (see Fig. 1). A propane gas burner (15 cm long x 15 cm wide x 5 cm high) was placed on the floor near the corner. Both the heat flux and temperature distributions were measured after a steady state temperature distribution was achieved at the corner wall. The heat flux was measured with three water-cooled heat flux meters. Two of them were fixed on the corner wall; while one flux meter was traversed from point to point. Representative temperature and heat flux distributions with and without ceiling are shown in Figs. 3. An interesting aspect of these results is that: both the heat flux and temperature distributions with the ceiling are lower than those without the ceiling. The reason was thought that the ceiling may play as a resistance, therefore, the buoyancy induced flow is not able to fully develop resulting in a poor convective heat transfer to the wall.

### **Mechanism of M-Shape Pyrolysis Front Formation**

The maximum flame spread rate along the vertical corner wall was achieved a few inches away from the corner; and the flame did not spread along the corner until the pyrolysis front reach the ceiling forming M-shape pyrolysis front (see Fig. 1)[2]. Four possible mechanisms were thought to explain the formation of the M-shape pyrolysis front: M1 - Ignition source effect; M2 - Solid phase conduction heat loss; M3 - Fire-induced flow cooling; and M4 - Flame displacement effect. Each mechanism was experimentally investigated. To test M1, PMMA corner walls with 30 cm wide x 1 m long x 1.2 cm thick were used; in one case bottom of the corner walls was uniformly ignited by a line gas burner and in another case only the bottom vertex was ignited by a propane torch. Both cases resulted in M-shape pyrolysis formation proving the role of M1 is minor. M2 was tested building two different PMMA corner walls: in one case the two PMMA boards were glued together in order to enhance the conductive heat loss at the vertical corner, while in another case the two PMMA boards were fixed on a large Marinite wall in order to minimize the conductive heat loss at the vertical corner. Both cases, however, resulted in the formation of M-shape pyrolysis front proving the role of M2 is minor. M3 was tested placing a small disc on the corner half way between the ceiling and floor with the aim to prevent the fire induced air to cool the corner. M-shape pyrolysis front formation appeared regardless of existence of the disc proving the role of M3 is minor. Finally M4 was tested by changing the corner angle, since flame displacement distance defined as the distance between the corner and the flame surface can be changed by changing the corner angle without changing the flame temperature. As a result, for the PMMA corner walls with 135 degree angle, the flame displacement distance was decreased by approximately half of that for the 90 degree corner angle; while with decreasing the corner angle (i.e, increasing the flame displacement distance), M-shape formation was enhanced on the PMMA corner walls.

## ACKNOWLEDGEMENTS

KS wishes to acknowledge Henry Mitler for his guidance in this research program, John deRis who offered corner heat loss mechanism for M-shape formation, and Forman Williams who offered fire induced air flow cooling mechanism. Matching grants from Vice Chancellor's Office for Research and Graduate Studies and the Center for Robotics and Manufacturing Systems, both at the University of Kentucky are acknowledged.

## REFERENCES

- [1] Arakawa, A., Saito, K., and Gruver, W.A., *Combust. Flame*, 92:222 (1993).
- [2] Qian, C., Ishida, H., and Saito, K., *Presented at the Central States and Eastern States Section Combustion Institute Joint Meeting*, New Orleans, AL. March 15-17, 1993.

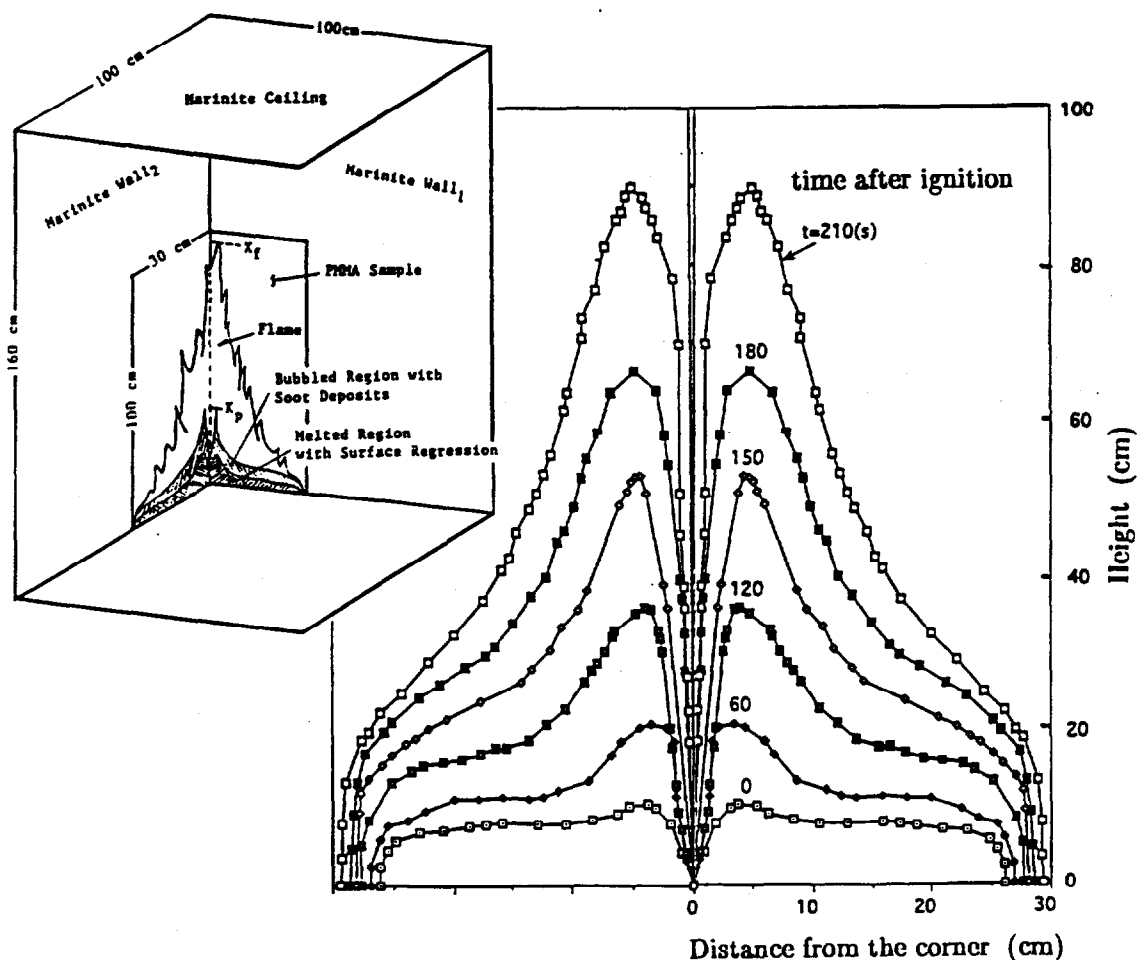


Fig. 1 Experimental apparatus and a 329°C isotherm pyrolysis front location measured at six different time periods after ignition by an automated infrared imaging system.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT - FY93

Institution: Factory Mutual Research Corporation

Grant No: 60NANB1D1177

Grant Title: Prediction of Fire Dynamics

Principal Investigators: Ronald L. Alpert and John de Ris

Other Professional Personnel: H.W. Emmons  
G.H. Markstein  
L. Orloff

NIST Scientific Officer: Dr. Henri Mitler

Technical Abstract:

This report summarizes accomplishments of a Factory Mutual Research Corporation (FMRC) project on the Prediction of Fire Dynamics for the NIST grant period indicated. Work performed under a subcontract by Professor H.W. Emmons on Ceiling-Jet Dynamics and on Development of Strategies for Performance Fire Codes is described under Task 1. The accomplishments of three tasks performed at FMRC are then presented in summaries of Tasks 2 - 4. All of this work is aimed at the development of submodels or algorithms that can be used in NIST/BFRL comprehensive computer fire models. These tasks have also led to the development of practical smoke-point measurement techniques for solid combustible materials to provide input data for the global model of flame radiation previously developed. A paper documenting the smoke-point measurement methodology has been provided to NIST.

Task 1: Prediction of Fire in Buildings (H.W. Emmons)

The objective of this task is to advance the knowledge of the science of fire physics, chemistry, psychology, and physiology, so as to make rational quantitative design for fire safety possible.

The primary objective of this task has been for some years to predict the transient development of the movement of hot gases along a ceiling. There are for current use various empirical formulas based upon limited experimental results and approximations. There are also 2- and 3-D theories requiring hours on a supercomputer. These are probably very accurate although no careful comparison has yet been made. However, such calculations are not yet practical for routine engineering use.

The simple 1-D ceiling jet theory - long used in hydraulics - was expected to serve as the best engineering approximation (with perhaps some empirical flow coefficients to correct for the effects of velocity profile and turbulence). This appears to be correct for cases of no density change, i.e., no gas heat transfer. No case with heat transfer can be thus solved since no steady state solutions exist which satisfy the required end boundary conditions. Partial progress has been made in the following three directions:

1. A solution for transient heat transfer to a finite heat capacity ceiling and the ambient below together with heat transfer from the ceiling to ambient is available with constant heat transfer coefficients. This

The Global Flame Radiation Model achieves its simple algebraic form by treating the flame as a whole. It does not explicitly consider the flame chemistry. It is applicable only to well-ventilated fires having a prescribed incompleteness of combustion. Instead, we need a more detailed integral model which explicitly considers the chemical mechanisms of soot and CO formation/oxidation as well as the flame radiation at each elevation. This model should be capable of predicting the combustion and release of soot and CO from a fire plume entering a vitiated upper ceiling layer. Initially, the model will demand more complicated mathematics (O.D.E.s) for it to provide definite understanding and useful insight. However to be practical, the physical assumptions and mathematics must be kept as simple as possible.

Considerable experimental data exists to guide the model development. Time-averaged species composition ( $O_2$ ,  $CO_2$ ,  $CO$ ,  $H_2O$ ,  $TH/C$ ) measurements throughout the lower part of buoyant turbulent diffusion flames are generally well correlated by the local time-mean equivalence ratio,  $\Phi$ . This is true for both well-ventilated and under-ventilated fires. It is particularly interesting to note that the deviations of CO concentrations in these flame correlations for different fuels generally rank with the fuel smoke-point values. Sootier fuels produce higher local CO concentrations and greater eventual CO overall release rates. Taken together these empirical studies suggest that the local turbulent flame chemistry is principally governed by the local equivalence ratio and the fuel smoke point.

### Task 3: Turbulent Flame Heat Transfer to Surfaces (J. de Ris)

The overall objective of this task is to provide experimental data for the development of submodels (i.e., formulae or correlations) of wall flame heat transfer components for inclusion in upward spread and fire growth models.

Recently, our experimental results have shown that: 1) much of the radiation emitted by the soot in flames is reabsorbed by the flames; and 2) the flames often have a cold sooty layer near the fuel surface which tends to block some of the radiant heat transfer. An 11th burner panel has been designed, built and is now being tested to specifically overcome the above problems. This panel (see Figure 3) consists of a porous-metal burner instrumented with four ray radiometers and an additional channel using an infrared-emitting diode source and a silicon detector for narrow-band emission-absorption measurement. Two radiometers are oriented normal to the burner surface and two at an angle of  $60^\circ$  to the normal direction, with one of each pair located in front of the burner panel and the other one in the rear. The radiometers in the rear are looking at the flame through nitrogen-purged apertures in the porous metal. The emission-absorption device also is oriented normal to the burner surface, using another aperture in the metal. As an additional feature, a device for automatically changing two alternative interference filters ( $\lambda=900\ \mu m$  and  $1000\ \mu m$ ) has been incorporated in the emission-absorption channel, which will permit temperature determinations by two-color pyrometry. It is also planned to add a thermocouple rack perpendicular to the burner surface for measurements of flame thickness. Check-out tests of this new apparatus are now in progress.

Our previous experiments dealt primarily with the vertical distributions of radiant emission and heat transfer within the gas supply (or simulated pyrolysis) zone. The main results of these experiments are contained in a paper presented at the 24th International Combustion Symposium. Among the conclusions, it was found that 1) the outward-directed radiance  $N_o$  emitted normal to the burner surface increased roughly linearly with height  $Z$  for fixed fuel mass flux; 2) linear relationships between reciprocal radiance  $1/N_o$  and reciprocal fuel mass flux  $1/\dot{m}$  were obtained at fixed heights; these relationships held over the entire range of mass/flux for methane and ethane, while, for ethylene and propylene, abrupt transitions separating two regimes occurred at critical mass fluxes; ordinate intercepts  $N_{\infty}$  and reciprocal slopes  $1/s$  are functions of height  $z$  that increase with fuel sooting tendency for fixed  $z$ ; 3) heat fluxes to the porous metal burner decrease with increasing fuel mass flux, particularly near the flame base. In general, the heat

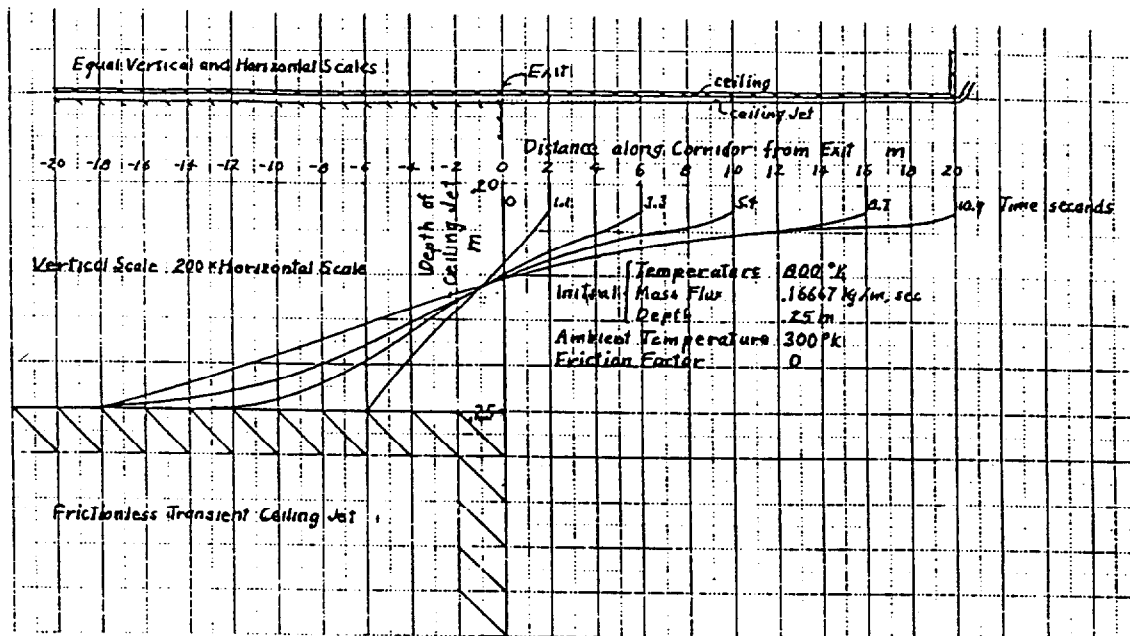


Fig. 1

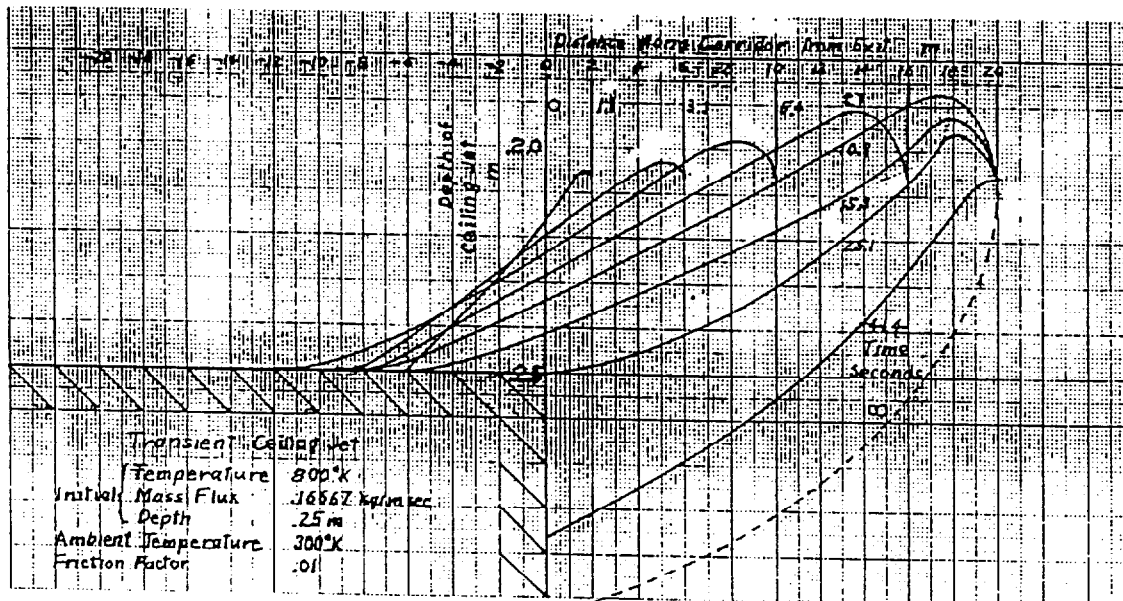


Fig. 2



**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT - FY93**

**STUDY OF HEAT AND SMOKE MOVEMENT  
AND THEIR INFLUENCE ON DETECTOR AND SPRINKLER RESPONSE  
IN ENCLOSED SPACES WITH COMPLEX CEILING GEOMETRIES**

Funding Agency

National Fire Protection Research Foundation

Professional Staff

Richard W. Bukowski, Project Leader

Glen Forney

William Davis

Project Objective

To examine the effect of complex ceiling geometry and obstructions on the distribution of heat and smoke in order to optimize requirements for automatic fire detector location found in NFPA 72E and for automatic sprinklers as covered by NFPA 13, 13D, and 13R.

Technical Accomplishments

At present, recommendations for the placement of automatic fire detectors found in the NFPA Standard on Detection Devices (72E) are based either on engineering judgement or on experiments done by Heskestad and Delichatsios on flat, unobstructed ceilings. In the implementation of these data, tables and curves were developed from calculations with a zone model which are also only applicable for flat, unobstructed ceilings. Since 72E includes recommendations for placement of fire detectors in spaces with sloping or peaked ceilings, or with open beams and joists, some validation of these recommendations is necessary. Further, detector siting problems associated with stratification and high air movement from HVAC systems are mentioned in the standards, but only limited installation guidance is provided which are based only on judgement.

In the first year of this planned four year effort, the use of CFD models was validated by reproducing the results of full-scale experiments conducted a decade ago by Heskestad and Delicatsios. Parametric studies were then conducted on a set of independent variables including fire size, ceiling height, beam depth and spacing, and room volume, and constant response surfaces were plotted for the principal types of fire sensors.

The ability of the approach to address small fires and stratification was explored with success. Sensor response characteristics were demonstrated for fires of 100 Watt release rates in a typical sized room with and without a vertical temperature gradient which exceeded the plume temperature -- resulting in a stratified flow. While there are no experimental data against which to verify these calculations, the physical processes evident in the simulation appear valid and reasonable.

Reports and Publications

NISTIR 4994, Forney, G.P., Davis, W.D., and Klotz, J.H., Simulating the Effect of Beamed Ceilings on Smoke Flow, Part. 1, Comparison of Numerical and Experimental Results.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT-FY93

Institution: The Pennsylvania State University

Grant No: 60 NANB8D0849

Grant Title: Upward Flame Spread on a Vertical Wall Under External Radiation

Principal Investigator: Professor Anil K. Kulkarni  
Department of Mechanical Engineering  
209 Reber Mechanical Engineering Building  
The Pennsylvania State University  
University Park, PA 16802

Other Professional Personnel: Ellen Brehob, Doctoral Student  
Shailesh S. Manohar, Graduate Student  
Rajesh Nair, Graduate Student  
Janice Aquino, NSF Student Intern

NIST Scientific Officer: Dr. Walter Jones

Technical Abstract:

**Introduction:** The overall objective of the present project is to understand the upward flame spread phenomenon under simulated surrounding fire conditions. This is achieved by conducting experiments on upward flame spread under external radiation, developing a mathematical model, measuring relevant material properties needed, and checking validity of the model by comparing predictions with data. Emphasis is placed on studying and predicting the behavior of practical wall materials used in building interiors and textiles. Presented below is a concise description of progress made in the past year; details on these tasks can be found in other reports and papers.

Technical Accomplishments:

(i) **Upward Flame Spread - Model and Experiments:** In the current phase of the project, flame spread tests were conducted on several new materials and a numerical model of the upward flame spread process was developed. The physical situation being modeled is shown in Figure 1. A slab of material is subjected to a known, transient heat flux on its face, it is ignited at the bottom, and the flames are allowed to spread upward. External radiation affects upward flame spread in two ways. Ahead of the pyrolysis front, the radiant heat flux adds to the heat feedback from the flame and causes the yet-unburned surface of the sample to heat up to the pyrolysis temperature quicker. Behind the pyrolysis front, where the surface area that is already burning, the external radiation increases the mass loss rate of the sample which in turn causes larger flames and enhanced heat feedback to the surface. Both of these effects of external radiation accelerate the upward flame spread. The general model equations were described in the last annual report. The effect of external radiation is included in two terms, the forward wall heat flux,  $\dot{q}_w$ , and the local mass loss rate,  $\dot{m}$ . The heat feedback is modeled as,

$$\dot{q}_w(x,t) = \dot{q}_{wo} \exp \left[ C_o \left( \frac{x-x_p}{x_f-x_p} \right) \right] + \dot{q}_{cr} - \dot{q}_{rerad}$$

where  $\dot{q}_{wo}$  is the maximum forward heat flux measured for a specific material,  $C_o$  is a constant applicable for all materials, equal to -1.37,  $\dot{q}_{cr}$  is external radiation and  $\dot{q}_{rerad}$  is reradiation of the

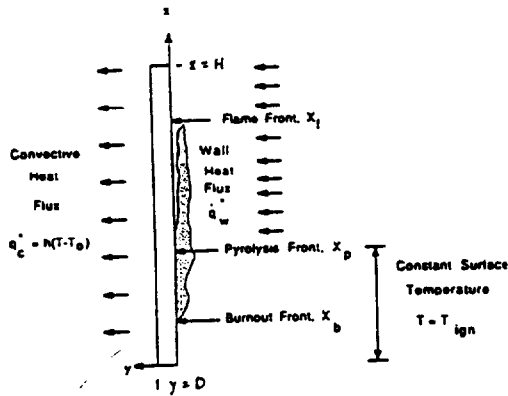


Figure 1. Boundary Conditions for the Burning Wall

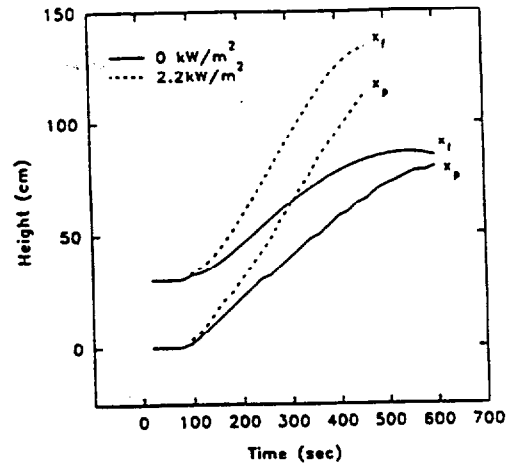


Figure 2. Flame Height and Pyrolysis Front Histories for 3.2 mm Hardboard Two Levels of Ext. Radiation

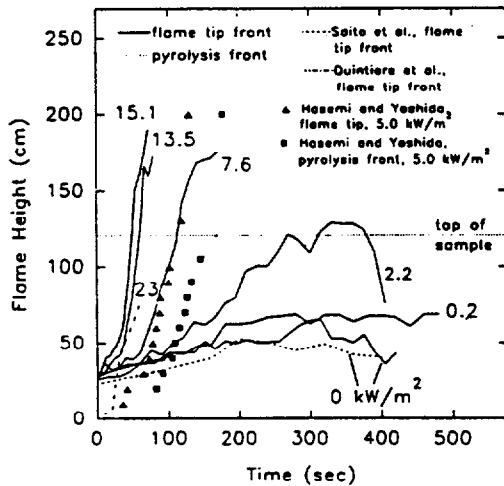


Figure 3. Flame Height for Particle Board at Various Levels of External Radiation

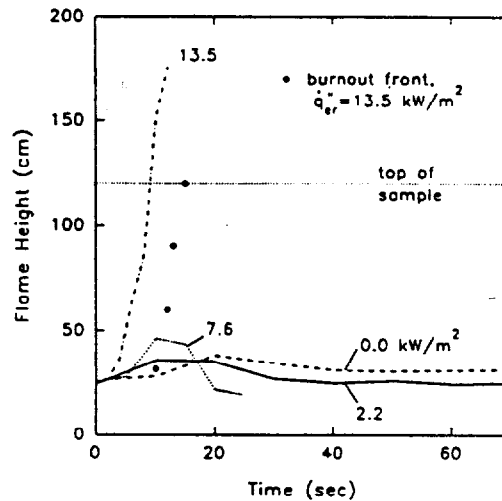


Figure 4. Flame Height for Cotton Textile at Various Levels of Ext. Radiation

## **C. Advanced Fire Sensing and Suppression**

### **C1. Fire Detection**

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
PRIORITY PROJECT - FY93

ADVANCED FIRE DETECTION SYSTEMS

Professional Personnel

William Grosshandler, Project Leader  
Richard Smith, Physical Scientist  
Marc Nyden, Research Chemist  
Margaret Jackson, Co-op Student

Project Objectives

To demonstrate novel techniques for early sensing of both traditional and heretofore unidentified products of and precursors to a fire (by 9/94), and to establish a methodology for evaluating the performance of advanced fire detection systems (by 9/96).

Technical Approach

A properly designed detection system must be able to identify in a matter of seconds a fire event which may occur only once in one hundred years, and the identification must lead to an action which is appropriate to the space being protected. This disparity in time scale and the variability in geometry, content and occupancy of the space impose great demands on the system. False alarms, maintenance problems, incomplete or inaccurate information, and inappropriate suppression responses are problems which can plague current fire detection systems, especially when cost is an overriding constraint. The phase out of halons and the increased capital investment in modern industrial processes make early sensing and suppression even more imperative.

The general approach in this research is to increase the amount of unambiguous information from the fire and protected environment, and to process the information in an intelligent manner consistent with the decisions which have to be made. Advances in the sensing of temperature, species concentrations, particulate matter, and acoustic and electromagnetic radiation have been surveyed to determine their applicability to fire detection. Of the many possible stimuli generated early in a fire, we have focused our investigations on ultra-sonic acoustic emission (AE) and infrared radiation.

Technical Accomplishments

The portable open-path Fourier transform infrared (OP-FTIR) spectrometer is a recent innovation which offers distinct advantages over conventional fire detection techniques. In situ measurements of the atmosphere of interest can be made directly and in real time, circumventing problems of extractive sampling. The limits of detection decrease in direct proportion to the path length over which the spectrum is collected, with the result that extended path lengths using multiple passes can produce high

**Related Grants**

Plumb, O.A. and Richards, R.F., "Development of an Economical Video-based Fire Detection and Location System," Washington State University.

Milke, J.A. and McAvoy, T.J., "Smart Fire Detection Using Neural Networks," University of Maryland.

Langley, L.W., "Evaluate Heat Flux Microsensor for Automatic Fire Detection," Vatel Corporation (SBIR).

**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
PRIORITY PROJECT - FY93**

**BALANCED DESIGN**

Professional Personnel

Richard W. Bukowski, Project Leader  
John Gross, Structural Engineer  
Scot Deal, Fire Protection Engineer

Project Objective

To quantify the performance and reliability of detection systems, suppression systems, and compartmentation including the field assessment of performance; to determine the conditions under which reduction or elimination of one or more of these results in unacceptable risk of loss, and to conduct a comparative analysis of compartmentation using fire resistive and noncombustible construction.

Scope

The time available for the study is insufficient to develop the needed predictive methods to address these issues solely by modeling. Thus, there needs to be a short term approach and a long term approach. For this study, it will be necessary to rely on field data for estimates of both performance and reliability; supplemented by predictive methods wherever possible.

If the full funding can be obtained it would be possible to incorporate all of the available data and utilize existing predictive capabilities to thoroughly quantify the performance and reliability of the three target technologies. In recent years the standards (i.e., NFPA 72E and 13) have incorporated procedures for performance prediction and, in the case of detectors, for design of systems on the basis of detecting critical rates of heat release. Once these levels of performance are quantified, risk assessment techniques can be used to relate reliability modified performance levels to the risks to life and property (task one).

Risk methods will also be utilized to quantify the conditions (along with uncertainties based on sensitivity analyses) for a range of trade-off options. Again, these analyses will quantify these impacts on the basis of life safety and property protection (task two). Finally, these risk methods will be used to quantify the impact of field conditions including the propensity of FR and NC constructions to compromise and field modification on performance and reliability and thus on the risks to life safety and property protection (task three).

Technical Accomplishments

During FY93 the project planning was carried out for both the technical approach and identification of resources -- both financial and informational. A workshop was held through which the state of knowledge on field performance and reliability of the key systems was explored and the potential benefits to various industries were identified in order to build a coalition. A workshop report was prepared and committees for technical and financial planning were established. A general consensus was reached as to timing and direction and a program start date of October 1, 1993 was agreed.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
DIRECTOR'S RESERVE PROJECT - FY93

DETECTION AND MONITORING OF FIRES WITH OPEN-PATH FTIR

Professional Personnel

William Grosshandler, Project Leader  
Marc Nyden, Research Chemist  
Emil Braun, Physicist

Project Objectives

To determine by September, 1993, if the open-path Fourier transform infrared (OP-FTIR) spectrometer shows promise for monitoring the products formed during the overheating of materials or smoldering prior to ignition, and for measuring the concentration of noxious combustion products created in a flaming fire and during active suppression.

Technical Approach

FTIR spectroscopy is a well-established and powerful means for measuring molecular species which have infrared activity. Traditionally, gases are extracted and placed in a sample cell through which an infrared beam is passed. Recently, a new version of the FTIR spectrometer has become available which circumvents the need to physically remove the gas sample from the volume of interest. Line-of-sight measurements along paths extending over a kilometer have been demonstrated. The research challenge for BFRL is to learn how to adapt the FTIR to open path monitoring of the products formed during the overheating of materials or smoldering prior to ignition, and to measuring the concentration of toxic species created in a flaming fire and during active suppression. Sensitivity, time response and interpretation of complex spectra in a background of particulate radiation need to be established before the OP-FTIR can be integrated into an early warning fire detection system or used to assist the fire suppression process.

Application of the instrument to four different situations has been planned: controlled, large environmental oil spill fires; laboratory pool fires; pyrolyzing solids; and the release of a suppressing agent into a closed room. The features of spectra obtained under different scan rates, number of scans, and spectral resolution will be examined in these different systems to ascertain limitations to resolution of minor constituents. The Midac OP-FTIR purchased for this study operates in both the passive and active mode, and both modes will be explored.

Difficulties in interpretation of the signal from the OP-FTIR are a result of overlapping spectra multiple species, strong temperature and concentration gradients along a line of sight, fluctuations in concentrations during the sampling period, and obscuration by smoke. Our understanding of radiative heat transfer in nonisothermal environments with and without soot will be applied to the FTIR spectrum to develop narrow-band models of the important chemical species. The goal is a numerical model which will yield estimates of concentrations and their uncertainty, as well as some estimate of the temperature profile and soot concentration. Supplemental temperature measurements and multiple views of the fire may be necessary to achieve the accuracy desired.



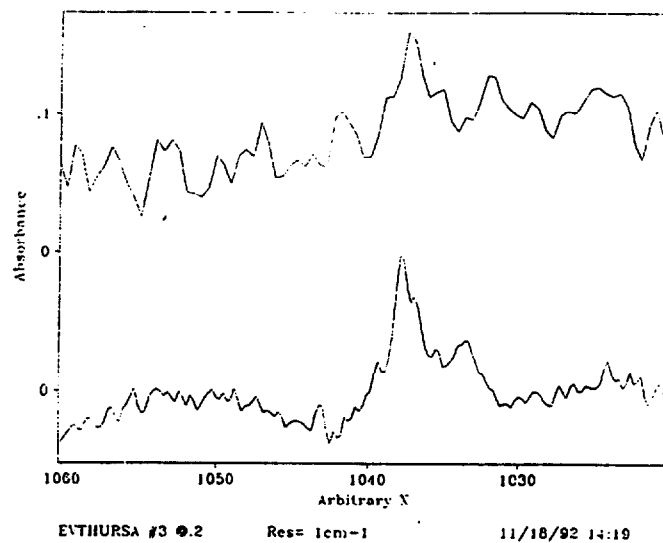


Figure 2. A spectrum measured during evaporation (top) is compared to library spectrum of benzene (bottom). The presence of benzene is indicated by peak at  $1037\text{ cm}^{-1}$ .

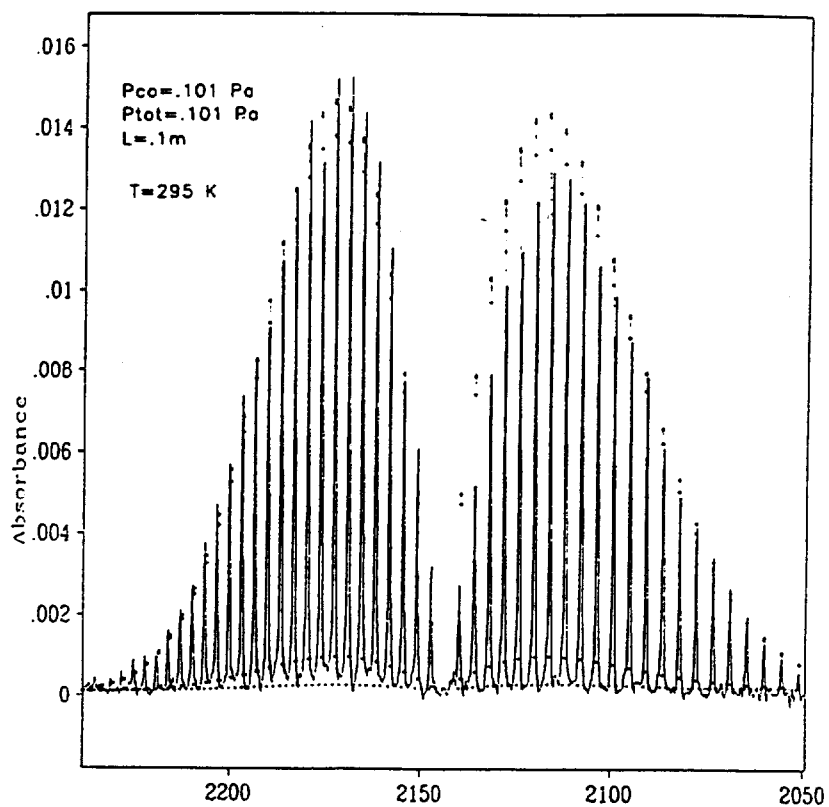


Figure 3. Result of line-by-line calculation (dotted line) compared to reference spectrum.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT - FY93

Department of Mechanical and Materials Engineering  
Washington State University

Award No. 60NANB2D1290

DEVELOPMENT OF AN ECONOMICAL VIDEO BASED FIRE DETECTION AND LOCATION  
SYSTEM

Principle Investigators: O.A.Plumb and R.F. Richards

NIST Scientific Officer: W. L. Grosshandler

A video fire detection system employing thermochromic sensors to monitor the temperature field near the ceiling of an industrial workspace is described. The system detects and then locates fires using information about changes in the temperature field acquired by a video camera and analyzed by a personal computer. The operation of the proposed fire detection system is simulated using the compartment fire zone model LAVENT. Modifications to LAVENT, made to facilitate the analysis, are discussed. The modifications include accounting for radiative transfer between compartment surfaces and between compartment surfaces and hot emitting-absorbing combustion gases. An analysis of a prototype video fire detection system and comparison of the response times of an optimized system with a standard fusible-link sprinkler system are presented.

**Proposed video fire detection system**

The proposed fire detection system consists of an array of temperature-sensitive, color-changing, sensor sheets suspended from the ceiling or posted on the vertical walls of the workspace to be protected from fire threat. The sensor sheets are fabricated of microencapsulated thermochromic liquid crystals (TLC) bonded to plastic backings. TLC's respond to changes in temperature by displaying a range of colors in a precise and repeatable manner. The temperature range over which the TLC color play occurs can be specified at the time of manufacture.

An inexpensive black and white video camera is used to monitor the TLC sensor sheets. Although the TLC sensor sheets are able to display a range of colors indicating a range of temperatures the proposed system makes use only of the onset of color (black to red) at the lower end of the TLC color band and the cessation of color (blue to black) at the upper end of the TLC color band.

A personal computer digitizes the image from the video camera and then determines which, if any, sensor sheets have changed color, their location in the monitored space, and the time at which the sensor sheets changed color. In this way the video system can continuously monitor the temperature field near the ceiling of the protected work space. Detecting and locating a fire depends on solving an inverse problem: calculating the location and magnitude of a heat source within a domain, given the temperature history at specified locations on the boundaries of the domain. Solving the inverse problem requires the specification and solution of the forward problem.

**System Simulation**

The solution to the forward problem for a compartment fire is given by the compartment fire

from the start of the fire to the first sensor sheet color change. The optimization and evaluation of the video fire detection system was carried out for two workspace environments: a large warehouse (76 x 61 x 9 m) and a medium size commercial or office space (10 x 10 x 3 m). Two kinds of fire threats were simulated in each of the workspaces: fires with constant thermal output and fires with growth rates that are quadratic in time.

The performance of the proposed video fire detection system was analyzed by running the modified LAVENT code to determine heat fluxes and resultant temperatures across the ceiling of the monitored space over time. Figure 1 shows the temperature rise on the ceiling of the large warehouse versus  $r/H$  for three constant output fires ( $Q = 200, 600, 1000$  kW) after 300 seconds. The variable  $r$  is the horizontal distance to the fire while  $H$  is the height of the enclosure ( $H = 9$  m in the warehouse). The temperature profiles represent very nearly steady-state conditions in the warehouse.

Figure 1 clearly shows that to detect small fires ( $Q = 200$  kW) any temperature sensors mounted at or near the enclosure ceiling must be able to respond to small increases in temperature above ambient. However, if sensors can reliably respond to small temperature increases above ambient sensors can be spaced fairly far apart. In the case of a 200 kW fire, sensors responding at a detection temperature above ambient of  $(T_d - T_{amb}) = 10$  C, could be at a distance of  $r/H = 0.3$  from the fire and still detect the fire. This value of  $r/H$  corresponds to a distance between sensors of  $d_s = 6$  m ( $d_s = 2(r/H)H$ ).

Figure 2 shows the time to detection,  $t_d$ , versus  $r/H$  for the three constant output fire scenarios considered in Fig. 1. For comparison purposes, the time to detection of a quadratically growing fire ( $Q(t) = 1055 (t/130s)^2$ ) is also shown. Each curve has been calculated assuming a sensor sheet detection temperature of  $T_d = 311$  C (100 F) and an ambient temperature of  $T_{amb} = 300$  K (80 F).

For the larger constant output fires ( $Q = 600$  kW,  $1000$  kW) the time to detection is seen to rise slowly with  $r/H$  for values of  $r/H < 0.5$  and then more rapidly for  $r/H > 0.5$ . The time to detection for the quadratically growing fire, rises even more slowly with  $r/H$ . Only for the smallest constant output fire ( $Q = 200$  kW) does time to detection increase rapidly for all values of  $r/H$ . Except for small fires, the use of widely spaced sensors does not necessarily result in significantly longer detection times.

Sensor spacing may be formally optimized by introducing a Figure of Merit. Figure 3 shows the Figure of Merit,  $t_d n_s$ , plotted against  $r/H$  for the fire scenarios of Fig. 2. The presence of the time to detection,  $t_d$ , in the Figure of Merit is self-explanatory. The number of sensor per unit area,  $n_s$ , is included as a multiplicative factor with the time to detection,  $t_d$ , because the cost and complexity of the fire detection system is expected to scale with the number of sensors that must be installed and monitored. Defined in this way, the Figure of Merit gives an indication of how increasing the number of sensors,  $n_s$ , (or decreasing sensor spacing,  $d_s$ ) affects the time to detection,  $t_d$ , for the system. Where the curve in Fig. 3 is flat, cutting sensor spacing in half will also cut time to detection in half. Where the curve has a negative slope, decreasing sensor spacing will bring diminishing returns in reduced time to detection. An optimized system would have sensor sheets spaced with an  $r/H$  at or just to the left of the minimum of the Figure of Merit curve.

Figure 3 shows that sensor spacing is optimized for all four fire scenarios simulated in the large warehouse over the same range of  $r/H$ :  $0.1 < r/H < 0.3$  (sensor spacing of  $1.8$  m  $< d_s < 5.5$  m). An optimized system requires relatively few sensors: the 9 m warehouse could be protected with sensors distributed on a square grid of 2 to 5 meters.

To demonstrate the performance of the video fire detection system the time to detection for an optimized system was compared to the response time of a standard fusible-link sprinkler system. The optimized video system was taken to have sensor sheets spaced 3 meters apart with a detection temperature  $T_d = 311$  K (100 F). The fusible-link sprinkler system was specified to conform to NFPA codes with fusible links, spaced 3 meters apart, having a Response-Time-Index (RTI) of  $220 (m s)^{1/2}$  ( $400 (ft s)^{1/2}$ ) and a fuse temperature of  $347$  K (165 F). Ambient temperature was taken to be  $300$  K (80 F) for both systems.

Table 1 gives a summary of the times to detection for the proposed video system and the response times of the standard sprinkler system for four fire threat simulations. In every case the video

**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT FY93**

**DEPARTMENT OF FIRE PROTECTION ENGINEERING AND  
DEPARTMENT OF CHEMICAL ENGINEERING  
UNIVERSITY OF MARYLAND AT COLLEGE PARK**

**60NANB2D1300  
SMART FIRE DETECTION USING NEURAL NETWORKS**

**Principal Investigators: James A. Milke and Thomas J. McAvoy  
Research Assistants: Samuel J. Denny and Dongling Pan  
NIST Scientific Officer: William L. Grosshandler**

**Abstract**

This research was motivated by progress made by Okayama. As a result of Okayama's small-scale experiments, the combination of the gas sensors and a neural network was able to discriminate between odors from fire and non-fire sources. The purpose of the research is again to integrate neural networks with sensors to develop a smart fire detector. The desired capabilities of this detector include very short response times, detection of fires associated with a wide variety of scenarios and discrimination between fire and non-fire or environmental sources. Complete development of such a detector involves a multi-year effort. During this one year study, effort concentrated on assessing sensor response characteristics relative to smoldering fires and non-fire or environmental sources associated with residences. In addition, initial neural networks were developed to demonstrate their utility in improving the discrimination ability of very sensitive fire sensors.

At the University of Maryland, the initial research effort was conducted by two teams: one in the Department of Fire Protection Engineering under the direction of J. Milke and another in the Department of Chemical Engineering under the direction of T. McAvoy. The fire protection engineering team concentrated on designing and building a small-scale experimental apparatus and initiating experiments to identify signatures from fire and non-fire sources. The chemical engineering team investigated the applicability of various neural networks for fire detection. The accomplishments of each team are described below.

**1. Fire Protection Engineering Team**

An operational, small-scale experimental apparatus was developed to characterize the signatures from fire and non-fire sources. The apparatus and experimental procedure are conceptually similar to those by Okayama. Okayama's experimental program was modified to provide a greater range of measurements to describe the signature.

The experimental apparatus illustrated in Figure 1 includes a means for generating smoke or odors, measurement equipment and sensors. The apparatus is adapted from the "smoke-box" specified in UL 217. The principal modification consists of the straight configuration rather than the U-shaped configuration in UL 217. The overall length of the apparatus is approximately 150 cm and the cross-sectional area is 0.09 m<sup>2</sup>. Instruments provide measurements of light obscuration, temperature, presence of oxidizable gas and gas species concentrations (CO, CO<sub>2</sub> and O<sub>2</sub>).

Sources of the smoke or odor are placed under a hood at the inlet end of the apparatus. Smoke and odors can be produced from a wide range of conditions: flaming and smoldering combustion of samples, heating

TABLE 1

| Classification Approach                 | Classification Rates |                  |
|---|----------------------|------------------|
|   | Unacceptable Parts   | Acceptable Parts |
| Direct classification by distance (G)*  | 56%                  | 56%              |
| Direct classification by distance (S)** | 60%                  | 70%              |
| Olfactory KII model (G)                 | 70%                  | 70%              |
| Olfactory KII model (S)                 | 60%                  | 70%              |
| Olfactory KIII model (G)                | 70%                  | 100%             |
| Olfactory KIII model (S)                | 70%                  | 60%              |
| Hopfield model (G)                      | 60%                  | 70%              |
| Hopfield model (S)                      | 60%                  | 70%              |
| Backpropagation network (G)             | 50%                  | 75%              |
| Backpropagation network (S)             | 60%                  | 75%              |
| Ellipsoidal network***                  | 62.5%                | 80%              |
| Ellipsoidal network(G)                  | 70%                  | 80%              |
| Ellipsoidal network(S)                  | 72.5%                | 80%              |

\* G: Binarization via Geometrical Approach

\*\* S: Binarization via Statistical Approach

\*\*\* No Binarization

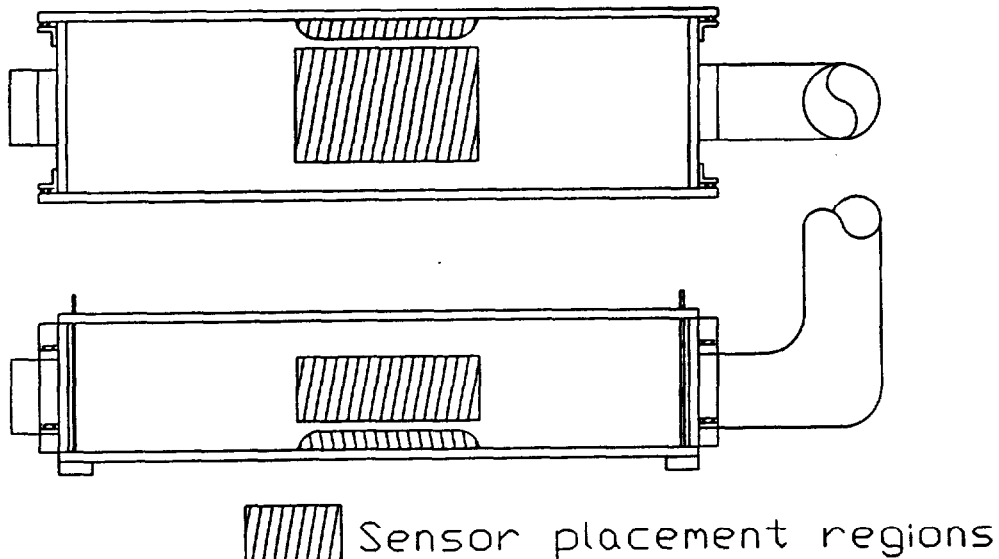


Figure 1. Schematic Diagram of Experimental Apparatus

## **C2. Fire Suppression**

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT - FY93

AGENT SCREENING FOR HALON 1301 AVIATION REPLACEMENT

Funding Agency: U.S. Air Force, Wright Laboratory

Professional Staff: William Grosshandler (Project Leader), Richard Gann, Anthony Hamins, Marc Nyden, William Pitts, John Yang, Michael Zachariah

Project Objective: To establish a comprehensive experimental program to screen eleven specified agents, sodium bicarbonate powder, and other promising chemicals as a means to identify (by 9/30/93) the best three candidates for a subsequent full-scale aircraft fire extinguishment evaluation program.

Technical Approach: A series of carefully designed experiments is being conducted to examine the thermodynamic properties of alternative fire fighting agents, their behavior during two-phase flow and interaction with flame chemistry, and the effect of the nature of the fire and the timing of release on the agents' effectiveness. Theoretical models are being used to interpret the results, to increase understanding of the suppression process, and to predict behavior over an expanded range of operating conditions.

Technical Accomplishments: The pressure of the eleven agents, pure and mixed with nitrogen and  $\text{CF}_3\text{H}$ , has been determined for a 1/3 liquid-filled condition at a temperature of 210, 295 and 422 K. The rate at which the material leaves a 500 ml vessel pressurized to 4 MPa with a 17 mm opening has been measured in about half of the compounds. The thrust of the liquid jet and the droplet behavior is being measured using high speed photography, piezo-electric transducers and laser extinction. The concentrations of all eleven agents necessary to extinguish flames in three distinct burner arrangements (cup burner, opposed-flow diffusion burner, and turbulent jet spray burner) have been measured. The decrease in pressure ratio and flame speed is being used to assess the performance of the eleven agents in a detonation tube burning ethene/air mixtures. Experiments with sodium bicarbonate powder are being conducted in the cup burner, OFDF and jet burner facilities. In addition to the experimental program, considerable effort has gone into modeling various phenomena associated with the suppression process. A chemical kinetic mechanism for the interaction of fluorinated agents with a flame has been developed; molecular bond computations are being used to help identify other promising chemicals not on the original list of eleven; and fluid mechanical models of the discharge process are assisting in the interpretation of the cold-flow experiments.

Reports and Publications:

Pitts, W.M. et al., "Dynamics of the Release of Alternate Halon Replacement Agents from Pressurized Bottles," Halon Alternatives Tech. Working Conference, Univ. of New Mexico, Albuquerque, May 1993.

Yang, J.C., et al., "Solubilities of Nitrogen and Freon-23 in Alternative Halon Replacement Agents," Halon Alternatives Technical Working Conference, University of New Mexico, Albuquerque, May 1993.

Grosshandler, W.L., et al., "Assessment of Halon Alternatives for Suppression of Turbulent Spray Flames," Halon Alternatives Technical Working Conference, University of New Mexico, Albuquerque, May 1993.

Cooper, L.C., "Discharge of Fire Suppression Agents from a Pressurized Vessel: A Mathematical Model and its Application to Experimental Design," NISTIR 5181, May 1993.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT - FY93

AGENT/SYSTEM COMPATIBILITY FOR HALON 1301 AVIATION REPLACEMENT

Funding Agency: U.S. Air Force, Wright Laboratory

Professional Staff: Richard Gann (Project Leader), Emil Braun, Thomas Cleary, George Mulholland, Richard Harris, Gregory Linteris, Richard Peacock; Gregory McKenna (MSEL), Richard Ricker (MSEL), Mark Stoudt (MSEL), William Waldron (MSEL)

Project Objective: Provide data for the appraisal of twelve USAF-specified candidate halon 1301 replacements for compatibility with flight systems, people, and the environment; recommend (in conjunction with the "Agent Screening" project) 3 candidates for further examination; perform longer-term testing to increase confidence in the preliminary results.

Technical Accomplishments: There have been two additions to the list of chemicals to be assessed and one deletion. All chemicals have been screened for non-volatile residues. One-month tests for compatibility with metals (for potential storage cylinders), gasket materials and lubricants are underway. These are being followed by testing of mechanical properties. One-month tests for storage under elevated pressure and temperature are nearly complete. Determinations are underway to assess possible uneven distribution of the chemicals following an accidental discharge in a compartment. An evaluation of potential environmental regulations that could restrict the use of the chemicals is underway.

Publications: None



**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT - FY 93**

Institution: The University of Michigan

Grant Number: 60NANB2D1293

Title: BASIC RESEARCH ON FIRE SUPPRESSION

Principal Investigators: Dr. Arvind Atreya  
Department of Mechanical Engineering and Applied Mechanics  
The University of Michigan; Ann Arbor, MI 48109-2125

Other Professional Personnel: Todd Crompton (M. S. candidate) & Jaecil Suh (Ph.D candidate)

NIST Scientific Officer: Dr. William Grosshandler

**TECHNICAL ABSTRACT:**

INTRODUCTION:

Literature on fire suppression severely lacks quantitative results on the amount of agent required and the application rate needed to suppress fires and prevent their re-ignition. As a result, little comparison between various agents is possible. Also, qualitatively the suppression actions of various agents are known (such as cooling of the condensed-phase, isolation of fuel and oxidizer, etc.) but the quantitative details of the mechanisms responsible for the agent's action are not well known. Even for water, there is little quantitative understanding regarding the extinguishment mechanisms. Thus, it has not been possible to determine how much water is actually required and what should be the application strategy. The amount of water used is often about two orders of magnitude larger than that needed in controlled laboratory experiments. The current knowledge of suppression mechanisms of halons is also insufficient to provide a clear understanding of the important chemical mechanisms. Most importantly, there does not exist a scientific basis for comparing the suppression effectiveness of physical and chemical suppression agents. This prevents development of new, perhaps more efficient, suppression agents and application strategies.

Thus, as a first step, we are developing an experimental and theoretical framework that will: (i) provide a quantitative understanding of the mechanisms (chemical and/or physical) responsible for extinguishment, (ii) enable determination of the suppression rate, time to extinguishment and agent application strategies, (iii) enable evaluation of suppression effectiveness which is needed for rational comparison of various suppression agents. The present work addresses this research problem through well-controlled small-scale laminar stagnation-point flow and counterflow diffusion flame experiments and modeling. This work focuses on water to help establish a standard for comparison with other suppression agents.

SUPPRESSION EXPERIMENTS:

Water, the most widely used suppression agent, is thought to be chemically inert in a fire and is believed to have a *physical* effect. However, there is little information on the magnitude of these effects during fire suppression. Physical cooling of porous and non-porous solids by water droplets was

#### Bright sooty flame (30% $O_2$ )

Further increase in the oxygen concentration makes the flame more sooty and bright yellow. Also, for the same flow rates of fuel and oxidizer, the flame moves closer to the porous ceramic surface. Since the flame temperature is significantly increased, water addition is expected to be more effective. Results of such an experiment are shown in Fig.3 for 13.3 mg/sec water application rate. Note that both CO and unburned hydrocarbons are oxidized to  $CO_2$ . This clearly shows chemical enhancement of the burning rate due to water application. Similar experiments conducted with 40% dilute solution of HBr show a reduction in the burning rate.

These results are consistent with the experiments conducted in sooty (fuel-rich) methane counterflow diffusion flames<sup>(3)</sup>. Here detailed flame structure measurements were made. It was found that by reducing the  $O_2$  concentration while maintaining the flame temperature by preheating the reactants (thus reducing the  $H_2O$  concentration in the reaction zone) led to an early soot inception and increased soot volume fraction. However, direct addition of only 3.6%  $H_2O$  (while holding all other conditions constant) resulted in delayed soot nucleation and a significant reduction in the soot volume fraction. These observations can be consistently explained by the mechanism of OH interference with soot inception. An increase in the  $H_2O$  concentration (brought about either by an increase in the  $O_2$  concentration or by direct addition) results in an increase in the OH concentration provided the flame temperature is high enough. This reduces the PAH and  $C_2H_2$  concentrations (the corresponding reduction in total hydrocarbons and CO was observed in the stagnation-point flow diffusion flame) and delays soot inception. This substantially decreases the ultimate soot loading and increases the combustion efficiency and hence the burning rate.

A model based upon the SANDIA CHEMKIN<sup>(4)</sup> code is being used to help understand the changes in the flame structure caused by water addition. Comparison of the model results with experiments and possible suppression mechanisms are also presented.

#### REFERENCES

- [1] Abu-Zaid, M., and Atreya, A., "Transient Cooling of Hot Porous and Non-Porous Ceramic Solids by Droplet Evaporation," Presented in the Poster Session of the 22nd. Symposium (International) on Combustion and accepted for publication in the ASME J. Heat Transfer, being revised, 1992.
- [2] diMarzo, M.; Liao, Y.; Tartarini, P.; Evans, D. D.; Baum, H. R.; "Dropwise Evaporative Cooling of a Low Thermal Conductivity Solid," *IAFSS, 3rd International Symposium*, 1991.
- [3] Zhang, C., Atreya, A. and Lee, K., "Sooting Structure of Methane Counterflow Diffusion Flames with Preheated Reactants and Dilution by Products of Combustion," *Twenty-Fourth Symposium (International) on Combustion*, The Combustion Institute, 1992, in press.
- [4] Kee, R. J., Rupley, F. M., and Miller, J. A., "A Fortran Chemical Kinetics Package for the Analysis of Gas-Phase Chemical Kinetics," *SANDIA REPORT, Sand89-8009B. UC-706*, Sandia National Laboratories, 1991.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
PRIORITY PROJECT - FY93

DYNAMICS OF FIRE SUPPRESSION

Professional Personnel

Gregory T. Linteris, Project Leader  
Kathy Notarianni

Project Objective

To develop a long-range plan of exploratory research by June, 1993 to obtain a sufficiently fundamental understanding of the mechanisms of flame extinction by existing gaseous and water mist fire suppressants to enable the development of the next generation of suppression agents and technologies.

Scope

Despite their widespread use, and notwithstanding the abundant experimental information on the quantities of inhibitors necessary to inhibit and extinguish flames, surprisingly little is known about the fundamental mechanisms by which some widely used suppressants work. Consequently, efforts to optimize the delivery and effectiveness of existing suppressants are limited. It is believed that improving the fundamental understanding of extinction and suppression will facilitate the development of more effective delivery systems as well as new agents and provide a basis for comparison of alternative suppressants.

Fire suppressants and their application methods should be effective, fast-acting, economical, have low toxicity, permit a habitable environment during suppression, leave no residue, and cause no damage to the protected space. Existing suppressants, however, are non-ideal: water can cause excessive damage, metal-based suppressants leave a residue, and the currently favored halogenated hydrocarbons may leave a corrosive residue after passing through a flame. Also, because of their suspected destruction of stratospheric ozone, the most effective halons are being phased out. There exists a continuing need for better suppressants and suppression methods.

In general, flame extinction occurs when the time necessary for chemical reaction is longer than the characteristic flow time of the system under investigation. Suppression requires flame extinction as well as prevention of re-ignition. Extinction can be achieved by increasing the reaction time, decreasing the flow time, or both. Because of the exponential dependence of reaction rate on temperature, lowering the peak flame temperature has a large affect on the reaction rate. A reduction in peak temperature can be achieved by: increasing the heat loss, reducing the heat feedback to the flame, or by lowering the effective heat release per unit mass of the reactants (often referred to as the "thermal" or "heat capacity" effect). The heat release can be reduced by addition of inert species, acting either through sensible or latent heats, or with endothermic reactions of the inhibitor. The reaction rate can also be reduced solely through kinetic effects. In these cases, the inhibitor disrupts the normal kinetics of the flame so that even at the same temperature the reaction rate is slower. For example, the inhibitor may decrease the production rate of the chain-carrying radicals in the flame (by promoting reactions which compete with the chain-branching steps), or may increase the destruction rates of radicals (through gas-phase or surface

### Publications

Linteris, G.T., "Flame Speed Measurements in a Premixed Methane-Air Flame inhibited with  $\text{CF}_3\text{H}$ ," to be submitted to the Eastern States Section Meeting of the Combustion Institute, Princeton, NJ, October 1993.

Notarianni, K., and Jason, N. (Eds.), "Water Mist Fire Suppression Workshop Proceedings," NISTIR 5207, March 1-2, 1993.

### Related Grants

"Experimental Studies of Diffusion Flame Extinction Using Halon Substitutes," K. Seshadri, University of California, San Diego.

"Basic Research on Fire Suppression," A. Atreya, University of Michigan.

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT - FY93

AN EVALUATION OF METAL VS. PLASTIC PIPING  
FOR USE IN FIRE SPRINKLER SYSTEMS

Funding Agencies: United States Fire Administration

Professional Staff: Kathy A. Notarianni, Project Leader  
Margaret Jackson, Mechanical Engineer

Project Objective: To provide a report which compares and evaluates performance of metal vs. plastic piping for use in fire sprinkler systems by October, 1993.

Technical Accomplishments: An extensive review of the fire and other relevant literature was conducted in order to compare and evaluate plastic pipe in terms of the key performance variables:

- Corrosive conditions
- Material degradation during a fire
- Maintainance
- Economics
- Occupancy classifications limitations
- System modification limitations
- Material limitations with types of systems
- System design (hydraulic calculations)
- Hanger and bracing considerations
- High water pressure
- UL listing and FM approval of material

Several databases were searched including but not limited to:

|   |                     |
|---|---------------------|
| Aerospace Database;                     | 1962 to 1993        |
| Chemical Abstracts;                     | 1970 to the present |
| Defense Technical Information Center;   | 1950 to the present |
| Engineering Index;                      | 1970 to 1993        |
| FIREDOC;                                | 1974 to the present |
| National Technical Information Service; | 1963 to 1993        |
| RAPRA Abstracts;                        | 1972 to 1993        |

The search was conducted in an X + Y manner to locate references containing an X variable such as plastic pipes, sprinkler pipes, polybutylene pipes or CPVC pipes AND a Y variable such as corrosion, corrosivity, maintenance, economics, system design, etc...

Meetings were held with manufacturers, system designers, and end users. In the ongoing phase of the project, information gathered is being summarized in terms of the key performance variables, and areas where little or no information exists are will be identified.

Publications: none

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT - FY 93

Institution: University of California, San Diego.

Grant no.: #60NANB2D1285.

Grant Title: Experimental Studies on the Extinction of Diffusion Flames Using Halon Substitutes.

Principal Investigator: Kalyanasundaram Seshadri, Department of Applied Mechanics and Engineering Sciences, University of California, San Diego, La Jolla, CA 92093-0310.

Other Personnel: D. Trees, Staff Research Associate.

NIST Scientific Officer: Dr. Anthony Hamins.

Technical Abstract: The principal objective of the proposed research is to investigate the relative influence of various agents, which are considered as substitutes for Halon 1301, in extinguishing diffusion flames burning liquid hydrocarbon fuels, specifically heptane and JP-8. The experimental configuration chosen for the study, is the diffusion flame stabilized in the mixing layer produced by directing an oxidizing gas stream downward on to the burning surface of the liquid fuel. This configuration is referred to in the literature as the counterflow configuration and is a convenient geometry for detailed fundamental studies of the structure and mechanisms of extinction of diffusion flames. The oxidizing gas used in the experiments was a mixture of air and the inhibiting agent. The agents tested were  $C_3HF_7$  (HFC-227),  $CHF_2Cl$  (HCFC-22),  $CF_3CH_2CF_3$  (HFC-236),  $CH_2FCF_3$  (HFC-134a),  $C_2F_6$  (FC-116),  $CHFCICF_3$  (HCFC-124),  $CHF_2CF_3$  (HFC-125),  $C_3F_8$  (FC-218),  $C_4F_{10}$  (FC-31-10), and cyclo- $C_4F_8$  (FC-318). Since, these agents are considered as possible substitutes for Halon 1301 ( $CF_3Br$ ), the effectiveness of these agents in extinguishing diffusion flames were compared with that of  $CF_3Br$ .

The design of the counterflow burner is similar to that employed in previous experimental studies [1]. A schematic illustration of the counterflow burner is shown in Fig. 1. This burner consists of a fuel cup which has a diameter of 45 mm and a depth of 18 mm, and a gas duct through which gaseous oxidizer containing the gaseous inhibitor to be tested is introduced. The fuel cup is cooled by water at the bottom in order to prevent the fuel from boiling, but is not cooled at the rim as that would establish a radial temperature gradient within the liquid fuel. A narrow annulus surrounds the wall of the cup near the rim to catch any overflow of the fuel and prevent it from entering the exhaust duct. A fine pointer projecting up through the liquid pool is used as an aid in adjusting the height of the fuel surface. Satisfactory repeatability has been obtained by setting the pool at the level at which the pointer just forms a discernible dimple on the fuel surface. Since, the flame sheet is very sensitive to surface movements, the fuel height in the cup is accurately controlled by a device similar to that used previously in 'cup burner' studies [1,2]. The gas handling system is designed such that it is possible to introduce measured amounts of air, oxygen, nitrogen and the gaseous inhibitor from the top duct. The gas duct has an inner diameter of 50.1 mm. A number of fine wire screens (200 mesh/inch) are placed in the duct to reduce turbulence and ensure a flat velocity profile at the exit of the duct. The distance between the ducts is adjustable and the duct can be swivelled to allow access to the fuel cup. The flowrates of air, nitrogen and the inhibitor are measured accurately by use of variable area flowmeters. Pressure gauges are arranged in parallel with the flowmeters to

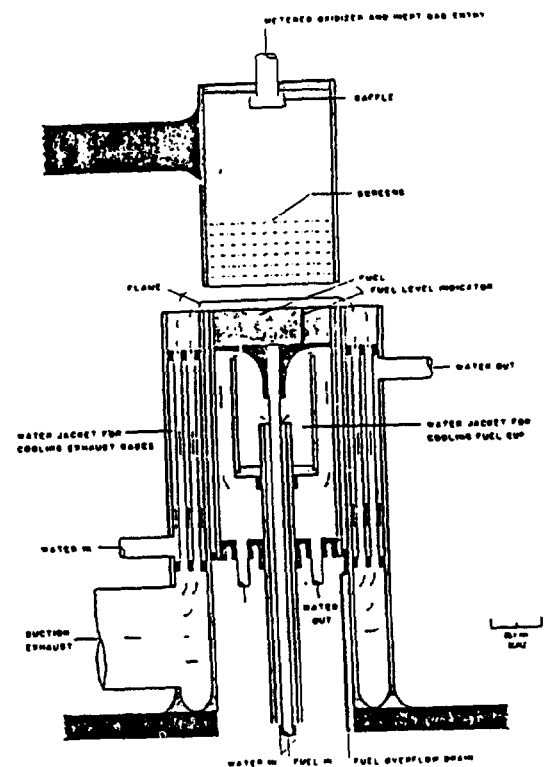


Figure 1. Schematic illustration of the counterflow burner.

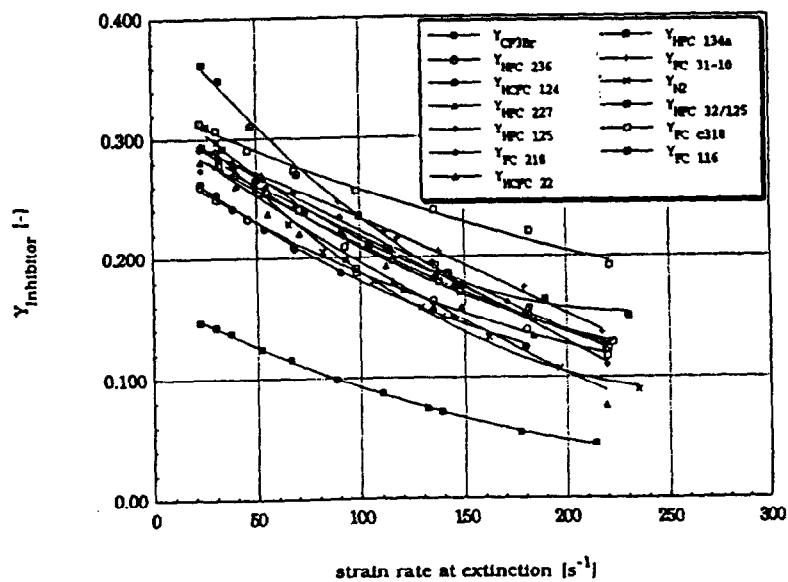


Figure 2. The strain rate as a function of the mass fraction of the inhibiting agent in the oxidizer gas stream at extinction of diffusion flames burning heptane.

**BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT - FY93**

**THE NEED FOR A SPRINKLER STANDARD  
FOR BOARD AND CARE FACILITIES**

Funding Agency

US Fire Administration

Professional Staff

Scot Deal, Project Leader

Richard W. Bukowski

Project Objective

To produce a technical report which analyzes the need for a fire protection standard for board and care facilities. The function of the standard is to provide a reasonable degree of protection for life and property from fire through standardized installation requirements for sprinkler systems based upon sound engineering principles and test data.

Scope

The current Life Safety Code contains requirements for sprinkler protection of new and substantially renovated B&C facilities according to NFPA 13D. For existing facilities, a strong compartmentation option is provided. In all cases, smoke detection is required in limited areas. Some questions exist as to the potential impact of fires beginning in spaces not required to be sprinklered under 13D, especially in light of the limited capacity of many B&C home residents to react properly and quickly.

Technical Accomplishments

The project involved an analysis of the potential impacts of sprinklers in Board and Care facilities where such are not currently required by the Life Safety Code. This includes facilities housing "prompt" residents in small and medium sized properties.

The analysis demonstrates the benefits of sprinklers relative to resident and staff safety for several common fire scenarios similar to documented fire incidents. The intent is to provide compelling information which will lead to the decision to voluntarily install sprinklers where not mandated by the code. The report is not necessarily intended to convince the code to change its minimum requirements as this is not held to be practical; particularly for small facilities with limited resources. However, the additional flexibility in admitting residents or where the capabilities of residents changes with their physical condition is hoped to be persuasive.



BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
OTHER AGENCY PROJECT - FY93

PREDICTING THE RESPONSE OF SPRINKLERS  
AND DETECTORS IN LARGE SPACES

Funding Agencies: General Services Administration  
National Aeronautics and Space Administration

Professional Staff: Kathy A. Notarianni, Project Leader  
William D. Davis, Physicist

Project Objective: To provide NASA with data on smoke movement and layer development in high bay areas by September, 1993.

Technical Accomplishments: Fire gas and disk temperatures were measured above the fire and along the ceiling in locations corresponding to the expected location of sprinklers or detectors during fire tests conducted in an aircraft hanger with a ceiling height of 30.4 m. The results of the experiments were then compared to the predictions from the zone fire models FPETool, DETACT-QS, and LAVENT inside and outside of the plume region.

Inside the plume region, both the FPETool and DETACT-QS computer programs underpredict the ceiling jet temperatures, thereby providing a conservative estimate of the time to activation of a sprinkler or detector. LAVENT predicts a greater temperature gradient in the vertical direction in the ceiling jet than was measured. The predictions of LAVENT for the positions nearer to the ceiling are closer to the measured values, and thus more accurate than the DETACT-QS or FPETool predictions. For the positions further from the ceiling, the predictions of DETACT-QS and FPETool are closer to the measured values. Outside of the plume region, the comparison of the measured and predicted ceiling jet temperatures is more accurate than inside the plume region.

In the second phase of this project, a computational fluid dynamic model, HARWELL FLOW3D, was used to model the hanger. Reasonable agreement was found between the computational fluid dynamic calculations and the experimental data.

Publications:

Notarianni, K.A., Predicting the Response of Sprinklers and Detectors in Large Spaces, Proceedings, SFPE Engineering Seminars, Large Fires: Causes and Consequences, Dallas, TX., November, 1992.

Notarianni, K.A., and Davis, W.D., "Use of Computer Models to Predict the Response of Sprinklers and Detectors in Large Spaces", Proceedings, Symposium on Computer Applications in Fire Protection Engineering, Worcester Polytechnic Institute, Worcester, MA, June, 1992.

Notarianni, K.A. and Davis, W.D., "Predicting the Response of Sprinklers and Detectors in Large Spaces," National Institute of Standards and Technology, NISTIR XXXX (to be published)

BUILDING AND FIRE RESEARCH LABORATORY  
FIRE RESEARCH PROGRAM  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
GRANTEE PROJECT - FY93

Institution: University of Maryland

Grant No: 70NANB1H1173,2

Grant Title: Transient Cooling of a Hot Surface by Droplets Evaporation

Principal Investigator: Dr. Marino di Marzo  
Mechanical Engineering Department  
University of Maryland  
College Park, MD 20742

Other Personnel: S. Tinker, Graduate Student  
G. White, Graduate Student

NIST Scientific Officer: Dr. David D. Evans

Technical Abstract:

Introduction. The modelling of the heat and mass transfer phenomena associated with the evaporation of a water droplet deposited on a glass-like material (Macor) surface is discussed for the case of heat input from above the surface by radiant heating panels. Previous validated computations, for the case of heat input by conduction from below the solid, have shown that a one-dimensional model for the transient conduction in the liquid provides a reasonable representation of the phenomena in a thin water layer (*diMarzo et al., 1993*). With reference to the shape factor  $\beta$  (see *diMarzo et al., 1992*) the droplet configuration for the radiant heat input case exhibits a larger value of  $\beta$  than for a similar conduction heat input case thus reinforcing the one-dimensional hypothesis. Three aspects of the modelling effort are outlined here: a) the effect of direct radiation from above on the droplet evaporation; b) the three sub-models used for the liquid layer during the various phases of the transient; and c) the evolution of the droplet shape during the transient.

Direct Radiation. The geometry of the radiant heat source has been described in Fig. 1 where the three electric radiant panels located above the surface are identified in terms of their respective fractional surface area coverage at various polar angles  $\phi$ . Note the cumulative effect of the two truncated conical panels on either side of the surface and the third, lower-aspect-ratio panel located around the whole surface around its perimeter. The following assumptions are made: a) the radiant panels behaves as black bodies; b) the radiation scattering within the water droplet is negligible; c) the liquid-vapor interface is horizontal and flat; and d) the radiation reaching the liquid-solid interface is completely absorbed by the solid. The volumetric heat generation in the liquid layer is given as:

exhibits a low-aspect-ratio disk-like shape which then regresses to a spherical cap with shrinking base. The model generating the transient droplet shape assumes that, at the receding angle, the droplet has reached a spherical cap configuration. This is reasonable because, in order for the surface tension to shrink the wetted surface, the liquid-vapor surface configuration must maximize the bounded volume. This receding angle configuration identifies the aspect ratio of the droplet which will be preserved for all the remaining portion of the transient. Considering the apex of the droplet at the receding angle, one can construct an initial droplet shape with identical apex. This configuration yields the maximum contact angle  $\theta_{\max}$ . Chandra and Avedisian<sup>a</sup> showed that, for an evaporating droplet, this angle is less than or equal to  $90^\circ$ . Should the computed  $\theta_{\max}$  exceed  $90^\circ$ , then the initial configuration will exhibit an apex higher than the apex at the receding condition (if one maintains the contact angle at  $90^\circ$ ). The minimum value of the contact angle  $\theta_{\min}$  can be found by imposing a spherical cap configuration at deposition. This configuration is possible only if the value of  $\theta_{\min}$  is greater than or equal to the receding angle. A sensitivity study of the effect of  $\theta_0$  shows that its impact is not significant. It is reasonable to argue that its upper bound is more physically justifiable (if one assumes that the recoiling phenomenon observed by Chandra and Avedisian<sup>a</sup> is limited). Figure 4 illustrates the transient droplet configuration for the case of  $\theta_{\max}$  exceeding  $90^\circ$ . In this case, a locus of the intercepts of the tangents to the liquid-vapor interface at the apex and at the liquid-vapor-solid contact point is traced. The equation describing this locus univocally determines the transient droplet shape. Note that for the case of  $\theta_{\max}$  less than or equal to  $90^\circ$ , this locus reduces to a horizontal line tangent the droplet apex.

Extensive validation of this model is currently being conducted and it is providing significant insight into the evaporative cooling process. The results of this model constitute the basis for the code simulating the cooling effect of a water spray (Tartarini *et al.* 1992) which is being developed and validated against the data of Dawson and diMarzo, 1993.

#### Reports and Papers:

1. M. di Marzo, C.H. Kidder, P. Tartarini, "Infrared thermography of Dropwise Evaporative Cooling of a Semiinfinite Solid Subjected to Radiant Heat Input" *Experimental Heat Transfer*, Vol. 5, pp. 101-114 (1992)
2. M. di Marzo, P. Tartarini, Y. Liao, D. Evans, H. Baum, "Evaporative Cooling Due to a Gently deposited Droplet" *International Journal of Heat and Mass Transfer*, in press (1993)
3. P. Tartarini, Y. Liao, M. di Marzo, "Numerical Simulation of Multi-Droplet Evaporative Cooling" *Proceedings of the X UIT National Heat Transfer Conference*, Genova, Italy, pp. 123-132 (1992) also appeared in *Heat and Technology*, Vol. 11, No. 1-2, pp. 98-106 (1993)
4. H. Dawson, M. di Marzo, "Multi-Droplet Evaporative Cooling: Experimental Results" *Proceedings of the 29th ASME/AIChE/ANS National Heat Transfer Conference*, Atlanta, GA, (1993)

<sup>a</sup> S. Chandra, C.T. Avedisian, "On the Collision of a Droplet With a Solid Surface" *Proceedings of the Royal Society of London, A*, Vol. 432, pp. 13-41 (1991)

## **Part 2.0 Alphabetical Listing of BFRL Fire Research Grantees and Their Grants**

|  | Page |
|--|------|
| California Institute of Technology   |      |
| Experimental Study of Heat Transfer and the Environment in a Room Fire . . . . .                           | 51   |
| Clemson University   |      |
| Computational Heat Transfer for Zone File Modeling . . . . .   | 71   |
| Mathematical Modeling of Human Egress from Fires in Residential Buildings . . . . .                        | 85   |
| Factory Mutual Research Corporation  |      |
| Prediction of Fire Dynamics . . . . .  | 159  |
| George Washington University   |      |
| Experimental and Modeling Studies of Soot and Carbon Monoxide in an Ethylene/Air Diffusion Flame . . . . . | 29   |
| Kansas State University  |      |
| Light Scattering Studies of Fractal Soot Aggregates . . . . .  | 35   |
| Massachusetts Institute of Technology  |      |
| Computer Simulation of the Environmental Impact of Large Fires: Plume Rise and Dispersion . . . . .        | 93   |
| National Fire Protection Association   |      |
| EXIT89 . . . . .   | 79   |
| Pennsylvania State University  |      |
| Fundamental Mechanisms for CO and Soot Formation in Diffusion Flames . . . . .                             | 13   |
| Upward Flame Spread on a Vertical Wall Under External Radiation . . . . .                                  | 167  |
| Purdue University  |      |
| Study of Entrainment and Flow Patterns in Pool Fires Using Particle Imaging Velocimetry . . . . .          | 111  |
| Study of Simulated Oil Well Blowout Fires and Flares . . . . .   | 115  |
| Rutgers, the State University of New Jersey  |      |
| Movement of Smoke and Hot Gases in Open Shafts . . . . .   | 59   |
| University of California, Berkeley   |      |
| Fire Propagation in Concurrent Flows . . . . .   | 19   |
| Large Fire Analyses . . . . .  | 99   |

NIST-114  
(REV. 6-93)  
ADMAN 4.09

U.S. DEPARTMENT OF COMMERCE  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY

MANUSCRIPT REVIEW AND APPROVAL

(ERB USE ONLY)

ERB CONTROL NUMBER

DIVISION

PUBLICATION REPORT NUMBER  
NISTIR 5263

CATEGORY CODE

INSTRUCTIONS: ATTACH ORIGINAL OF THIS FORM TO ONE (1) COPY OF MANUSCRIPT AND SEND TO THE SECRETARY, APPROPRIATE EDITORIAL REVIEW BOARD.

PUBLICATION DATE  
September 1993

NUMBER PRINTED PAGES  
184

TITLE AND SUBTITLE (CITE IN FULL)

Summaries of BFRL Fire Research In-House Projects and Grants, 1993

CONTRACT OR GRANT NUMBER

TYPE OF REPORT AND/OR PERIOD COVERED

AUTHOR(S) (LAST NAME, FIRST INITIAL, SECOND INITIAL)

Jason, Nora H.

PERFORMING ORGANIZATION (CHECK (X) ONE BOX)

☒ NIST/GAITHERSBURG  
☐ NIST/BOULDER  
☐ JILA/BOULDER

LABORATORY AND DIVISION NAMES (FIRST NIST AUTHOR ONLY)

Building and Fire Research Laboratory, Fire Safety Engineering Division

SPONSORING ORGANIZATION NAME AND COMPLETE ADDRESS (STREET, CITY, STATE, ZIP)

PROPOSED FOR NIST PUBLICATION

☐  
☐  
☐  
☐  
☐

JOURNAL OF RESEARCH (NIST JRES)  
J. PHYS. & CHEM. REF. DATA (JPCRD)  
HANDBOOK (NIST HB)  
SPECIAL PUBLICATION (NIST SP)  
TECHNICAL NOTE (NIST TN)

☐  
☐  
☐  
☐  
☒

MONOGRAPH (NIST MN)  
NATL. STD. REF. DATA SERIES (NIST NSRDS)  
FEDERAL INF. PROCESS. STDS. (NIST FIPS)  
LIST OF PUBLICATIONS (NIST LP)  
NIST INTERAGENCY/INTERNAL REPORT (NISTIR)

☐  
☐  
☐  
☐

LETTER CIRCULAR  
BUILDING SCIENCE SERIES  
PRODUCT STANDARDS  
OTHER

PROPOSED FOR NON-NIST PUBLICATION (CITE FULLY)

☐

U.S.

☐

FOREIGN

PUBLISHING MEDIUM

☒  
☐  
☐

PAPER  
DISKETTE (SPECIFY)

☐

CD-ROM

OTHER (SPECIFY)

SUPPLEMENTARY NOTES

ABSTRACT (A 2000-CHARACTER OR LESS FACTUAL SUMMARY OF MOST SIGNIFICANT INFORMATION. IF DOCUMENT INCLUDES A SIGNIFICANT BIBLIOGRAPHY OR LITERATURE SURVEY, CITE IT HERE. SPELL OUT ACRONYMS ON FIRST REFERENCE.) (CONTINUE ON SEPARATE PAGE, IF NECESSARY.)

This report describes the fire research projects performed in the Building and Fire Research Laboratory (BFRL) Fire Research Program and under its grants program from October 1, 1992 through September 30, 1993.

KEY WORDS (MAXIMUM OF 9; 28 CHARACTERS AND SPACES EACH; SEPARATE WITH SEMICOLONS; ALPHABETIC ORDER; CAPITALIZE ONLY PROPER NAMES)

Charring; combustion; fire models; fire research; flame spread; blowout fires; hazards; ignition; polymers; soot; smoke; sprinklers

AVAILABILITY

☒  
☐  
☒

UNLIMITED

☐

FOR OFFICIAL DISTRIBUTION - DO NOT RELEASE TO NTIS

ORDER FROM SUPERINTENDENT OF DOCUMENTS, U.S. GPO, WASHINGTON, DC 20402

ORDER FROM NTIS, SPRINGFIELD, VA 22161

NOTE TO AUTHOR(S): IF YOU DO NOT WISH THIS MANUSCRIPT ANNOUNCED BEFORE PUBLICATION, PLEASE CHECK HERE. ☐

ELECTRONIC FORM